


DESIGN NOTES:


Design: AASHTO LRFD Bridge Design Specifications, 4th edition with California Amendments. ACPA DESIGN DATA 1, October 2007. INDIRECT DESIGN METHOD

Soil: w Fe = 162 pcf Installation Type 1
 w Fe = 168 pcf Installation Types 2 & 3
 w = Unit weight of soil (pcf)
 Fe = Soil-structure interaction factor

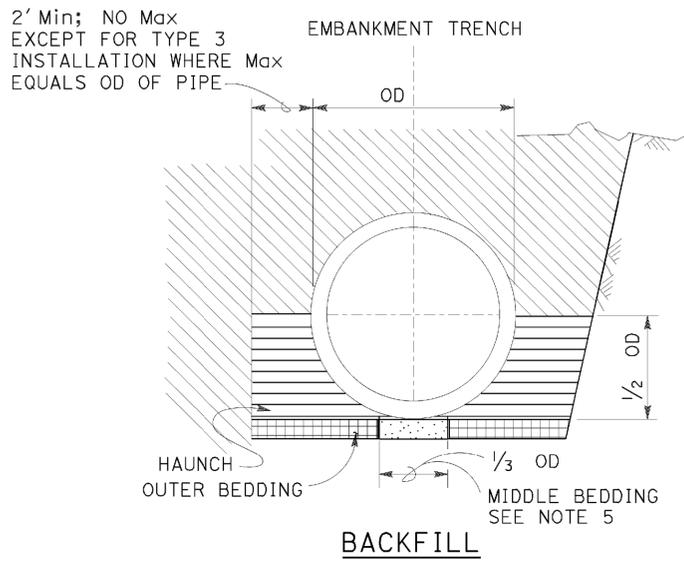

LEGEND:

	ROADWAY EMBANKMENT
	STRUCTURE BACKFILL (CULVERT) FOR HAUNCH SEE NOTE 6
	STRUCTURE BACKFILL (CULVERT) FOR OUTER BEDDING SEE NOTE 6
	LOOSE BACKFILL
	STRUCTURE EXCAVATION (CULVERT)

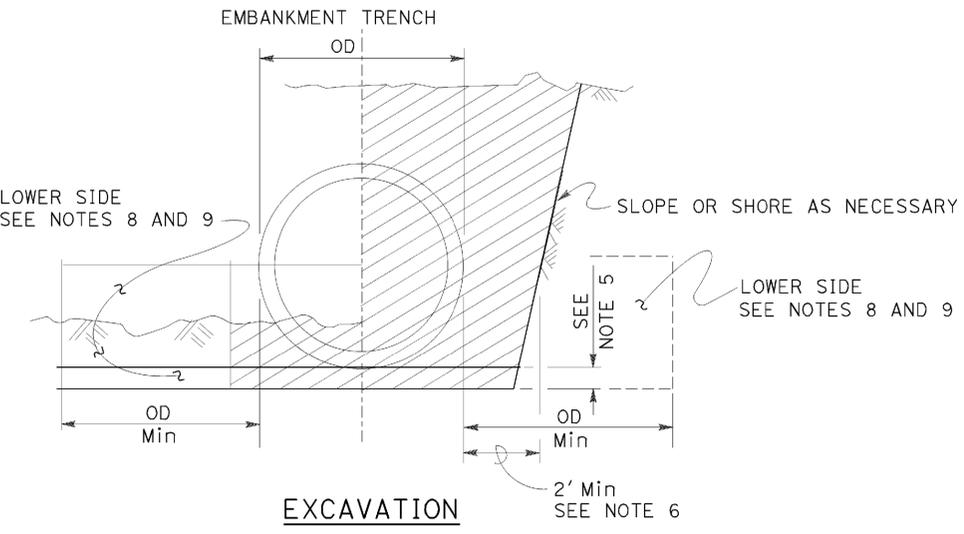

INSTALLATION TYPE 1:

The haunch and outer bedding shall be compacted to a minimum 90 percent relative compaction. In addition, the minimum sand equivalent in these areas shall be 30 and the maximum percentage passing the No. 200 sieve size shall be 12.

INSTALLATION TYPE 2:

The haunch and outer bedding shall be compacted to a minimum 90 percent relative compaction. In addition, the minimum sand equivalent in these areas shall be 25.

INSTALLATION TYPE 3:

The haunch and outer bedding shall be compacted to a minimum 85 percent relative compaction. 90 percent relative compaction will be required where the fill over the pipe is less than 4'-0" or 1/2 OD. In addition, the minimum sand equivalent in these areas shall be 25 and the material shall not contain rocks, broken concrete, or other solid material exceeding 3" in greatest dimension.

INSTALLATION TYPE 1

MINIMUM CLASS AND D-LOAD	COVER	
	60" Dia AND SMALLER	OVER 60" Dia TO 120" Dia Max
CLASS II 1000D	14.9'	12.9'
CLASS III 1350D	15.0' - 21.9'	13.0' - 18.9'
CLASS III SPECIAL 1700D	22.0' - 27.9'	19.0' - 24.9'
CLASS IV 2000D	28.0' - 32.9'	25.0' - 29.9'
CLASS IV SPECIAL 2500D	33.0' - 41.9'	30.0' - 38.9'
CLASS I 3000D	42.0' - 49.9'	39.0' - 46.9'
CLASS I SPECIAL 3600D	50.0' - 60.0'	47.0' - 58.0'

INSTALLATION TYPE 2

MINIMUM CLASS AND D-LOAD	COVER	
	60" Dia AND SMALLER	OVER 60" Dia TO 120" Dia Max
CLASS II 1000D	11.9'	9.9'
CLASS III 1350D	12.0' - 15.9'	10.0' - 14.9'
CLASS III SPECIAL 1700D	16.0' - 20.9'	15.0' - 19.9'
CLASS IV 2000D	21.0' - 24.9'	20.0' - 23.9'
CLASS IV SPECIAL 2500D	25.0' - 31.9'	24.0' - 30.9'
CLASS I 3000D	32.0' - 37.9'	31.0' - 37.9'
CLASS I SPECIAL 3600D	38.0' - 46.0'	38.0' - 46.0'

INSTALLATION TYPE 3

MINIMUM CLASS AND D-LOAD	COVER	
	60" Dia AND SMALLER	OVER 60" Dia TO 120" Dia Max
CLASS II 1000D	8.9'	5.9'
CLASS III 1350D	9.0' - 11.9'	6.0' - 10.9'
CLASS III SPECIAL 1700D	12.0' - 15.9'	11.0' - 13.9'
CLASS IV 2000D	16.0' - 18.9'	14.0' - 17.9'
CLASS IV SPECIAL 2500D	19.0' - 24.9'	18.0' - 22.9'
CLASS I 3000D	25.0' - 29.9'	23.0' - 28.9'
CLASS I SPECIAL 3600D	30.0' - 36.0'	29.0' - 35.0'

NOTES:


- Unless otherwise shown on the plans or specified in the special provision, the Contractor shall have the option of selecting the class of RCP and the type of installation to be used, provided the height of cover does not exceed the value shown for the RCP selected.
 Example: 24" RCP culvert with maximum cover of 24'-0" the options are:
 a) Class III Special or stronger with Installation Type 1.
 b) Class IV or stronger with Installation Type 2.
 c) Class IV Special or stronger with Installation Type 3.
 Cover is defined as the maximum vertical distance from top of the pipe to finished grade within the length of any given culvert.
- The class of RCP and Installation Type selected shall be the same throughout the length of any given culvert.
- The "length of any culvert" is defined as the culvert between:
 a) Successive drainage structure (inlets, junction boxes, headwalls, etc.).
 b) A drainage structure and the inlet or outlet end of the culvert.
 c) The inlet and outlet end of the culvert when there are no intervening drainage structures.
- Oval and arch shaped RCP shall not be used.
- Bedding depth: 1/25 OD Min, not less than 3".
- Slurry cement backfill may be substituted for backfill in the outer bedding and haunch areas. If slurry is used, the outer and middle beddings shall be omitted. Prior to installation, the soil under the middle 1/3 of the outside diameter of the pipe shall be softened by scarifying or other means to a minimum depth of 1/25 OD, but not less than 3". Where slurry cement backfill is used, clear distance to trench wall may be reduced as set forth in the Standard Specifications.
- Backfill shall be placed full width of excavation except where dimensions are shown for backfill width or thickness. Dimensions shown are minimum.
- Lower side shall be suitable material as determined by the Engineer. Otherwise it shall be considered unsuitable as set forth in of the Standard Specifications. See Note 9.
- Where the pipe is placed in a trench, if the trench walls are sloped at 5 vertical to 1 horizontal or steeper for at least 90 percent of the trench height or up to not less than 12" from the grading plane, the firmness of the soil in the lower side need not be considered.
- Non-reinforced precast concrete pipe sizes 3'-0" or smaller may be placed under installation Types 1, 2 or 3.

STATE OF CALIFORNIA
 DEPARTMENT OF TRANSPORTATION
**EXCAVATION AND BACKFILL
 CONCRETE PIPE CULVERTS
 INDIRECT DESIGN METHOD**
 NO SCALE

RSP A62DA DATED JULY 18, 2014 SUPERSEDES STANDARD PLAN A62DA
 DATED MAY 20, 2011 - PAGE 24 OF THE STANDARD PLANS BOOK DATED 2010.


REVISED STANDARD PLAN RSP A62DA

Dist	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET NO.	TOTAL SHEETS
02	Piu	89	20.0/20.6	202	235










 REGISTERED CIVIL ENGINEER
 October 30, 2015
 PLANS APPROVAL DATE
THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.


 REGISTERED PROFESSIONAL ENGINEER
 No. C59976
 Exp. 6-30-16
 CIVIL
 STATE OF CALIFORNIA

TO ACCOMPANY PLANS DATED 01-19-16

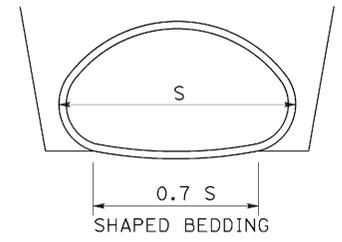

SHAPED BEDDING
S = Larger than 84"

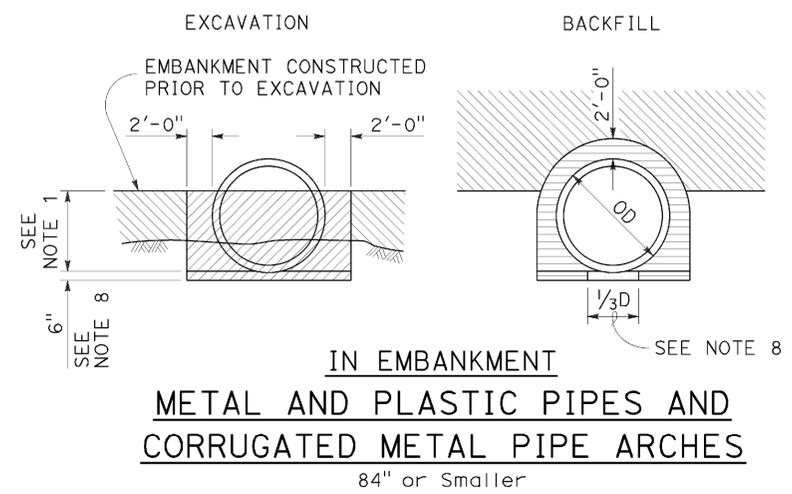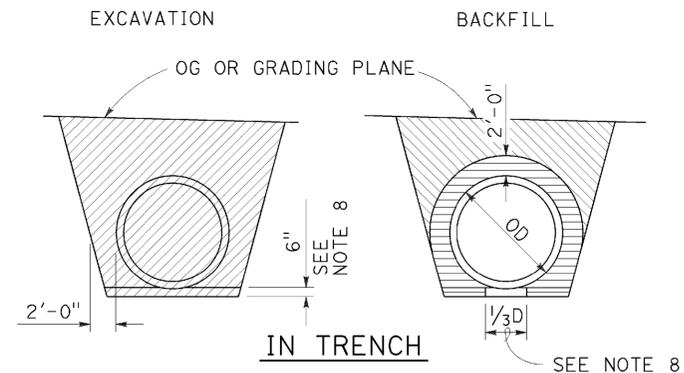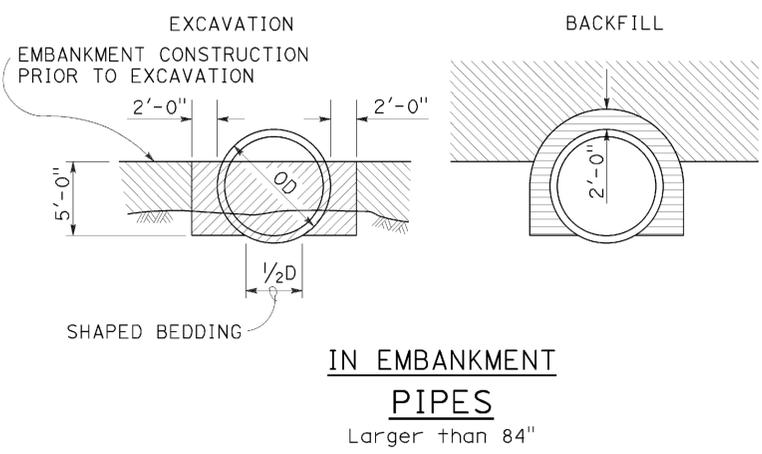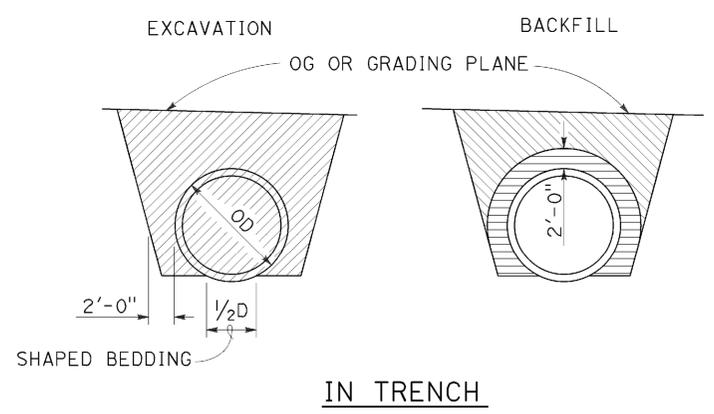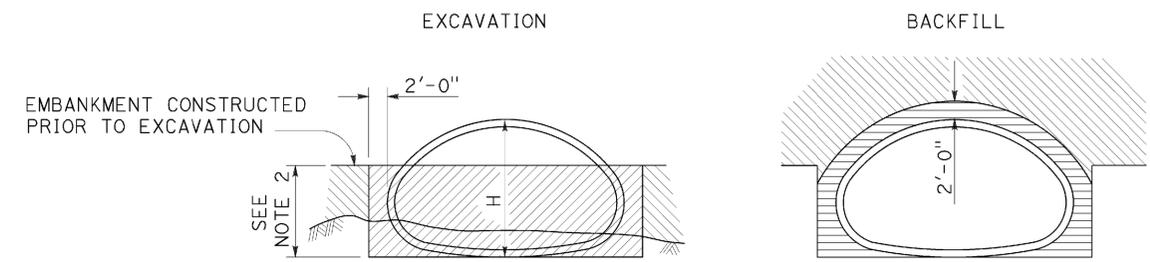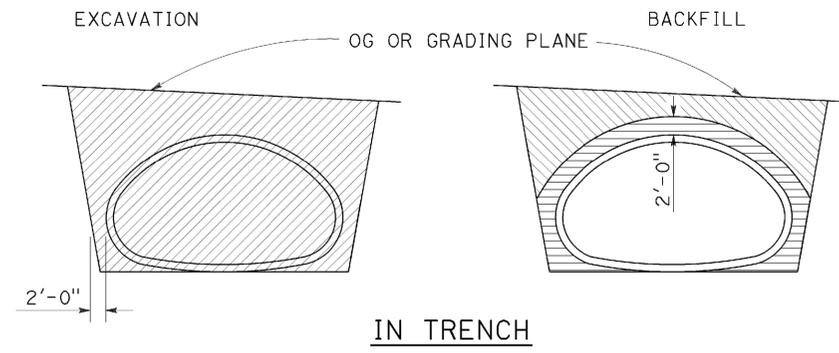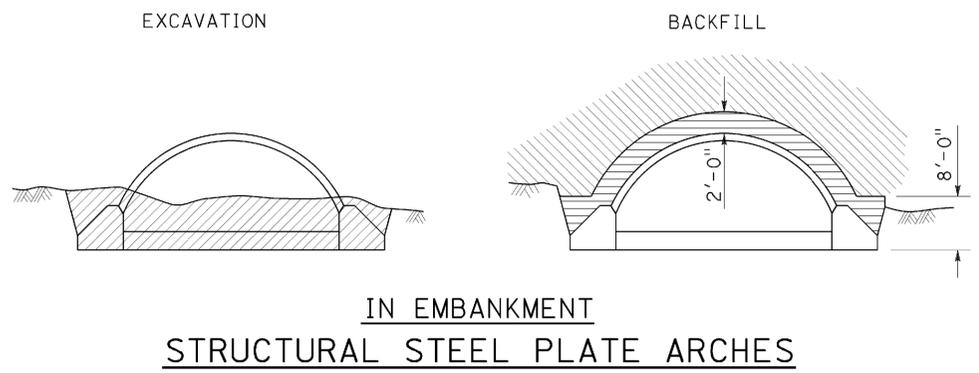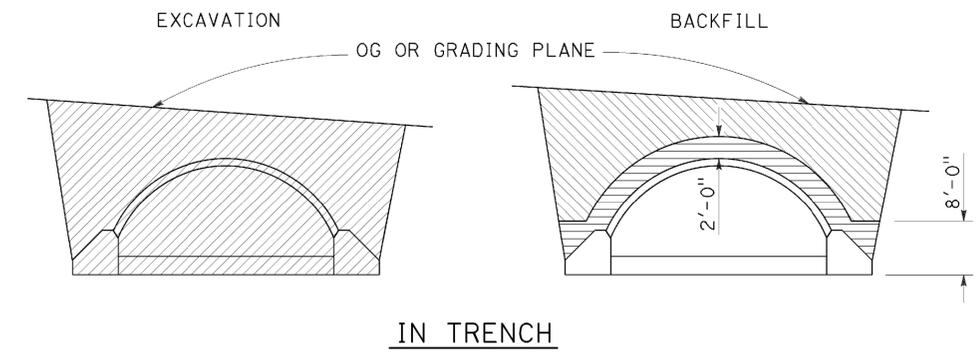

NOTES:

1. PIPES: 30" minimum for diameters up to and including 42" then $\frac{2}{3}$ diameter but no more than 60" required. CORRUGATED METAL PIPE ARCHES: 30" maximum.
2. $\frac{2}{3}$ H up to 60" maximum.
3. Slope or shore excavation sides as necessary.
4. Backfill shall be placed full width of excavation except as noted.
5. Diagrams do not apply to overside drains.
6. Dimensions shown are minimum.
7. Construction strutting of structural steel plate pipe, arches and vehicular undercrossing to be used when shown on the project plans. When shown, see Standard Plan D88A for strutting requirements.
8. Excavation below pipe and 80% relative compaction requirements for plastic pipes only.
9. D is the inside diameter (ID) of the pipe.

LEGEND

	STRUCTURE EXCAVATION (CULVERT)		ROADWAY EMBANKMENT
	STRUCTURE BACKFILL (CULVERT) 95% RELATIVE COMPACTION		STRUCTURE BACKFILL (CULVERT) 80% RELATIVE COMPACTION

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

EXCAVATION AND BACKFILL
METAL AND PLASTIC CULVERTS
NO SCALE

RSP A62F DATED OCTOBER 30, 2015 SUPERSEDES STANDARD PLAN A62F DATED MAY 20, 2011 - PAGE 26 OF THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP A62F

Dist	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	Piu	89	20.0/20.6	203	235


Randell D. Hiatt
REGISTERED CIVIL ENGINEER

July 19, 2013
PLANS APPROVAL DATE


THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

TO ACCOMPANY PLANS DATED 01-19-16


REGISTERED PROFESSIONAL ENGINEER
Randell D. Hiatt
No. C50200
Exp. 6-30-15
CIVIL
STATE OF CALIFORNIA

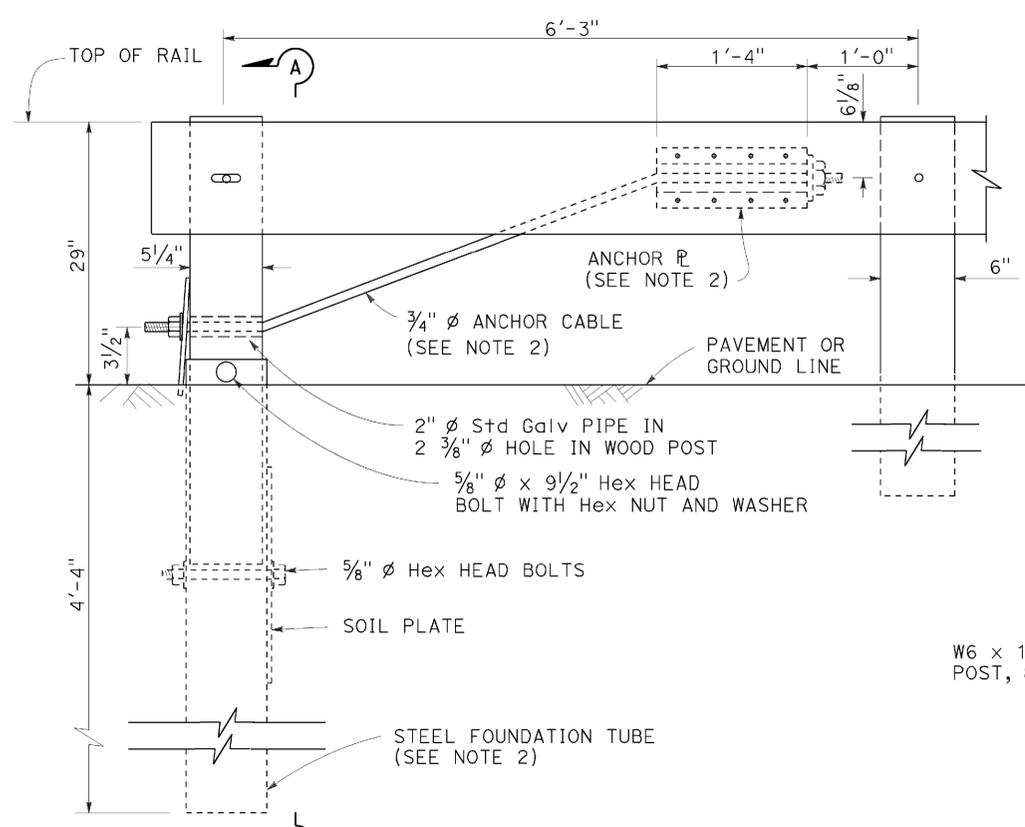


**ELEVATION
END ANCHOR
ASSEMBLY (TYPE SFT)**

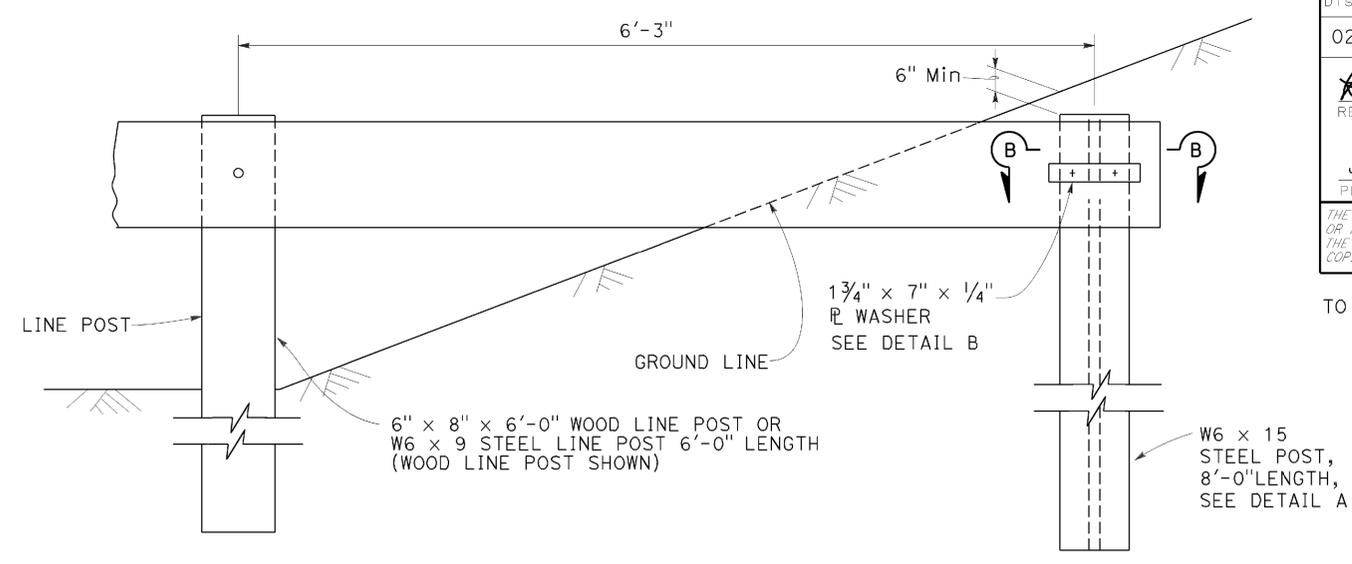


BURIED POST END ANCHOR

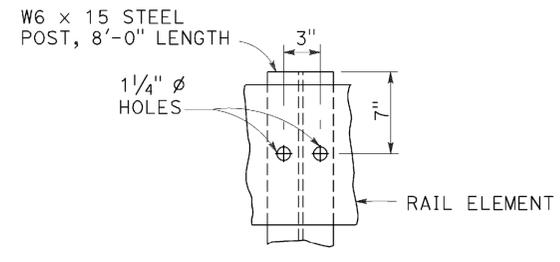


DETAIL A

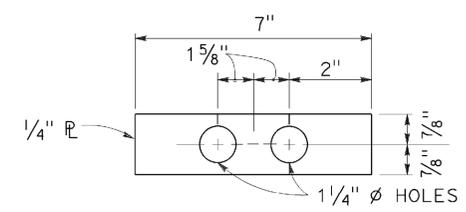


DETAIL B

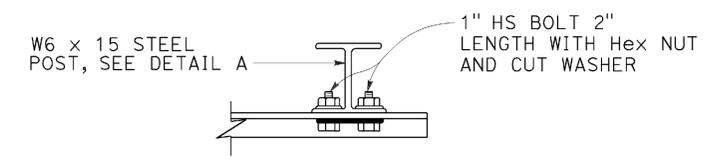

SECTION B-B

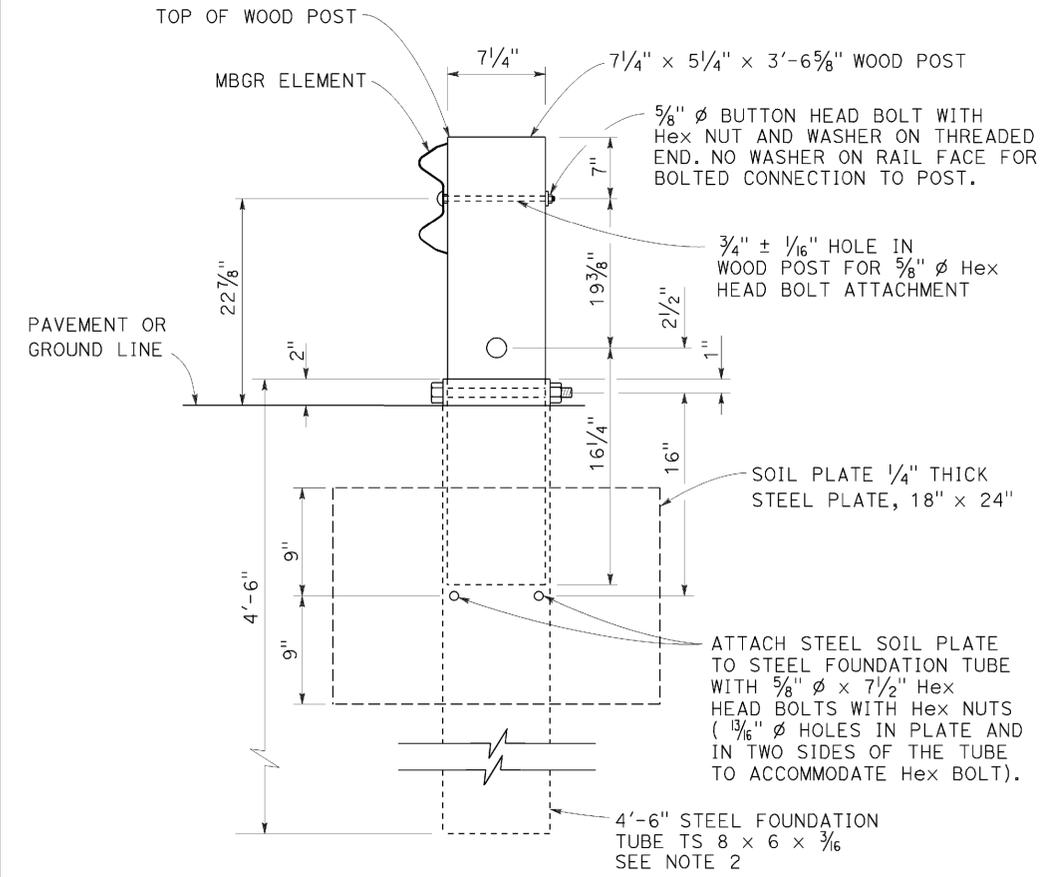

SECTION A-A

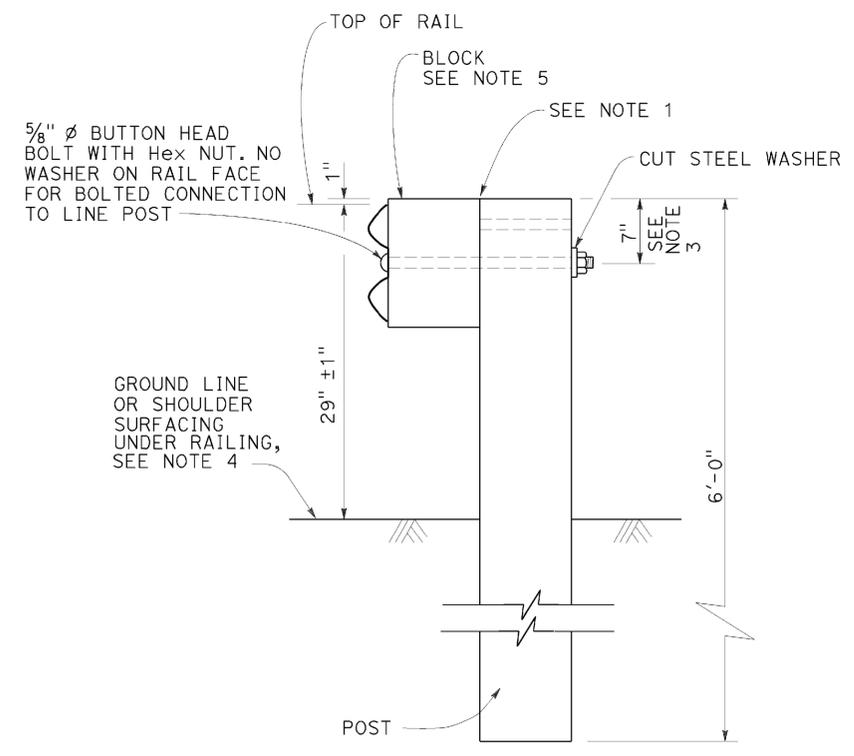

**TYPICAL LINE
POST INSTALLATION**

NOTES:

- For wood post and wood block, toenail with 2-16d Galv nails in top of block. For steel post and notched wood or plastic block, notched face of block faces steel post.
- A 6'-0" Length steel foundation tube, TS 8 x 6 x 3/16, without a soil plate, may be furnished and installed in place of the 4'-6" length steel foundation tube and soil plate shown. Minimum embadment of the 6'-0" length tube shall be 5'-9". A 5/8" diameter Hex head bolt and nut shall be installed in the hole in the 6'-0" length tube to keep the wood post from dropping into the tube.
- To connect railing to 27" terminal system end treatment, transition the top of railing height at a ratio of 120:1 to terminal system end treatment height plus one 12'-6" standard railing section at the transitioned height for a horizontal connection to the end treatment.
- Install posts in soil.
- See Revised Standard Plans RSP A77N1 and RSP A77N2 for details.
- Holes excavation in the slope to construct the buried post end anchor shall be backfilled with selected earth, placed in layers approximately 1'-0" thick. Each layer shall be moistened and thoroughly compacted.

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

**METAL BEAM GUARD RAILING
RECONSTRUCT INSTALLATION**

NO SCALE

RSP A77L3 DATED JULY 19, 2013 SUPPLEMENTS THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP A77L3


DIST	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	Piu	89	20.0/20.6	204	235

Raymond Don Tsztoo
 REGISTERED CIVIL ENGINEER
 October 19, 2012
 PLANS APPROVAL DATE


REGISTERED PROFESSIONAL ENGINEER
 Raymond Don Tsztoo
 No. C37332
 Exp. 6-30-14
 CIVIL
 STATE OF CALIFORNIA

THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.


TO ACCOMPANY PLANS DATED 01-19-16

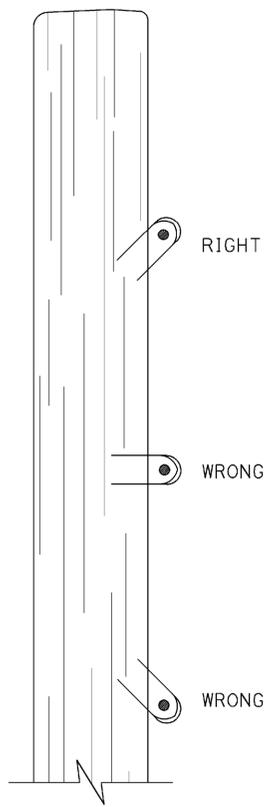

DRIVE STAPLES AT ANGLE

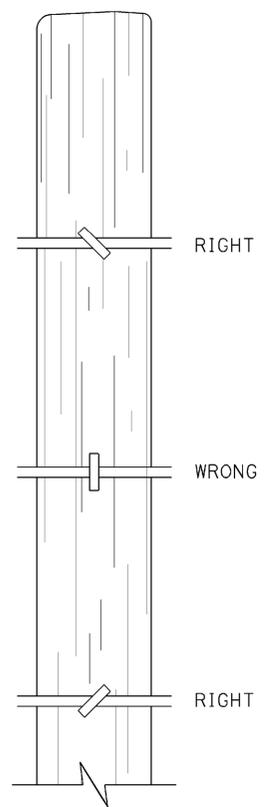


DO NOT DRIVE STAPLES PARALLEL TO SIDE OF POST

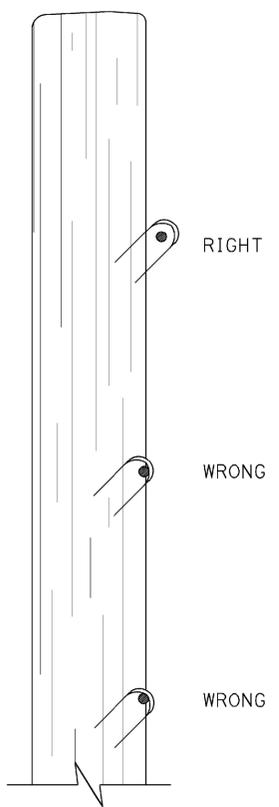


LEAVE WIRE LOOSE IN STAPLE

LINE POST STAPLING DETAILS


(Apply to rectangular/square and round posts)
Do not staple vertical wire in wire mesh.

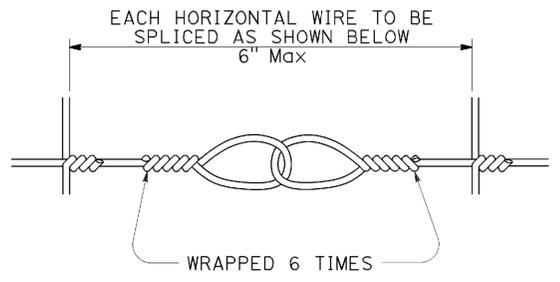

SPLICE DETAIL FOR BARBED WIRE/WIRE MESH FENCE

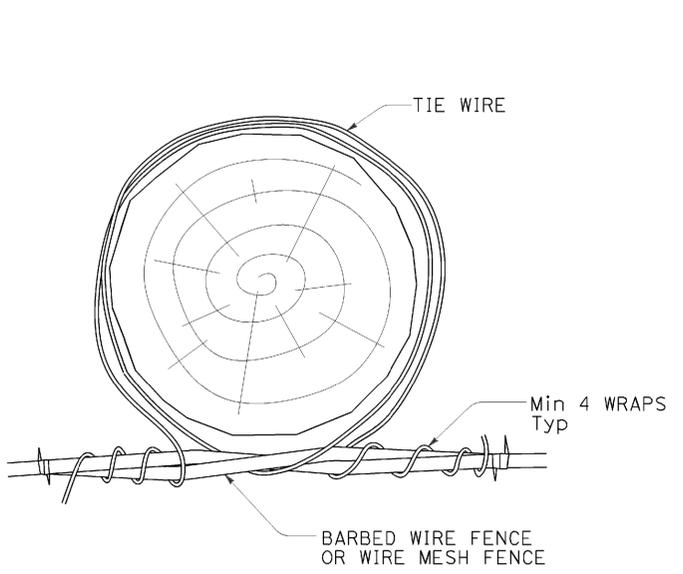


OPTION A

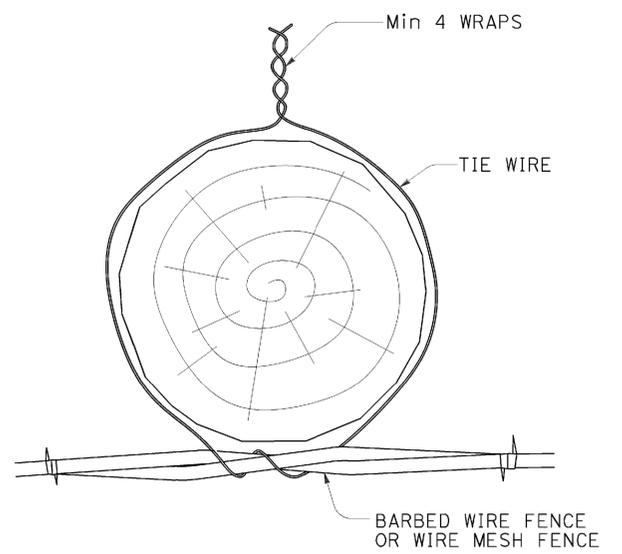

OPTION B

LINE POST WIRE TIE OPTION DETAILS

(Option details also apply to rectangular/square posts)

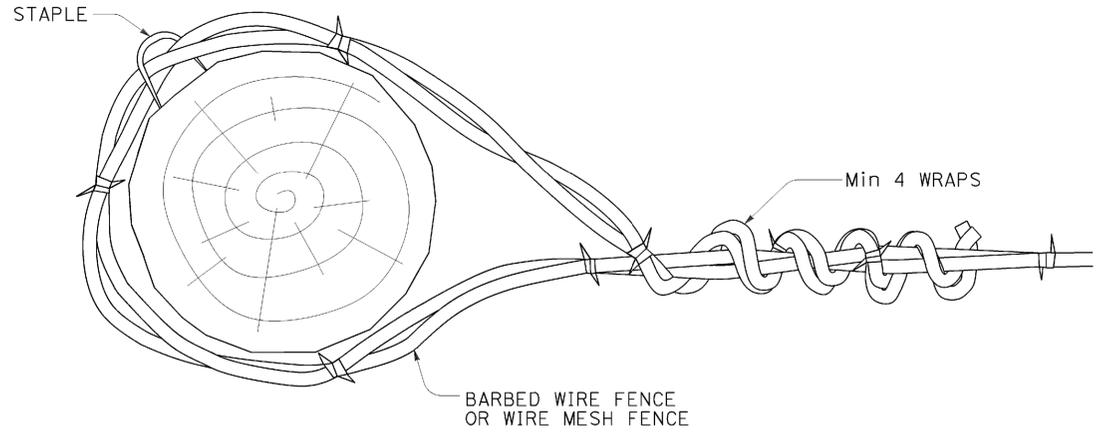

END, LATCH, PULL, AND CORNER POST DETAIL

(Also applies to rectangular/square posts)



BARBED WIRE AND WIRE MESH FENCE - MISCELLANEOUS DETAILS

NO SCALE


RSP A86D DATED OCTOBER 19, 2012 SUPPLEMENTS THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP A86D

TO ACCOMPANY PLANS DATED 01-19-16

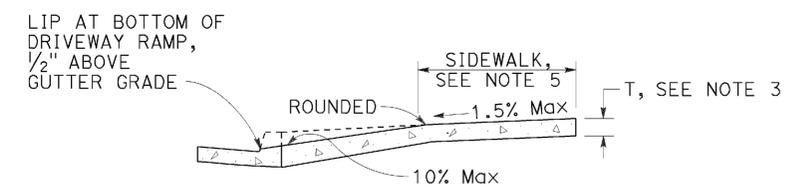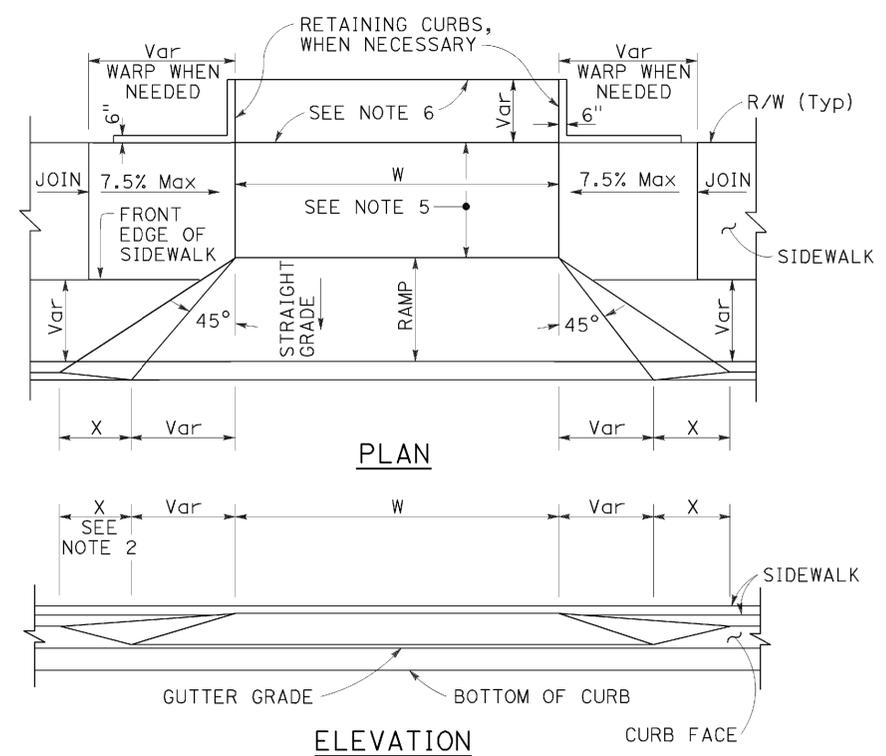

CASE A
Typical driveway, sidewalk not depressed

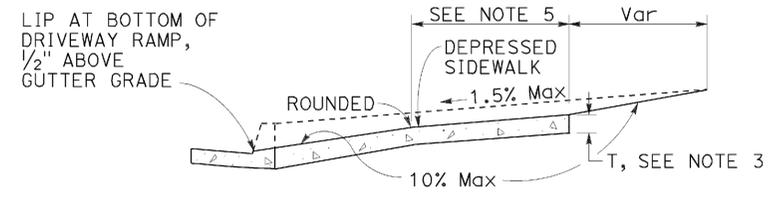

CASE B
Driveway with depressed sidewalk

SECTIONS


TABLE A

CURB TYPE	DIMENSIONS			
	"H1"	"H2"	"W1"	"W2"
A1-6	1'-2"	6"	7 1/2"	1 1/2"
A1-8	1'-4"	8"	8"	2"
A2-6	1'-0"	6"	2'-7 1/2"	1 1/2"
A2-8	1'-2"	8"	2'-8"	2"
A3-6	6"	5"	7 1/4"	1 1/4"
A3-8	8"	7"	7 3/4"	1 3/4"
B1-4	1'-0"	4"	7 1/2"	2 1/2"
B1-6	1'-2"	6"	9"	4"
B2-4	10"	4"	2'-7 1/2"	2 1/2"
B2-6	1'-0"	6"	2'-9"	4"
B3-4	4"	3"	7"	2"
B3-6	6"	5"	8 1/2"	3 1/2"
D-4	10"	4"	1'-6"	1'-1"
D-6	1'-0"	6"	2'-2"	1'-9"


CURB QUANTITIES

TYPE	CUBIC YARDS PER LINEAR FOOT
A1-6	0.02585
A1-8	0.03084
A2-6	0.05903
A2-8	0.06379
A3-6	0.01036
A3-8	0.01435
B1-4	0.02185
B1-6	0.02930
B2-4	0.05515
B2-6	0.06171
B3-4	0.00641
B3-6	0.01074
B4	0.05709
D-4	0.04083
D-6	0.06804
E	0.06661


DRIVEWAYS




TYPE A1 CURBS
See Table A

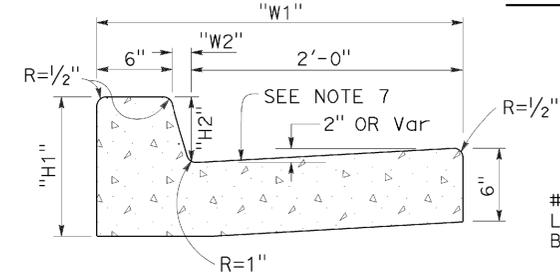


TYPE A2 CURBS
See Table A

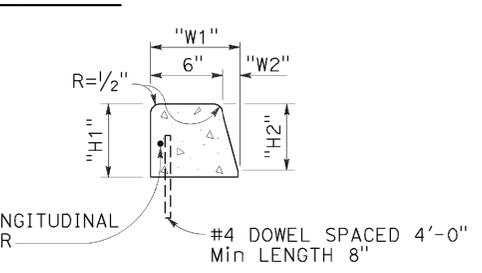


TYPE A3 CURBS
Superimposed on existing pavement
See Table A

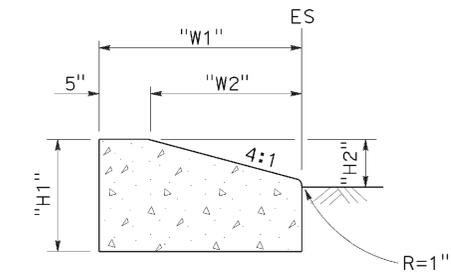


TYPE D CURBS
See Table A

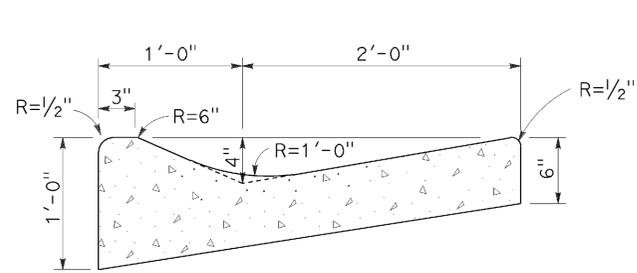


TYPE E CURB




TYPE B1 CURBS
See Table A

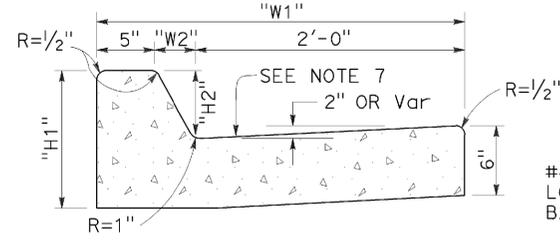


TYPE B2 CURBS
See Table A

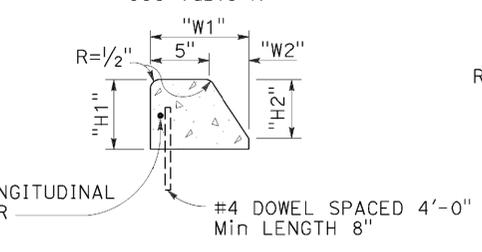

TYPE B3 CURBS
Superimposed on existing pavement
See Table A

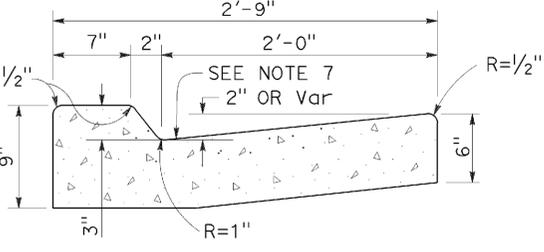

TYPE B4 CURBS

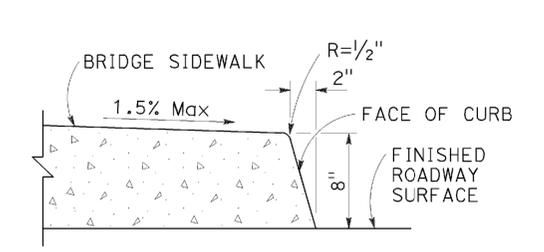

TYPE H CURB
On Bridges

CURBS

- NOTES:**
- Case A driveway section typically applies.
 - X=3'-0" except for curb heights over 10" where 4:1 slopes shall be used on curb slope.
 - Sidewalk and ramp thickness "T" at driveway shall be 4" for residential and 6" for commercial.
 - Difference in slope of the driveway ramp and the slope of a line between the gutter and a point on the roadway 5'-0" from gutter line shall not exceed 15%. Reduce driveway ramp slope, not gutter slope, where required.

- Minimum width of clear passageway for sidewalk shall be 4'-2".
- Retaining curbs and acquisition of construction easement may be necessary for narrow sidewalks or curb heights in excess of 6".
- Across the pedestrian route at curb ramp locations, the gutter pan slope shall not exceed 1" of depth for each 2'-0" of width.

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

CURBS AND DRIVEWAYS

NO SCALE


RSP A87A DATED JULY 19, 2013 SUPERSEDES STANDARD PLAN A87A
DATED MAY 20, 2011 - PAGE 119 OF THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP A87A


Dist	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	Piu	89	20.0/20.6	206	235

H. David Cordova
 REGISTERED CIVIL ENGINEER
 No. C41957
 Exp. 3-31-16
 CIVIL
 STATE OF CALIFORNIA


July 3, 2015
 PLANS APPROVAL DATE
 THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

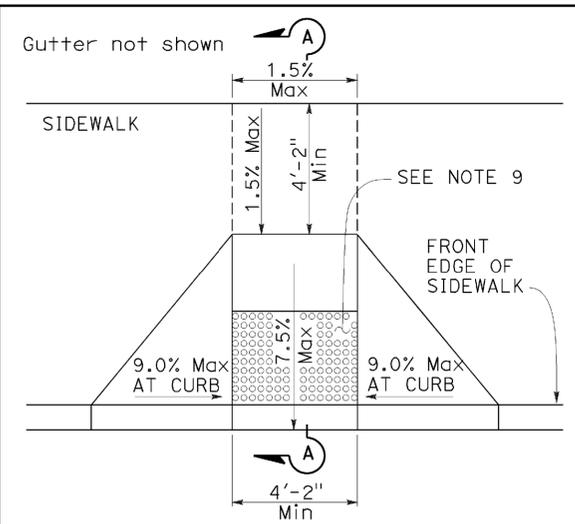


CASE A

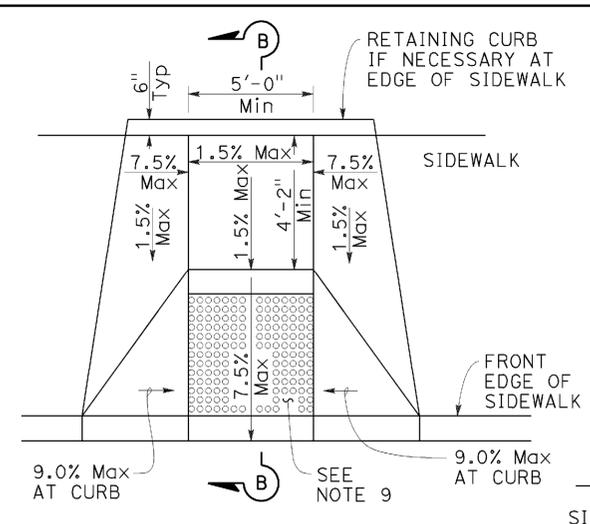


CASE B

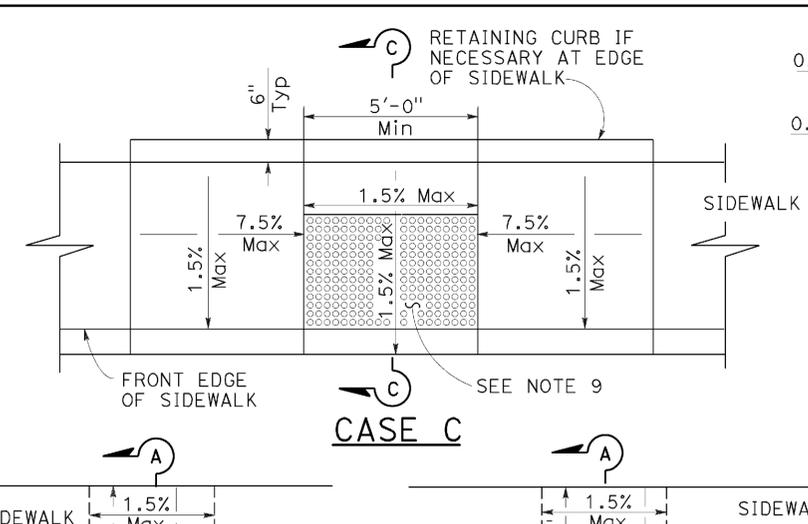


CASE C

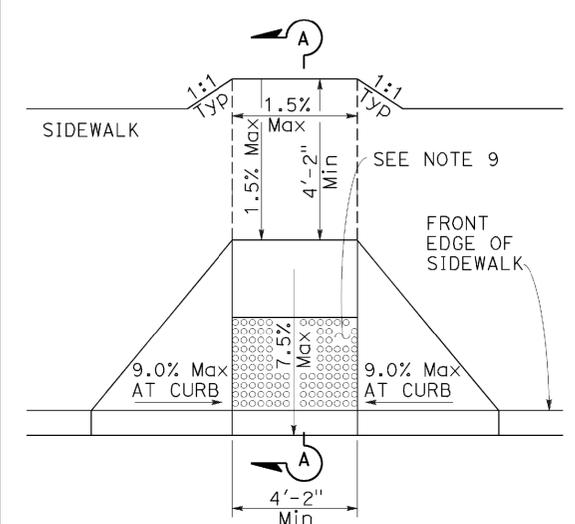


CASE D

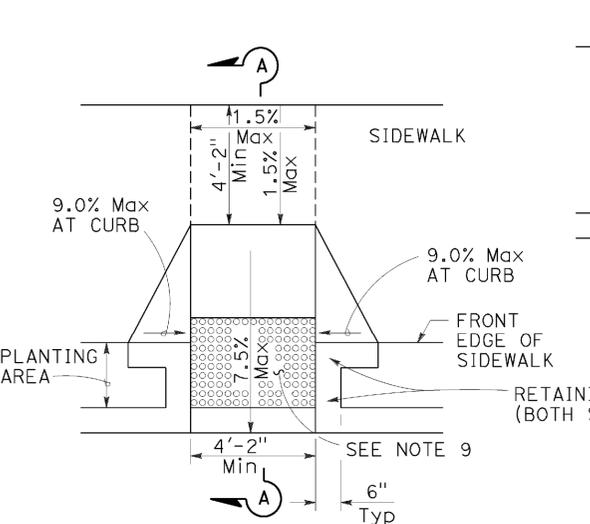


CASE E

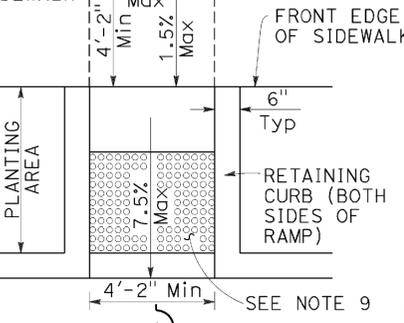

CASE F

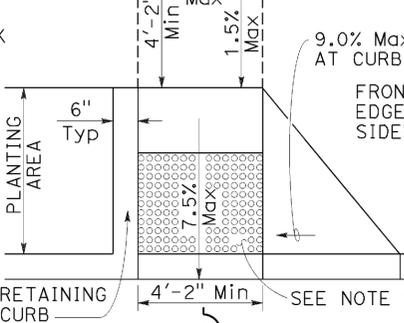


CASE G

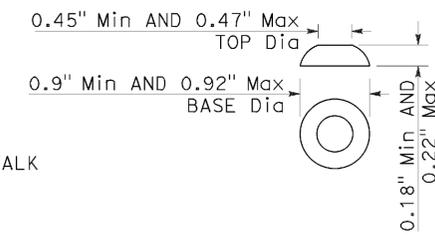


RAISED TRUNCATED DOME

NOTES:


- As site conditions dictate, Case A through Case G curb ramps may be used for corner installations similar to those shown in Detail A and Detail B. The case of curb ramps used in Detail A do not have to be the same. Case A through Case G curb ramps also may be used at mid block locations, as site conditions dictate.
- If distance from curb to back of sidewalk is too short to accommodate ramp and 4'-2" platform (landing) as shown in Case A, the sidewalk may be depressed longitudinally as in Case B, or C or may be widened as in Case D.
- When ramp is located in center of curb return, crosswalk configuration must be similar to that shown for Detail B.
- As site conditions dictate, the retaining curb side and the flared side of the Case G ramp shall be constructed in reversed position.
- If located on a curve, the sides of the ramp need not be parallel, but the minimum width of the ramp shall be 4'-2".
- Side slope of ramp flares vary uniformly from a maximum of 9.0% at curb to conform with longitudinal sidewalk slope adjacent to top of the ramp, except in Case C and Case F.
- Transitions from ramps and landing to walks, gutters or streets shall be flush (no lip) and free of abrupt changes.
- Counter slopes of adjoining gutters and road surfaces immediately adjacent to and within 24 inches of the curb ramp shall not be steeper than 1:20 (5.0%). Gutter pan slope shall not exceed 1" of depth for each 2'-0" of width.
- Curb ramps shall have a detectable warning surface that extends the full width and 3'-0" depth of the ramp. A 4'-0" wide detectable warning surface may be used on a 4'-2" wide curb ramp. Detectable Warning Surfaces shall conform to the requirements in the Standard Specifications.
- Sidewalk and ramp thickness, "T", shall be 3 1/2" minimum.
- Utility pull boxes, manholes, vaults and all other utility facilities within the boundaries of the curb ramp will be relocated or adjusted to grade by the owner prior to, or in conjunction with, curb ramp construction.
- Detectable warning surface may have to be cut to allow removal of utility covers while maintaining full detectable warning width and depth.

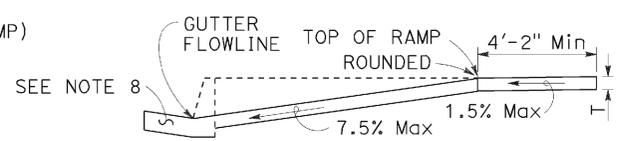

SECTION A-A

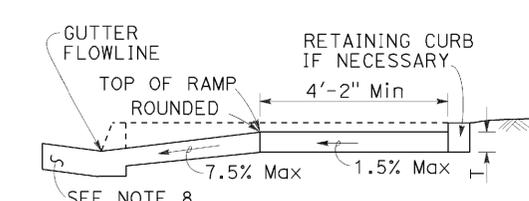

SECTION B-B

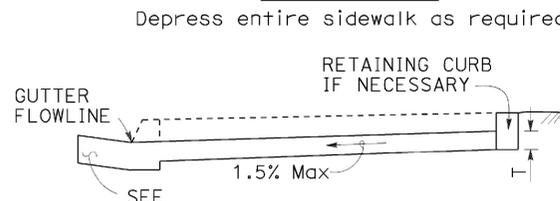


SECTION C-C




RAISED TRUNCATED DOME PATTERN (IN-LINE) DETECTABLE WARNING SURFACE

See Note 9

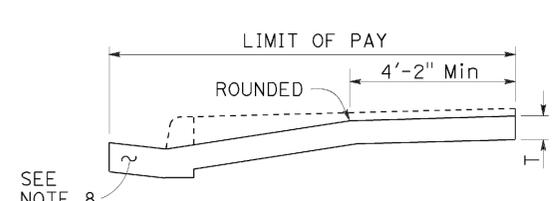


RETROFIT PAY LIMITS

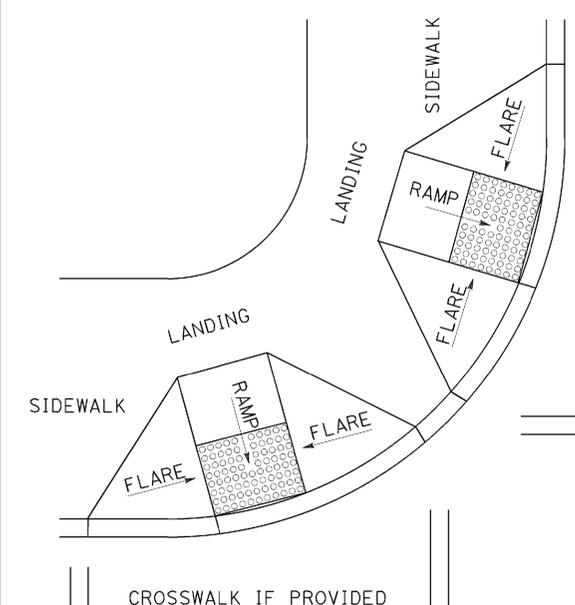

DETAIL A

TYPICAL TWO-RAMP CORNER INSTALLATION

See Note 1

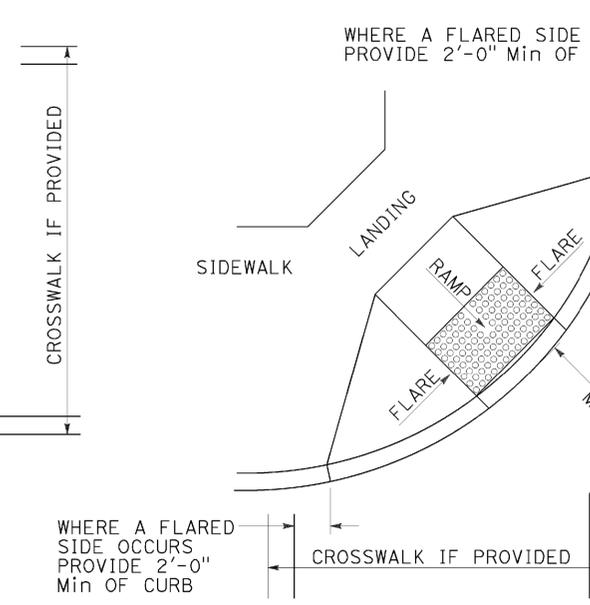

DETAIL B

TYPICAL ONE-RAMP CORNER INSTALLATION

See Notes 1 and 3

CURB RAMP DETAILS
NO SCALE

RSP A88A DATED JULY 3, 2015 SUPERSEDES RSP A88A DATED MARCH 21, 2014 AND RSP A88A DATED JULY 19, 2013 AND STANDARD PLAN A88A DATED MAY 20, 2011 - PAGE 121 OF THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP A88A

2010 REVISED STANDARD PLAN RSP A88A

DATE PLOTTED => 19-JAN-2016
TIME PLOTTED => 13:08

DIST	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	Plu	89	20.0/20.6	207	235

Srikanth N. Balasubramanian
REGISTERED CIVIL ENGINEER


October 30, 2015
PLANS APPROVAL DATE

THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.


Srikanth N. Balasubramanian
No. C56426
Exp. 6-30-17
CIVIL
STATE OF CALIFORNIA

TO ACCOMPANY PLANS DATED 01-19-16


ABBREVIATIONS:
TE TAPERED EDGE

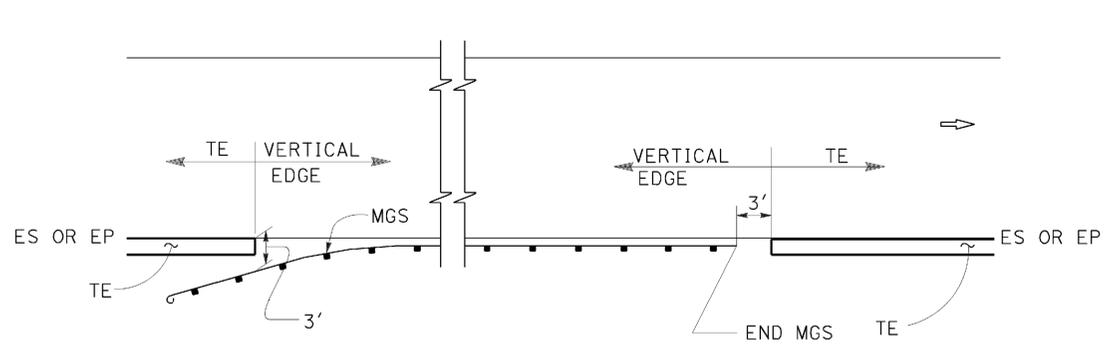


MGS

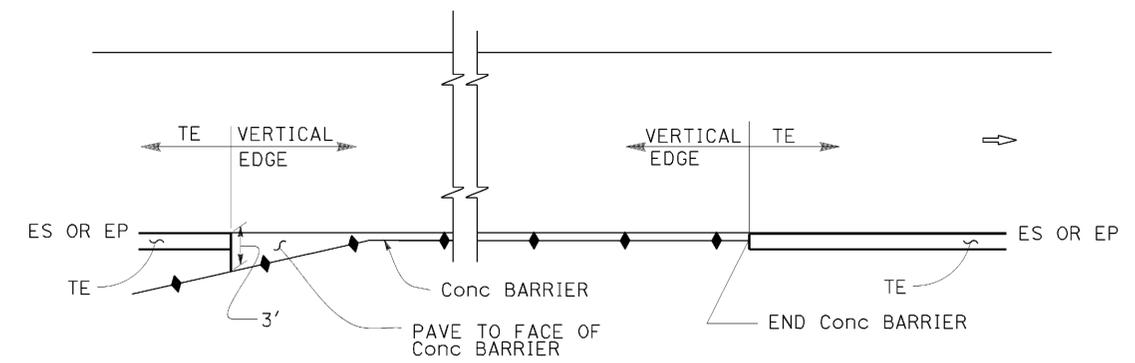


CONCRETE BARRIER

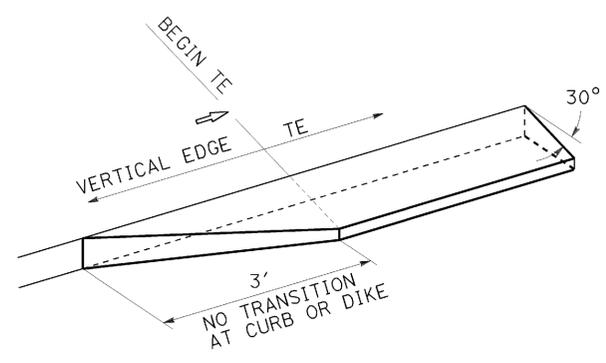

TRANSITION DETAIL FOR CONCRETE ONLY

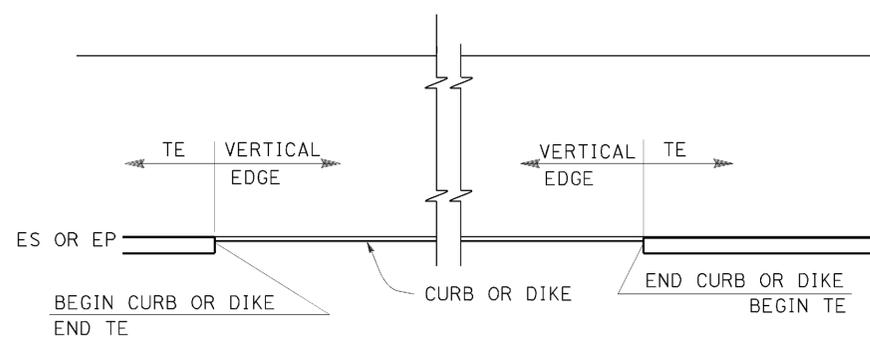


CURB OR DIKE

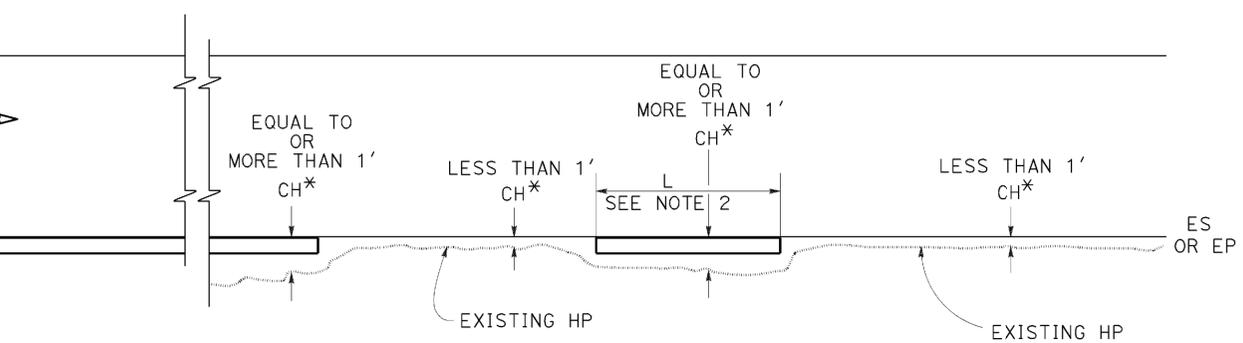


NARROW SIDE SLOPE

* CH = Distance from ES or EP to existing HP.

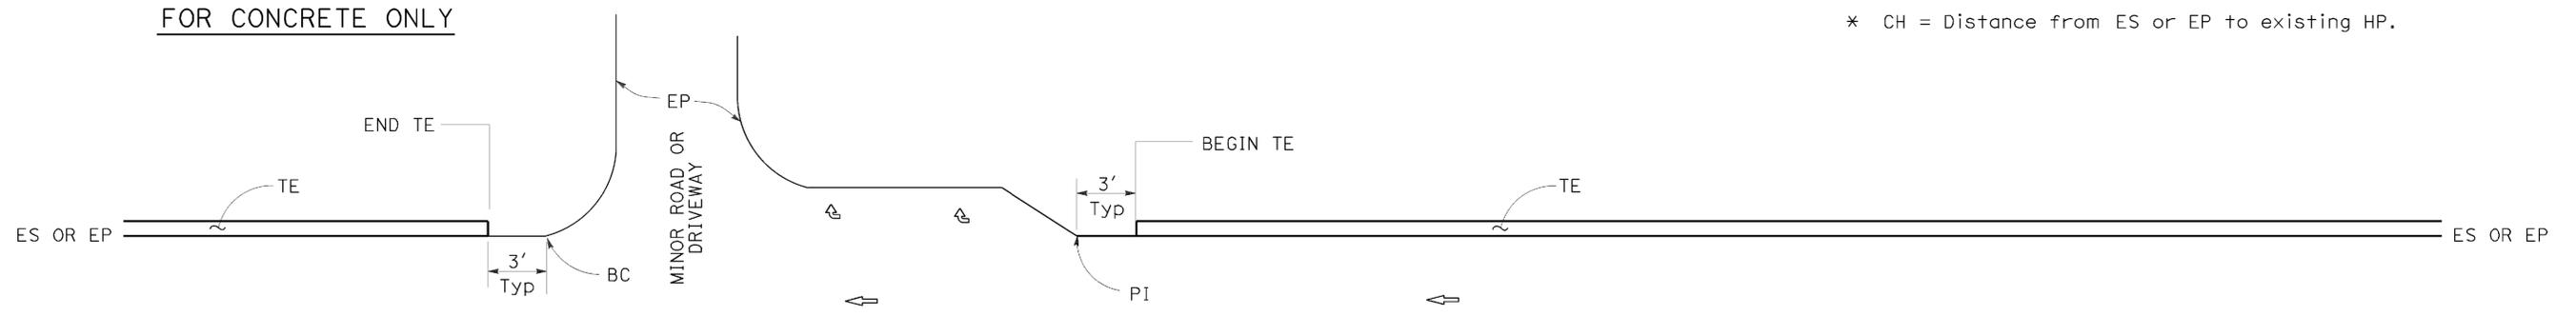

STATE ROUTE

STATE ROUTE

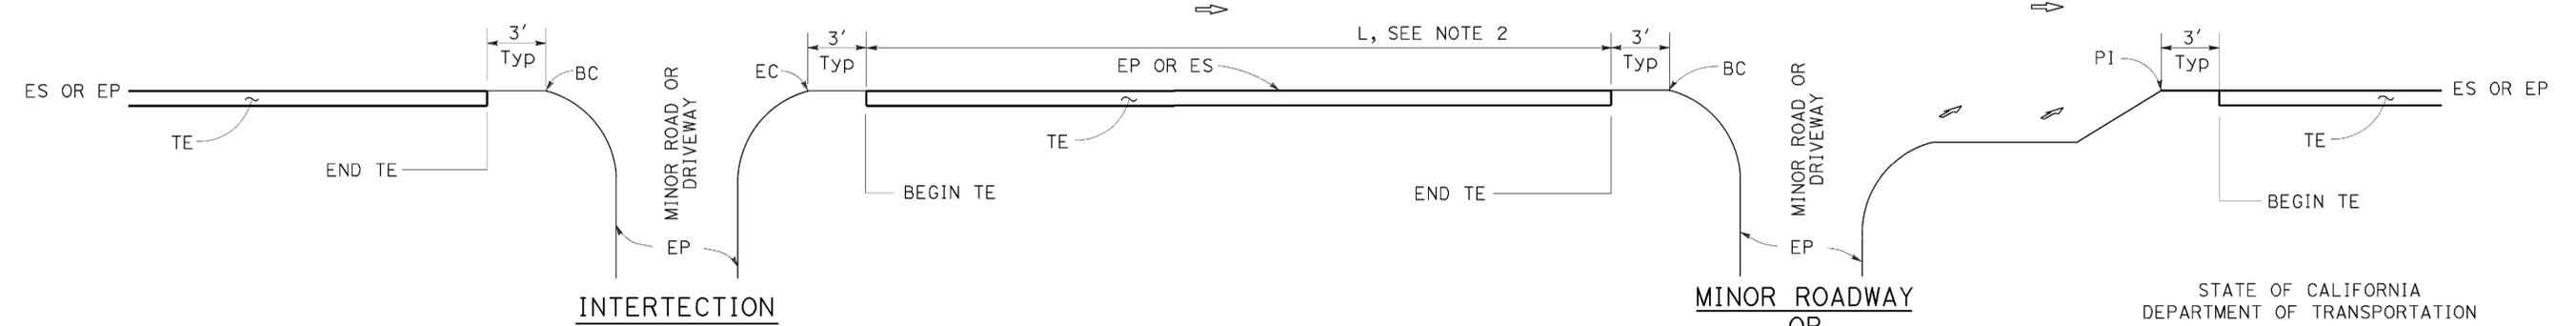

INTERSECTION

DRIVEWAY AND INTERSECTION

MINOR ROADWAY OR DRIVEWAY

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

PAVEMENT EDGE TREATMENTS

NO SCALE

NOTES:

1. For details not shown, see Revised Standard Plans RSP P75 and RSP P76.
2. Tapered edge is optional when L is less than 30'.

RSP P74 DATED OCTOBER 30, 2015 SUPERSEDES RSP P74 DATED NOVEMBER 15, 2013 AND RSP P74 DATED JANUARY 20, 2012 THAT SUPPLEMENTS THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP P74

2010 REVISED STANDARD PLAN RSP P74

DATE PLOTTED => 19-JAN-2016
TIME PLOTTED => 13:09

DIST	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	Plu	89	20.0/20.6	208	235

Srikanth N. Balasubramanian
REGISTERED CIVIL ENGINEER

October 30, 2015
PLANS APPROVAL DATE

Srikanth N. Balasubramanian
No. C56426
Exp. 6-30-17
CIVIL
STATE OF CALIFORNIA

THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

TO ACCOMPANY PLANS DATED 01-19-16

ADDITIONAL HMA OR CONCRETE QUANTITIES FOR TE/SIDE/MILE

TYPICAL CROSS SECTION	TT	TOTAL ADDITIONAL MATERIAL FOR TE/SIDE/MILE		
		HMA (TON)	CONCRETE (CY)*	CONCRETE (CY)**
	0.15'	7.7	NA	NA
	0.20'	13.7	NA	NA
	0.30'	30.9	NA	NA
	0.40'	54.9	NA	NA
	0.45'	69.4	NA	NA
	0.50'	84.2	NA	NA
	0.60'	113.9	NA	NA
	0.70'	143.6	70.9	94.2
	0.80'	173.3	85.6	112.2
	0.90'	203.0	100.3	130.2
	1.00'	232.7	114.9	148.2
	1.10'	262.4	129.6	166.2
1.20'	292.1	144.3	184.2	

* For Detail "A"
** For Optional Detail "A"

LEGEND:

HMA OVERLAY

HMA OR CONCRETE OVERLAY


CONCRETE OVERLAY

ABBREVIATIONS:


TE TAPERED EDGE
TT TOTAL THICKNESS OF TE

TABLE A
EDGE TREATMENT FOR VARIOUS OVERLAY THICKNESS AND CONDITIONS


FIELD CONDITION	OVERLAY THICKNESS	
	LESS THAN 0.15'	0.15' OR MORE
Exist SLOPE 6:1 OR FLATTER	CASE E	CASE A
Exist SLOPE 3:1 TO 6:1	CASE E	CASE B
Exist SLOPE STEEPER THAN 3:1	CASE F	CASE F
CUT SECTION (REPLACE, COLD PLANE, MILL PAVEMENT)	CASE D	CASE C

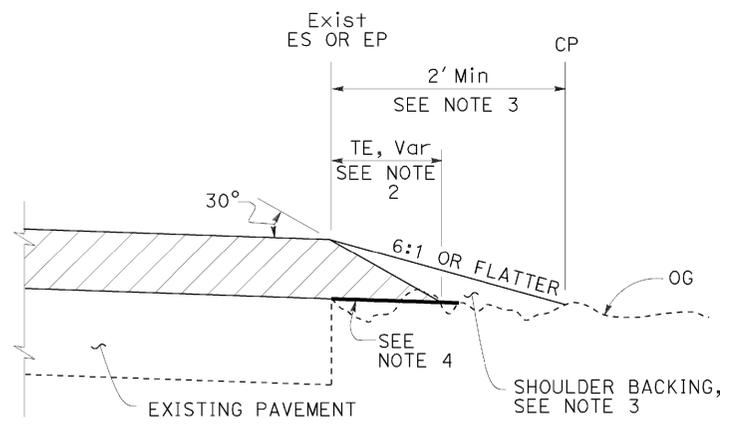


CASE A
Tapered Edge

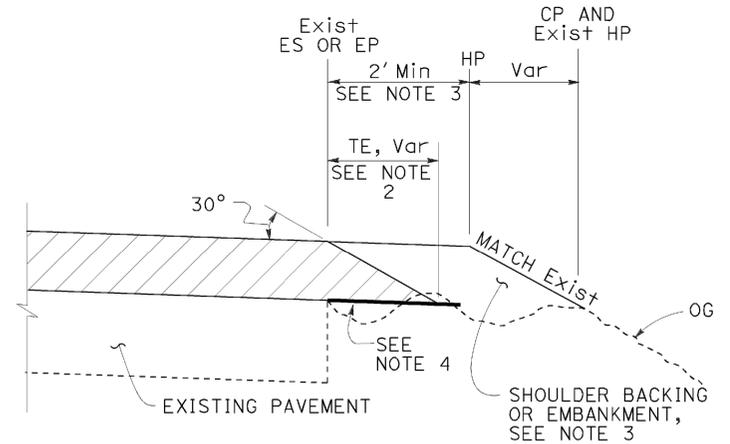


CASE B
Tapered Edge

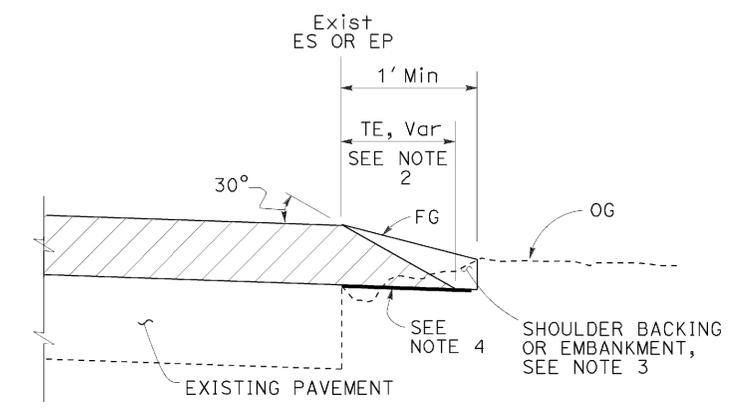


CASE C
Tapered Edge

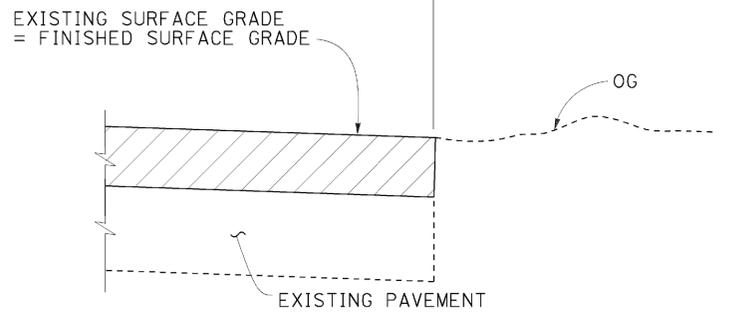

CASE D
Vertical Edge

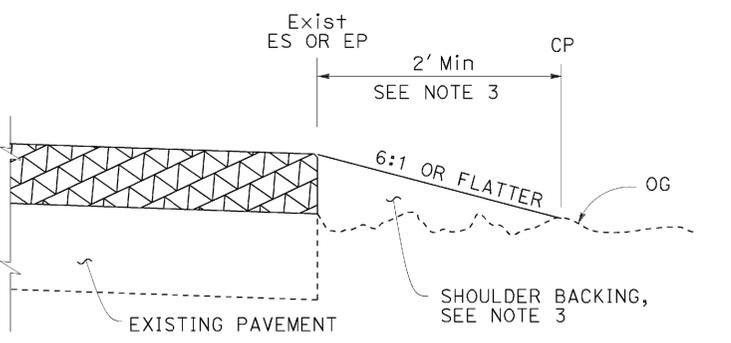


CASE E
Vertical Edge

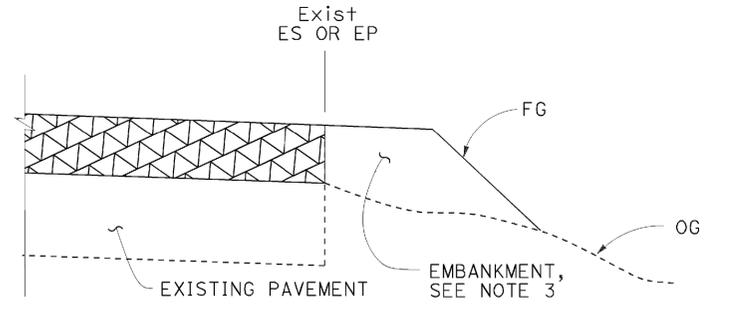

CASE F
Vertical Edge


* See Table A and Revised Std Plan RSP P74

- NOTES:**
- For limits of tapered edge and vertical edge treatments, see Revised Standard Plan RSP P74.
 - Details shown for HMA overlay thickness less than 0.43'. See Detail "A" for HMA overlay thickness more than 0.43' or concrete overlay.
 - For locations and limits of shoulder backing or embankment see project plans.
 - Grade existing ground to place tapered edge. 1' minimum width
 - Tapered edge transverse joint must match overlay transverse joint. End of #6 longitudinal bar must be 2" ± 1/2" clear from transverse joint.
 - Tapered edge is not needed in the area of MGS, barrier, right turn lane and acceleration lane. See Revised Standard Plan RSP P74.

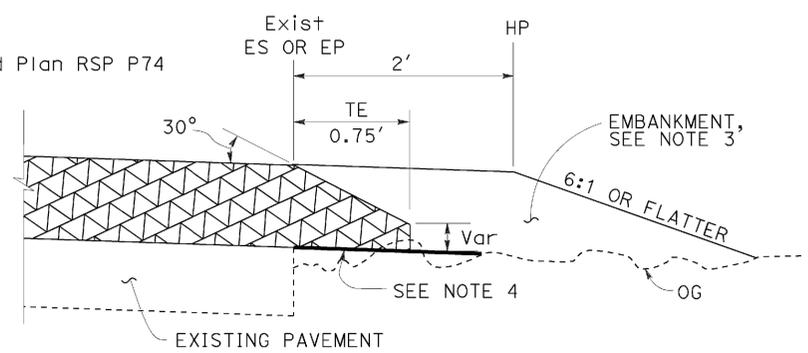

DETAIL "A"

For HMA overlay thickness more than 0.43' or concrete overlay

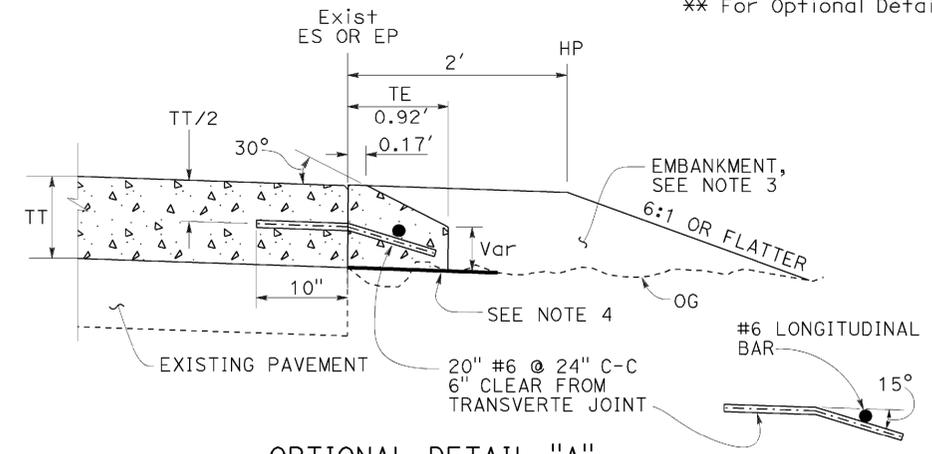

OPTIONAL DETAIL "A"
For concrete overlay
See Note 5

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION
PAVEMENT EDGE TREATMENTS - OVERLAYS

NO SCALE

RSP P75 DATED OCTOBER 30, 2015 SUPERSEDES RSP P75 DATED NOVEMBER 15, 2013 AND RSP P75 DATED JANUARY 20, 2012 THAT SUPPLEMENTS THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP P75

2010 REVISED STANDARD PLAN RSP P75

DIST	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	PIU	89	20.0/20.6	209	235

Srikanth N. Balasubramanian
REGISTERED CIVIL ENGINEER

October 30, 2015
PLANS APPROVAL DATE

Srikanth N. Balasubramanian
No. C56426
Exp. 6-30-17
CIVIL
STATE OF CALIFORNIA

THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.


TO ACCOMPANY PLANS DATED 01-19-16

LEGEND:


-  HMA PAVEMENT
-  HMA OR CONCRETE PAVEMENT
-  CONCRETE PAVEMENT

ABBREVIATIONS:


- TE TAPERED EDGE
- TT TOTAL THICKNESS OF TE
- HW HINGE WIDTH, DISTANCE FROM ES OR EP TO HP

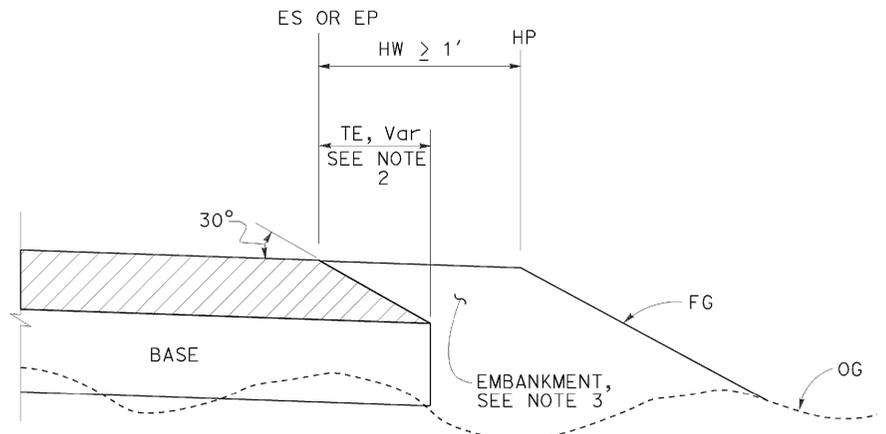


CASE K
Tapered Edge - Fill Section, HW $\geq 1'$

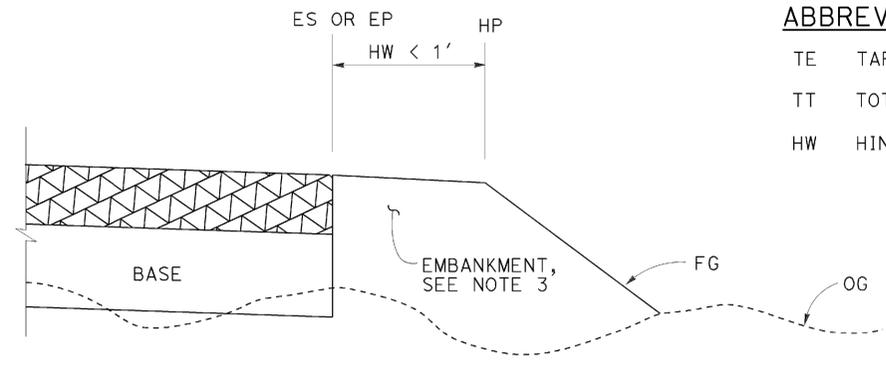


CASE L
Vertical Edge - Fill Section, HW $< 1'$

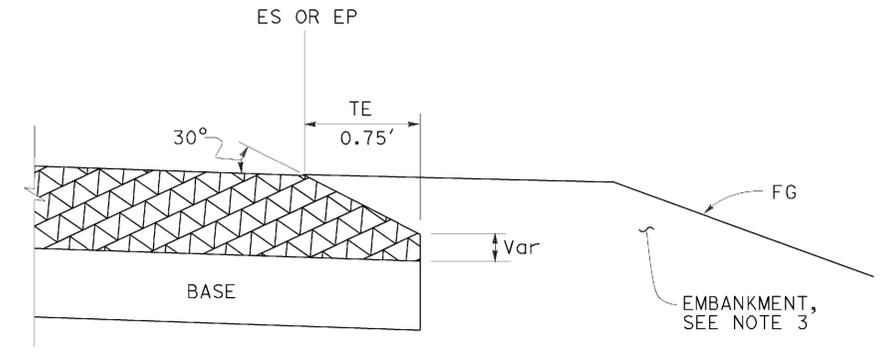


DETAIL "B"
For HMA pavement thickness more than 0.43' or concrete pavement

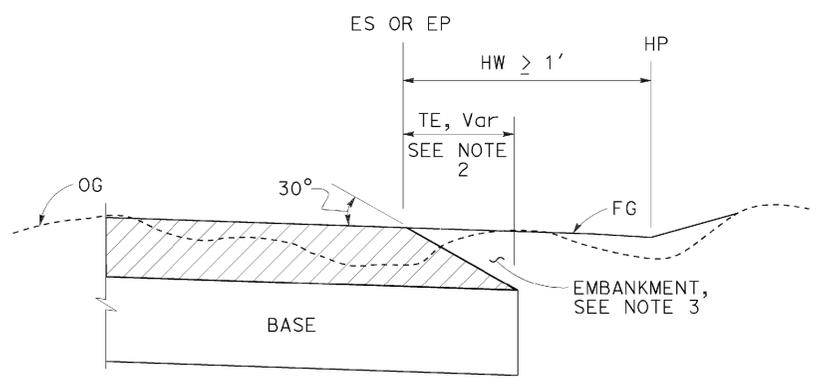

CASE M
Tapered Edge - Cut Section, HW $\geq 1'$

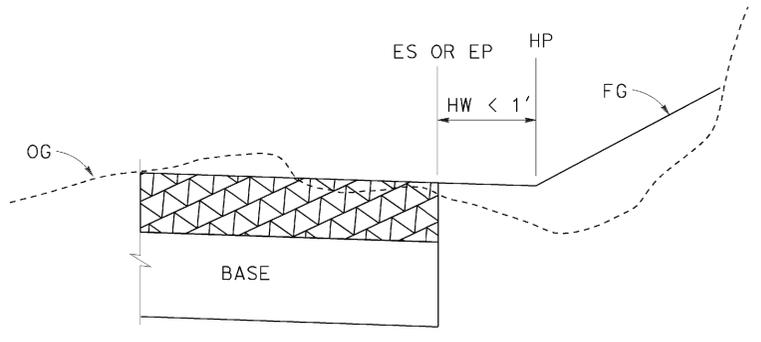

CASE N
Vertical Edge - Cut Section, HW $< 1'$

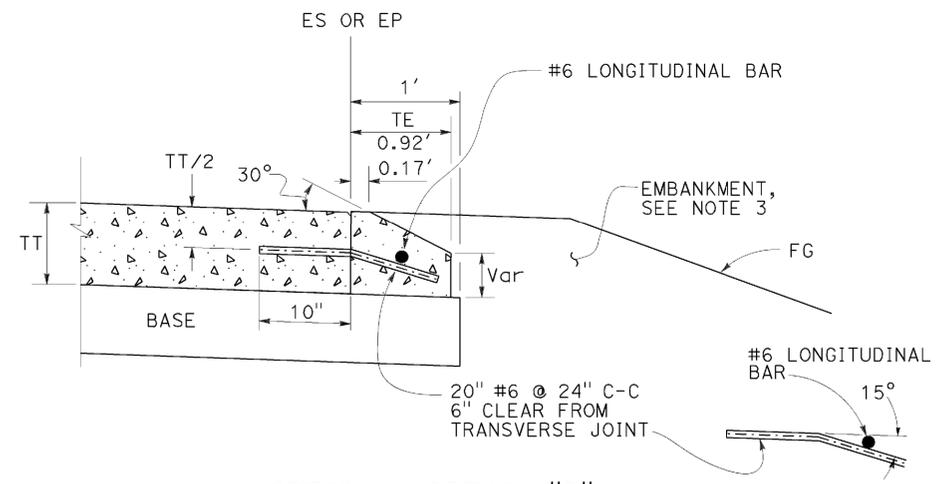

OPTIONAL DETAIL "B"
For concrete pavement
See Note 4

FILL SECTION

CUT SECTION

NOTES:

- For limits of tapered edge and vertical edge treatments, see Revised Standard Plan RSP P74
- Details shown for HMA pavement thickness less than 0.43'. See Detail "B" for HMA pavement thickness more than 0.43' or concrete pavement.
- For locations and limits of embankment see project plans.
- Tapered edge transverse joint must match pavement transverse joint. End of #6 longitudinal bar must be 2" $\pm 1/2$ " clear from transverse joint.
- Tapered edge is not needed in the area of MGS, barrier, right turn lane and acceleration lane. See Revised Standard Plan RSP P74.

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION
**PAVEMENT EDGE TREATMENTS-
NEW CONSTRUCTION**
NO SCALE

RSP P76 DATED OCTOBER 30, 2015 SUPERSEDES RSP P76 DATED NOVEMBER 15, 2013 AND RSP P76 DATED JANUARY 20, 2012 THAT SUPPLEMENTS THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP P76

2010 REVISED STANDARD PLAN RSP P76

DATE PLOTTED => 19-JAN-2016
TIME PLOTTED => 13:09


Dist	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	Piu	89	20.0/20.6	210	235

Glenn DeCou
REGISTERED CIVIL ENGINEER

October 19, 2012
PLANS APPROVAL DATE

Glenn DeCou
No. C34547
Exp. 9-30-13
CIVIL
STATE OF CALIFORNIA

THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

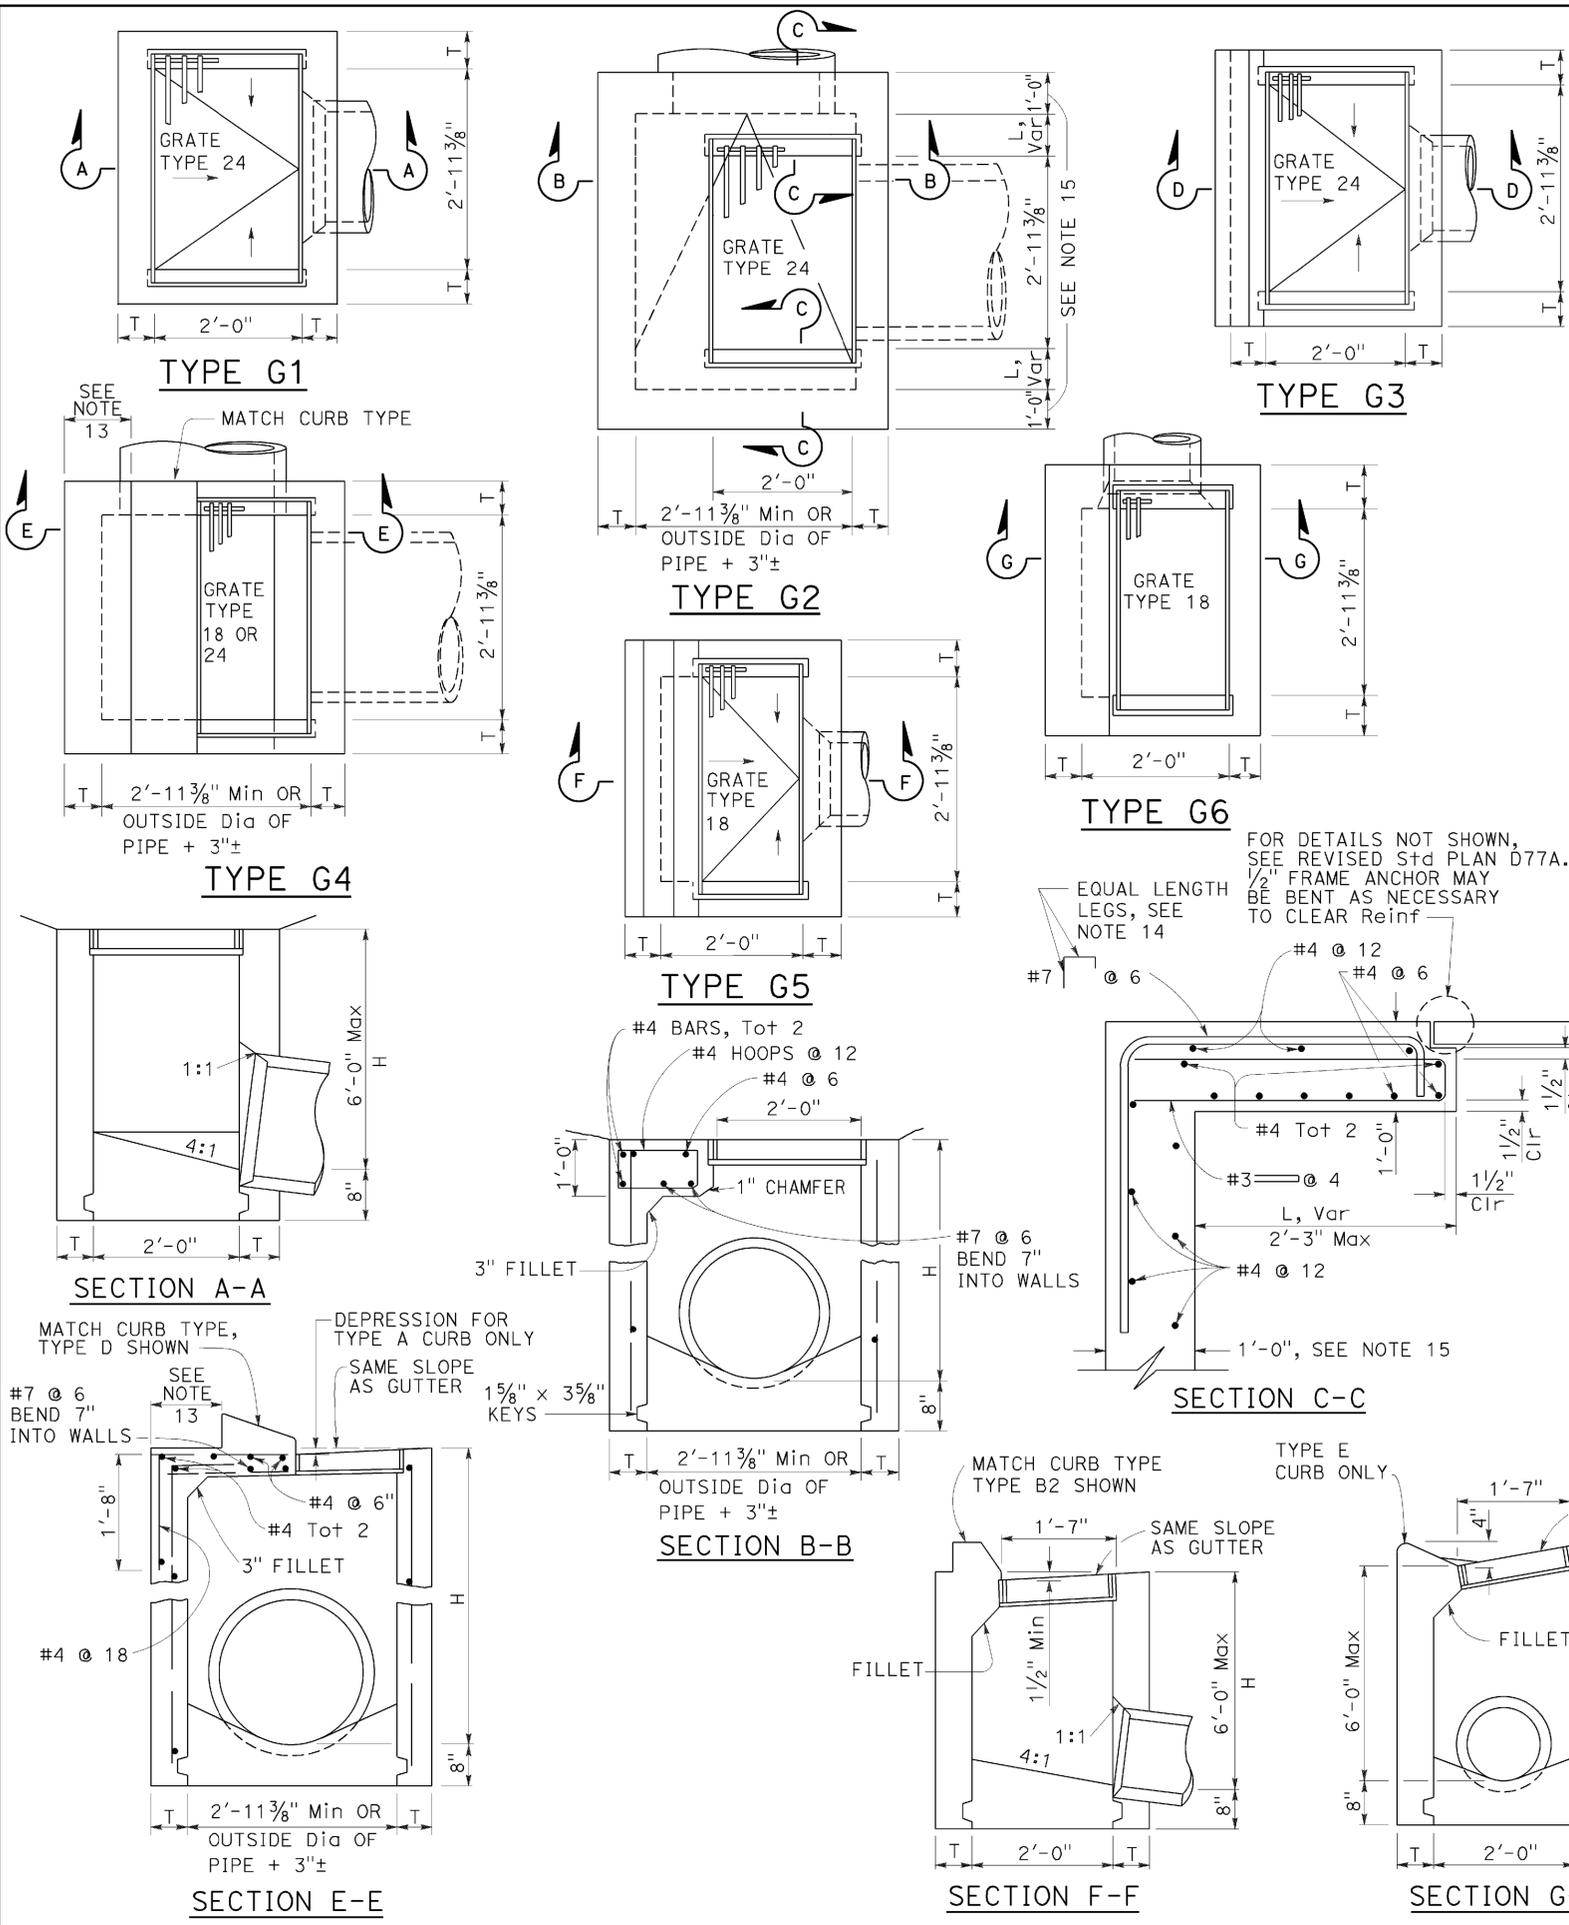

NOTES:

- "H" is the difference in elevation between the outlet pipe flow line and the normal gutter grade line undepressed.
- For "T" wall thickness, see Table A below.
- Wall reinforcing not required when "H" is 8'-0" or less and the unsupported width or length is 7'-0" or less. Walls exceeding these limits shall be reinforced with #4 bars @ 1'-6" ± centers placed 1/2" clear to inside of box unless otherwise shown.
- Inlet bottom reinforcing not required. See Standard Plan D74C for alternative reinforced bottom and alternative half round bottom.
- Steps-None required where "H" is less than 2'-6". Where "H" is 2'-6" or more, install steps with lowest rung 1'-0" above the floor and highest rung not more than 6" below top of inlet. The distance between steps shall not exceed 1'-0" and shall be uniform throughout the length of the wall. Place steps in the wall without an opening. Steps inserts may be substituted for the bar steps. Step inserts shall comply with State Industrial Safety requirements. See Standard Plan D74C for step details.
- Details shown apply to both metal and concrete pipe.
- Pipe(s) can be placed in any wall.
- Curb section shall match adjacent curb.
- Basin floors shall have wood trowel finish and a minimum slope of 12:3 from all directions toward outlet pipe.
- Set inlet so that grate bars are parallel to direction of principal surface flow.
- See Revised Standard Plans D77A and D77B for grate and frame details and weights of miscellaneous iron and steel.
- See Standard Plan D78A for gutter depression details.
- This dimension will vary with different grates, curbs types, box width and wall thickness.
- Bar may be rotated as necessary to clear opening. Where "L" is 6" or less, bar may be omitted.
- Where "L" is 6" or less, wall thickness shall be as shown in Table A.
- Cast-in-place inlets to be formed around all pipes/stubs intersecting the inlet, and concrete poured in one continuous operation. Precast inlets shall have mortared connections conforming to details for Type GCP Inlet shown on Standard Plan D75B. See Standard Specifications for mortar composition.

TABLE A

TYPE	CONCRETE QUANTITIES		CONCRETE QUANTITIES	
	H=3'-0" TO 8'-0" (T=6")	H=8'-1" TO 20'-0" (T=8")	H=3'-0" (CY)	H=8'-1" (CY)
G-1	0.95	0.220	See Note A	SEE NOTE A
G-2*	1.31	0.255	3.50	0.357
G-3	1.03	0.220	See Note A	SEE NOTE A
G-4* (TYPE 24)	1.27	0.255	3.48	0.357
G-4* (TYPE 18)	1.30	0.255	3.50	0.357
G-5	1.02	0.220	SEE NOTE A	SEE NOTE A
G-6	1.04	0.220	SEE NOTE A	SEE NOTE A

TABLE BASED ON 8" FLOOR SLAB. NO DEDUCTIONS ARE TO BE MADE TO THESE QUANTITIES BECAUSE OF PIPE OPENINGS, DIFFERENT FLOOR ALTERNATIVES OR DIFFERENT CURB TYPES. * QUANTITIES FOR TYPE G-2 AND G-4 INLETS BASED ON THE MINIMUM INTERIOR DIMENSIONS.

NOTE A:

Maximum allowable height 6'-0".

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

DRAINAGE INLETS

NO SCALE

RSP D73 DATED OCTOBER 19, 2012 SUPERSEDES STANDARD PLAN D73 DATED MAY 20, 2011 - PAGE 156 OF THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP D73


Dist	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	Piu	89	20.0/20.6	211	235

REGISTERED CIVIL ENGINEER
 October 30, 2015
 PLANS APPROVAL DATE
THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.


TO ACCOMPANY PLANS DATED 01-19-16

NOTES:

- "H" is the difference in elevation between the outlet pipe flow line and the normal gutter grade line undeepressed.
- For "T" wall thickness, see Table A below.
- Wall reinforcing not required when "H" is 8'-0" or less and the unsupported width or length is 7'-0" or less. Walls exceeding these limits shall be reinforced with #4 @ 18"± centers placed 1/2" clear to inside of box unless otherwise shown.
- Inlet bottom reinforcing not required. See Standard Plan D74C for alternative reinforced bottom.
- Steps - None required where "H" is less than 2'-6". Where "H" is 2'-6" or more, install steps with lowest rung 1'-0" above the floor and highest rung not more than 6" below top of inlet. The distance between steps shall not exceed 1'-0" and shall be uniform throughout the length of the wall. Place steps in the wall without an opening. Step inserts may be substituted for the bar steps. Step Inserts shall comply with State Industrial Safety requirements. See Standard Plan D74C for step details.
- When shown on the project plans, place a 3/4" plain round protection bar horizontally across the length of the opening and bend back 4" into the inlet wall on each side.
- Pipe(s) can be placed in any wall.
- Curb section shall match adjacent curb.
- Basin floors shall have wood trowel finish and shall slope toward the outlet pipe as shown.
- See Revised Standard Plans RSP D77A and RSP D77B for grate and frame details and weights of miscellaneous iron and Steel.
- See Standard Plan D78A for gutter depression details.
- Complete joint penetration butt welds may be substituted for the fillet welds on all anchors.
- Standard square, hexagon, round or equivalent headed anchors may be substituted for the right angle hooks on the anchors shown on this plan.
- Cast-in-place inlets to be formed around all pipes/stubs intersecting the inlet and concrete poured in one continuous operation. Precast inlets shall have mortared pipe connections conforming to details for Type GCP inlets on Revised Standard Plan RSP D75B. See Standard Specifications for mortar composition.

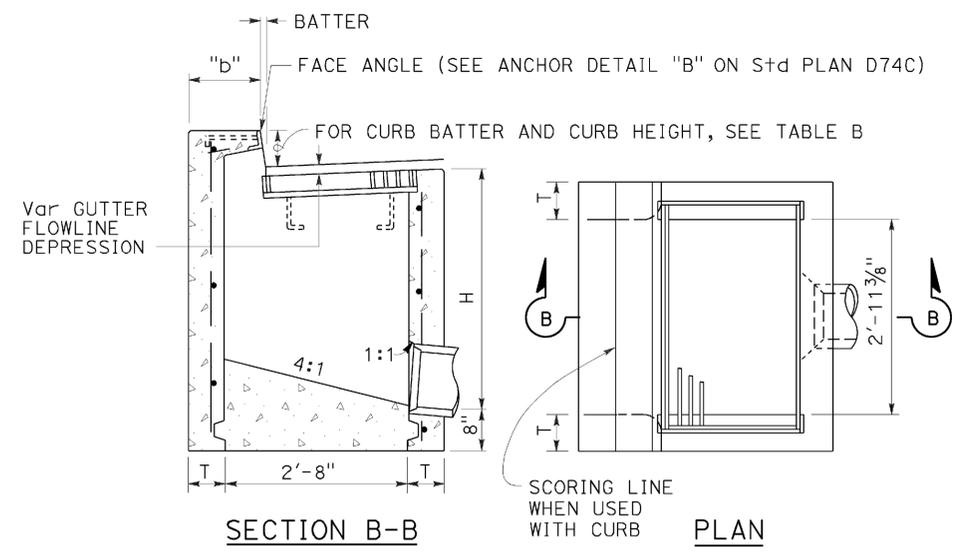


TYPE GO

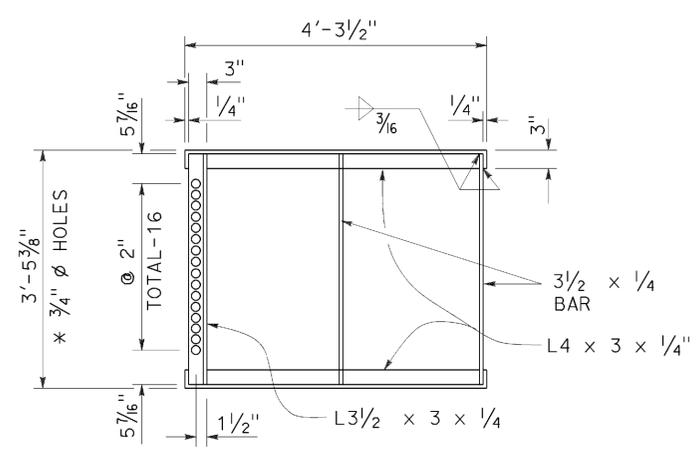


GRATE FRAME FOR TYPE GDO INLET

* 3/4" ø Holes required only with trash rack

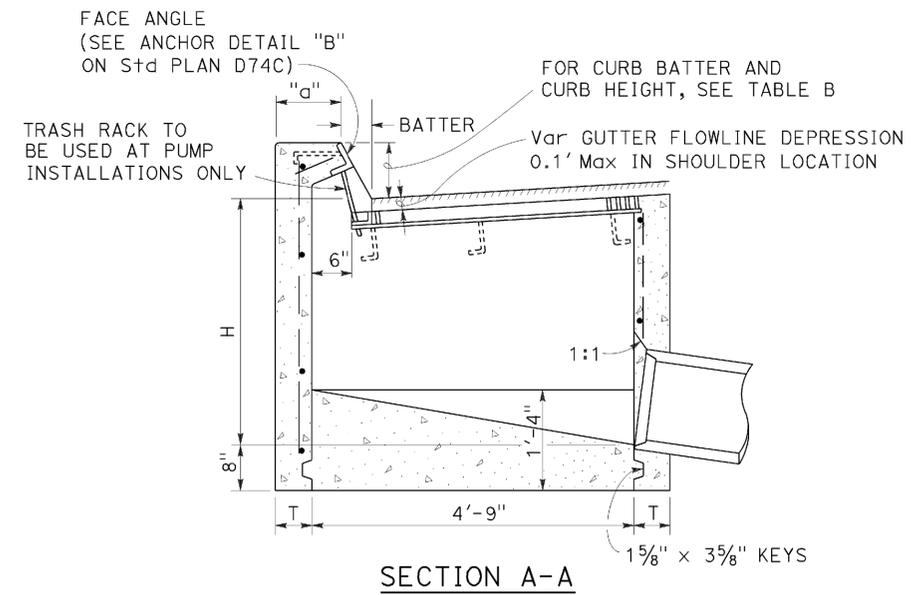

SECTION A-A

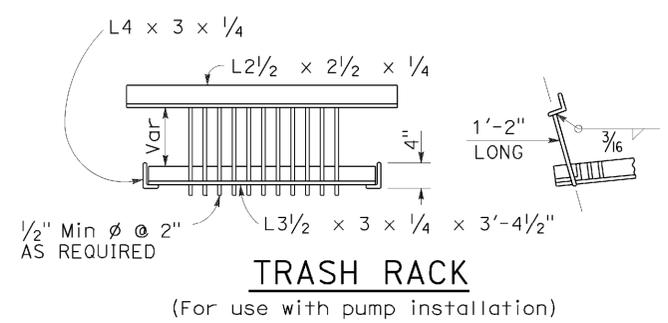

TRASH RACK

(For use with pump installation)


TABLE A
CONCRETE QUANTITIES

TYPE	H=3'-0" TO 8'-0" (T=6")		H=8'-1" TO 20'-0" (T=8")	
	H=3'-0" (CY)	ADDITIONAL PCC PER FOOT (CY)	H=8'-1" (CY)	ADDITIONAL PCC PER FOOT (CY)
GO	1.24	0.245	3.39	0.346
GDO	1.62	0.322	4.36	0.446

Table based on 8" floor slab, and curb type giving highest quantity of concrete. No deductions or adjustments are to be made to these quantities because of pipe openings, different floor alternatives or different curb type.

TABLE B

CURB TYPE	NORMAL CURB HEIGHT	CURB BATTER	"a" DIMENSION	"b" DIMENSION
A1-6	6"	1 1/2"	T+7 1/2"	T+6 1/2"
A1-8	8"	2"	T+7"	T+6"
B1-6	6"	4"	T+5"	T+4"
TYPE A DIKE	6"	3"	T+6"	T+5"

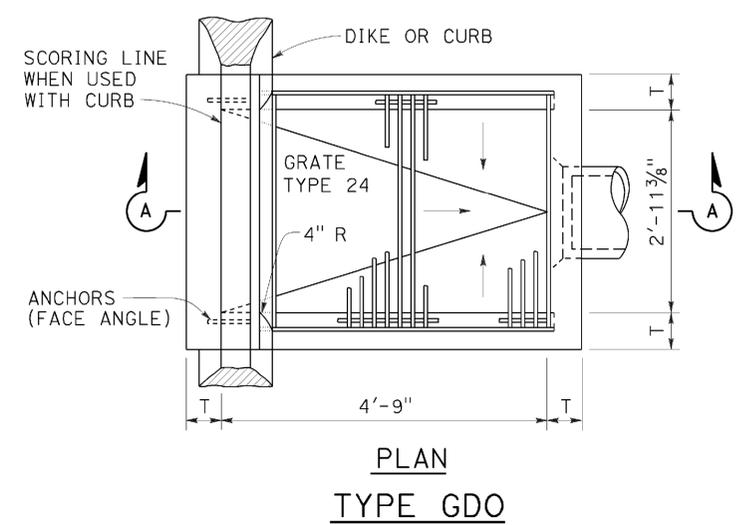

TYPE GDO

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION
DRAINAGE INLETS
NO SCALE

RSP D74B DATED OCTOBER 30, 2015 SUPERSEDES STANDARD PLAN D74B DATED MAY 20, 2011 - PAGE 159 OF THE STANDARD PLANS BOOK DATED 2010.



REVISED STANDARD PLAN RSP D74B

Dist	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	Piu	89	20.0/20.6	212	235



Raymond Don Tsztso
 REGISTERED CIVIL ENGINEER
 October 30, 2015
 PLANS APPROVAL DATE
 THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

REGISTERED PROFESSIONAL ENGINEER
 Raymond Don Tsztso
 No. C37332
 Exp. 6-30-16
 CIVIL
 STATE OF CALIFORNIA



TO ACCOMPANY PLANS DATED 01-19-16

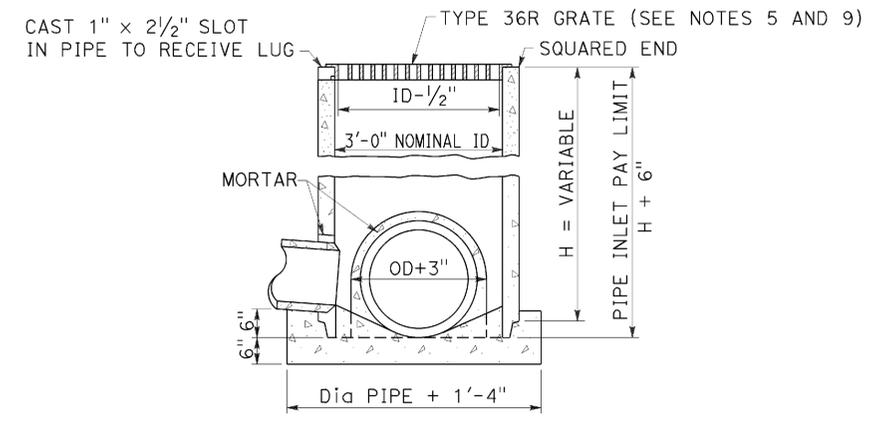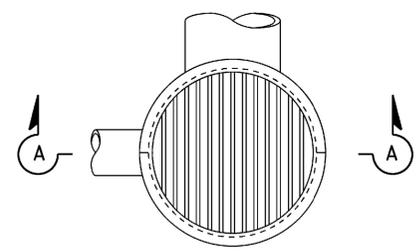


SECTION A-A
TYPE GCP
Concrete pipe inlet with grate

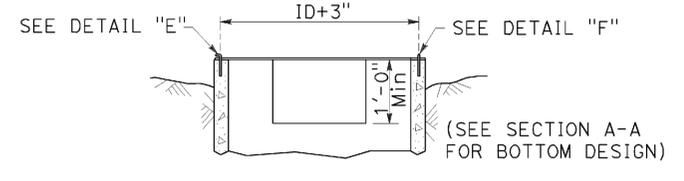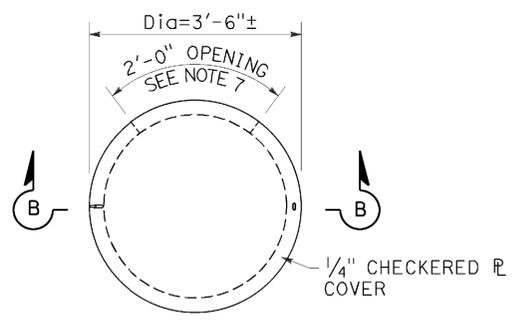


SECTION B-B
TYPE OCP or OCPI
Concrete pipe inlet with steel cover
(See Note 6)

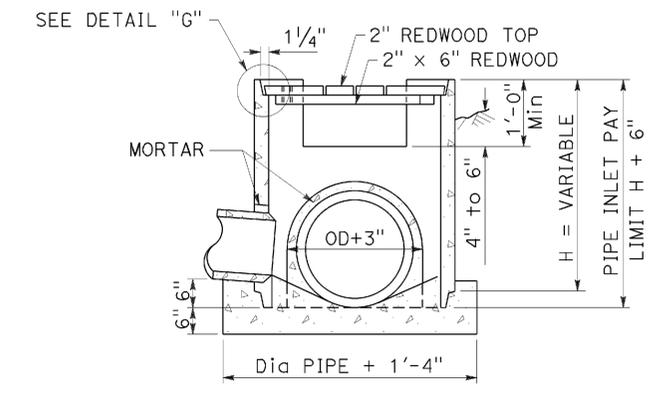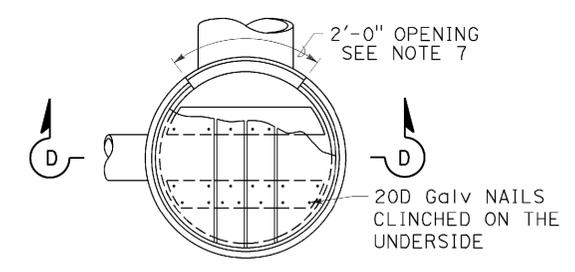

SECTION D-D
TYPE OCP or OCPI
Concrete pipe inlet with redwood cover
(See Notes 6 and 10)

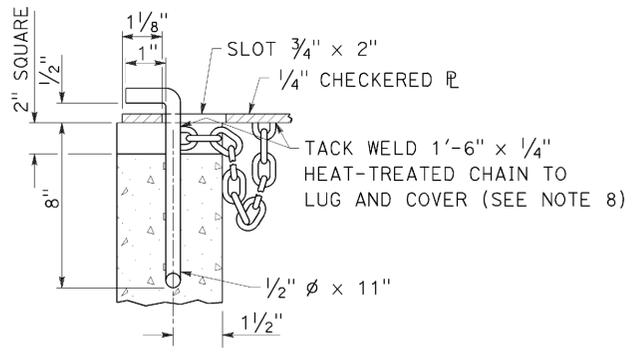


DETAIL "E"

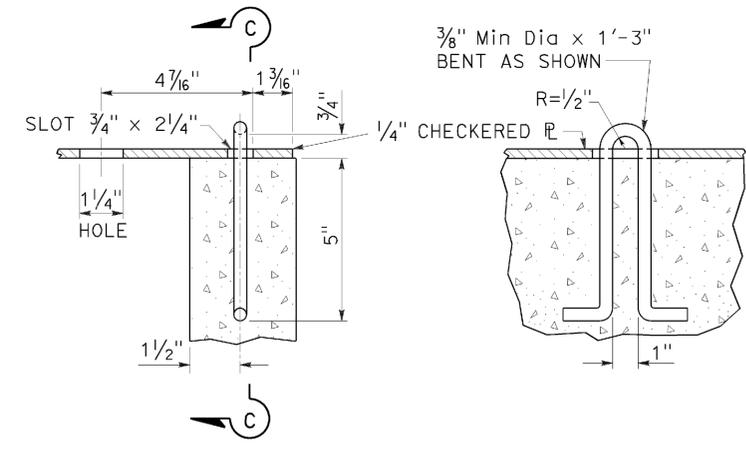

DETAIL "F"

SECTION C-C

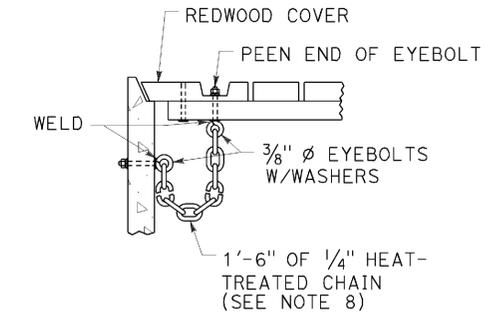

DETAIL "G"

NOTES:

- For details of steel pipe inlets, see Standard Plan D75A.
- For details of ladder and steps and when ladder or steps are required, see Standard Plan D75C.
- Inlet pipes shall not protrude into basin.
- Except for inlets used for junction boxes, basin floors shall have minimum slope of 4:1 from all directions toward outlet pipe, and a wood trowel finish.
- See Revised Standard Plans RSP D77A and RSP D77B for Grate and Frame Details and Weights of Miscellaneous Iron and Steel.
- Designation of Type OCPI pipe inlets on plans indicates trash racks are to be furnished and installed on all side openings. See Standard Plan D75C for Trash Rack details.
- More than one side opening may be required. Location and number as ordered by the Engineer. Opening may be cast in pipe.
- Chain to be provided when specified.
- Place pipe so bars of grate will be parallel with main surface flow.
- Redwood covers shall only be placed at locations designated on the plans.

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION


CONCRETE PIPE INLETS

NO SCALE


RSP D75B DATED OCTOBER 30, 2015 SUPERSEDES STANDARD PLAN D75B DATED MAY 20, 2011 - PAGE 162 OF THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP D75B


2010 REVISED STANDARD PLAN RSP D75B

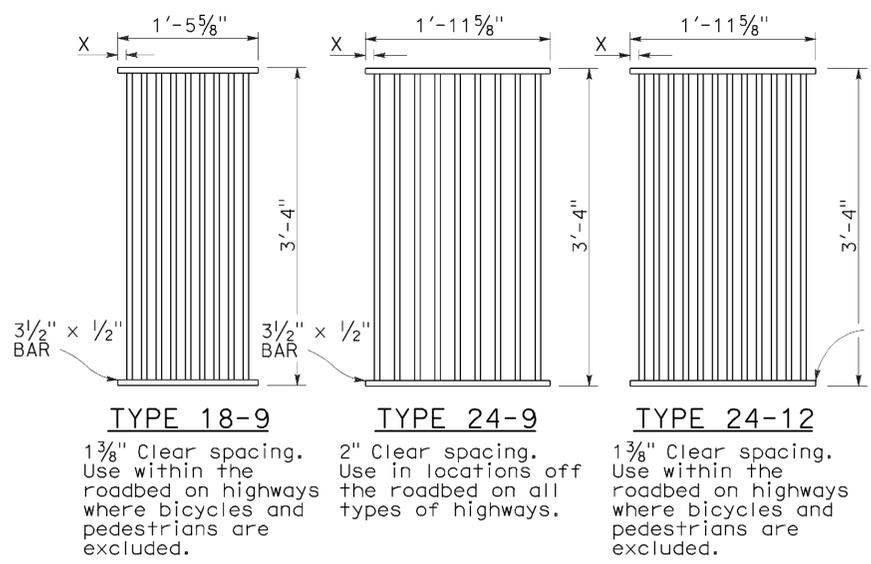


RECTANGULAR GRATE DETAILS
(See table below)

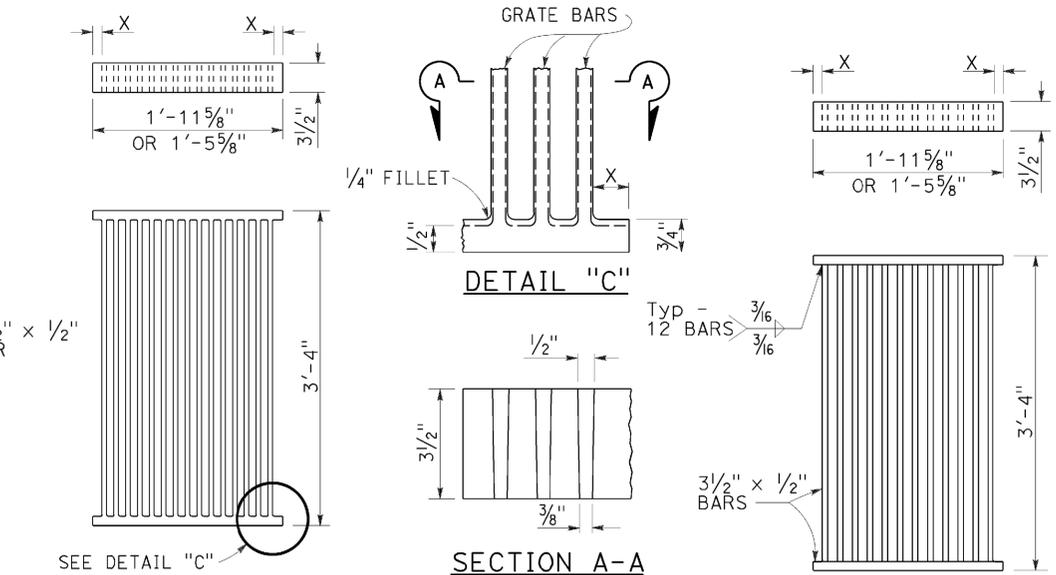


ALTERNATIVE CAST DUCTILE IRON GRATE OR CAST CARBON STEEL GRATE
ALTERNATIVE WELDED GRATE

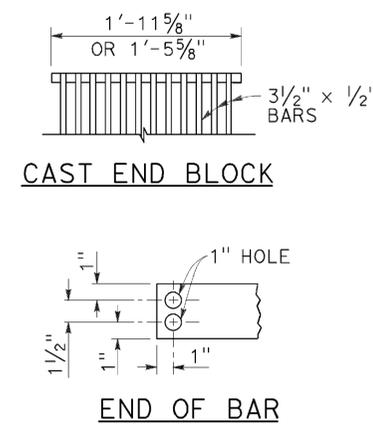


CAST END BLOCK
END OF BAR

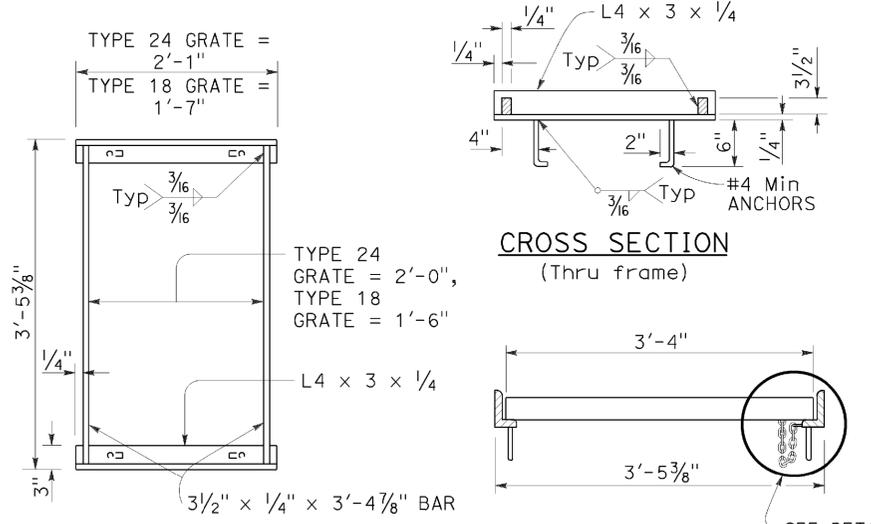

CROSS SECTION (Thru frame)
LONGITUDINAL SECTION (Thru frame and grate)

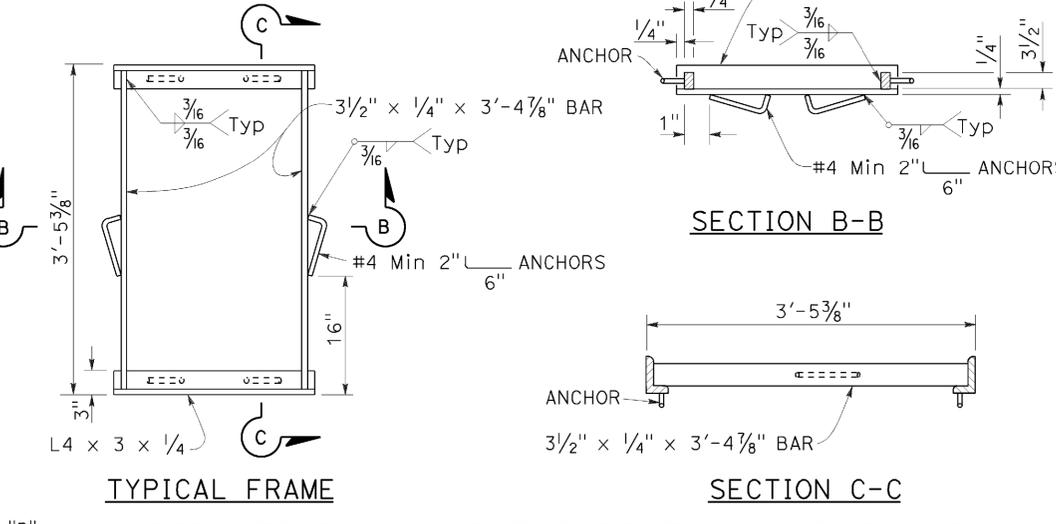

TYPICAL FRAME
SECTION B-B
ALTERNATIVE ANCHOR FOR RECTANGULAR FRAME
(For details not shown, See Rectangular Frame Details)

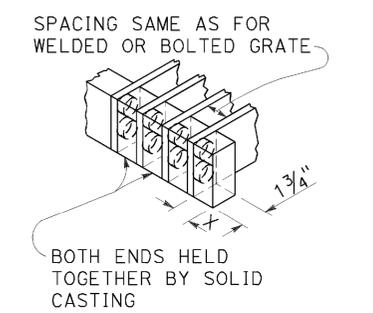

ALTERNATIVE CAST DUCTILE IRON OR CAST CARBON STEEL END BLOCK GRATE


RECTANGULAR FRAME DETAILS
(For all rectangular grates)

GRATE BAR SPACING TABLE


TYPE	No. OF BARS	CLEAR BAR SPACING	X
18-9	9	1 3/8"	1 1/16"
24-9	9	2"	1 9/16"
24-12	12	1 3/8"	1 1/4"

INLET TYPE	COVER TYPE	WEIGHT LB
OS	PLATE	174
OL-7	PLATE	170
OL-10	PLATE	170
OL-14	PLATE	170
OL-21	PLATE	170
OCPI	PLATE	112
OCPI	PLATE	112
OCPI	REDWOOD	42
OMP	PLATE	177
OMPI	PLATE	177

INLET TYPE	GRATE TYPE	No. OF GRATES	WEIGHT LB
GDO	24-12	2	634
GOL-7	24-12	1	326
GOL-10	24-12	1	326
G0,G1,G2,G3,G4 (TYPE 24)	24-9	1	263
	24-12	1	326
G4 (TYPE 18),G5,G6	18-9	1	249
GT1	18-9	2	498
GT2	18-9	2	498
GT3	24-12	2	652
GT4	24-12	2	652
TRASH RACK			22
GRATE CHAIN			3

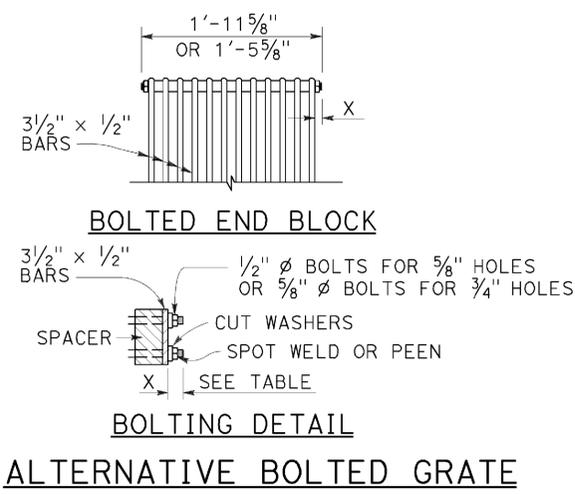

BOLTED END BLOCK
BOLTING DETAIL
ALTERNATIVE BOLTED GRATE

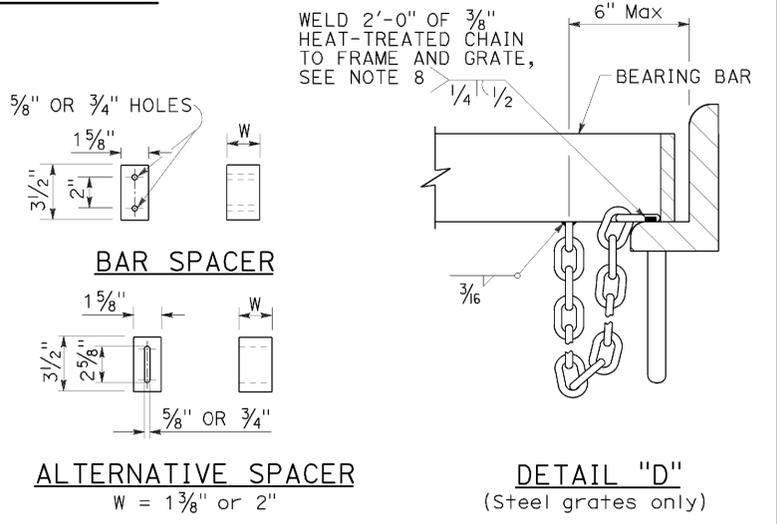

BAR SPACER
ALTERNATIVE SPACER
DETAIL "D"
(Steel grates only)

GRATE DETAILS No. 1
NO SCALE

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

RSP D77A DATED APRIL 19, 2013 SUPERSEDES RSP D77A DATED JULY 20, 2012 AND STANDARD PLAN D77A DATED MAY 20, 2011 - PAGE 164 OF THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP D77A

2010 REVISED STANDARD PLAN RSP D77A

Dist	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	Piu	89	20.0/20.6	215	235

Gregory A. Balzer
LICENSED LANDSCAPE ARCHITECT

July 19, 2013
PLANS APPROVAL DATE

THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

TO ACCOMPANY PLANS DATED 01-19-16

A

AB AGGREGATE BASE
 ABS ACRYLONITRILE-BUTADIENE-STYRENE
 AC ASPHALT CONCRETE
 ACC ARMOR-CLAD CONDUCTORS
 Adj ADJACENT/ADJUSTABLE
 AIC AUXILIARY IRRIGATION CONTROLLER
 Alt ALTERNATIVE
 AMEND AMENDMENT
 ARV AIR RELEASE VALVE
 AUTO AUTOMATIC
 AUX AUXILIARY
 AVB ATMOSPHERIC VACUUM BREAKER

B

B&B BALLED AND BURLAPPED
 B/B BRASS/BRONZE
 B/B/PL BRASS/BRONZE/PLASTIC
 B/PL BRASS/PLASTIC
 BFM BONDED FIBER MATRIX
 Bit Ctd BITUMINOUS COATED
 BP BOOSTER PUMP
 BPA BACKFLOW PREVENTER ASSEMBLY
 BPE BACKFLOW PREVENTER ENCLOSURE
 BV BALL VALVE

C

C CONDUIT
 CAP CORRUGATED ALUMINUM PIPE
 CARV COMBINATION AIR RELEASE VALVE
 CB COUPLING BAND
 CCA CAM COUPLER ASSEMBLY
 CEC CONTROLLER ENCLOSURE CABINET
 CHDPE CORRUGATED HIGH DENSITY POLYETHYLENE
 CL CHAIN LINK
 CNC CONTROL AND NEUTRAL CONDUCTORS
 Conc CONCRETE
 CP COPPER PIPE
 CS COMPOST SOCK
 CSP CORRUGATED STEEL PIPE
 CST CENTER STRIP
 CV CHECK VALVE

D

Dia DIAMETER
 DIP DUCTILE IRON PIPE
 DIT DRIP IRRIGATION TUBING
 DG DECOMPOSED GRANITE
 DN DIAMETER NOMINAL
 DVA DRIP VALVE ASSEMBLY

E

EC EROSION CONTROL
 ECTC EROSION CONTROL TECHNOLOGY COUNCIL
 Elect ELECTRIC/ELECTRICAL
 Elev ELEVATION
 ELL ELBOW
 ENCL ENCLOSURE
 EP EDGE OF PAVEMENT
 ES EDGE OF SHOULDER
 EST END STRIP
 ESTB ESTABLISHMENT
 ETW EDGE OF TRAVELED WAY

F

F FULL CIRCLE
 F/P FULL/PART CIRCLE
 FCV FLOW CONTROL VALVE
 FERT FERTILIZER
 FG FINISHED GRADE
 FH FLEXIBLE HOSE
 FIPT FEMALE IRON PIPE THREAD
 FIS FERTILIZER INJECTOR SYSTEM
 FL FLOW LINE
 FR FIBER ROLL
 FS FLOW SENSOR
 FSC FLOW SENSOR CABLE
 FV FLUSH VALVE

G

Galv GALVANIZED
 GARV GARDEN VALVE
 GARVA GARDEN VALVE ASSEMBLY
 GM GRAVEL MULCH
 GPH GALLONS PER HOUR
 GPM GALLONS PER MINUTE
 GSP GALVANIZED STEEL PIPE
 GV GATE VALVE

H

H HALF CIRCLE
 HDPE HIGH DENSITY POLYETHYLENE
 HP HORSEPOWER/HINGE POINT
 HPL HIGH PRESSURE LINE
 Hwy HIGHWAY

I

IC IRRIGATION CONTROLLER
 ICC IRRIGATION CONTROLLER(S)
 IN CONTROLLER ENCLOSURE CABINET
 ID INSIDE DIAMETER
 IFS IRRIGATION FILTRATION SYSTEM
 IPS IRON PIPE SIZE
 IPT IRON PIPE THREAD
 Irr IRRIGATION

L

L LENGTH

M

Max MAXIMUM
 MBGR METAL BEAM GUARD RAILING
 MCV MANUAL CONTROL VALVE
 MIC MASTER IRRIGATION CONTROLLER
 Min MINIMUM
 MIPT MALE IRON PIPE THREAD
 Misc MISCELLANEOUS
 MtI MATERIAL
 MVP MAINTENANCE VEHICLE PULLOUT

N

NCN NO COMMON NAME
 NL NOZZLE LINE
 No. NUMBER
 NPT NATIONAL PIPE THREAD

O

O/C ON CENTER
 OD OUTSIDE DIAMETER
 OL OVERLAP

P

P PART CIRCLE
 PB PULL BOX
 PCC PORTLAND CEMENT CONCRETE
 PE POLYETHYLENE
 PKt PACKET
 PL PLASTIC
 PLS PURE LIVE SEED
 PLT PLANT/PLANTING
 PLT ESTB PLANT ESTABLISHMENT
 PM POST MILE
 PR PRESSURE RATED
 PRLV PRESSURE RELIEF VALVE
 PRV PRESSURE REGULATING VALVE
 PVC POLYVINYL CHLORIDE
 PvmT PAVEMENT

Q

Q QUARTER CIRCLE
 QCV QUICK COUPLING VALVE

NOTE:
 For additional abbreviations,
 see Standard Plans A10A and A10B.

R

R RADIUS
 RCP REINFORCED CONCRETE PIPE
 RCV REMOTE CONTROL VALVE
 RCVM REMOTE CONTROL VALVE (MASTER)
 RCVMF REMOTE CONTROL VALVE (MASTER) W/FLOW SENSOR
 RCVP REMOTE CONTROL VALVE W/PRESSURE REGULATOR
 RCW RECYCLED WATER
 RECP ROLLED EROSION CONTROL PRODUCT
 REQ REQUIRED
 RICS REMOTE IRRIGATION CONTROL SYSTEM
 R/W RIGHT OF WAY

S

S SLIP
 SCH SCHEDULE
 SF STATE-FURNISHED
 Shld SHOULDER
 Sq SQUARE
 SST SIDE STRIP
 Sta STATION
 Std STANDARD
 SW SIDEWALK/SOUND WALL

T

T THIRD CIRCLE/THREAD
 TLS TRUCK LOADING STANDPIPE
 TQ THREE QUARTER CIRCLE
 TRM TURF REINFORCEMENT MAT
 TT TWO-THIRDS CIRCLE
 TWSA TREE WELL SPRINKLER ASSEMBLY
 Typ TYPICAL

U

UG UNDERGROUND

W

W WIDTH
 W/ WITH
 WM WATER METER
 WS WYE STRAINER
 WSA WYE STRAINER ASSEMBLY
 WSP WELDED STEEL PIPE
 WWM WELDED WIRE MESH

STATE OF CALIFORNIA
 DEPARTMENT OF TRANSPORTATION
**LANDSCAPE AND
 EROSION CONTROL ABBREVIATIONS**
 NO SCALE


RSP H1 DATED JULY 19, 2013 SUPERSEDES STANDARD PLAN H1
 DATED MAY 20, 2011 - PAGE 218 OF THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP H1

2010 REVISED STANDARD PLAN RSP H1

EXISTING	NEW	ITEM DESCRIPTION
		WATER METER (WM)
		BACKFLOW PREVENTER ASSEMBLY (BPA)
		BACKFLOW PREVENTER ENCLOSURE (BPE)
		BOOSTER PUMP (BP)
		TRUCK LOADING STANDPIPE (TLS)
		FLOW SENSOR (FS)
		MASTER IRRIGATION CONTROLLER (MIC)
		AUXILIARY IRRIGATION CONTROLLER (AIC)
		IRRIGATION CONTROLLER (IC)
		IRRIGATION CONTROLLER (IC) (BATTERY)
		IRRIGATION CONTROLLER (IC) (SOLAR)
		IRRIGATION CONTROLLER (IC) (TWO WIRE)
		IRRIGATION CONTROLLER(S) IN CONTROLLER ENCLOSURE CABINET (ICC)
		ARMOR-CLAD CONDUCTORS (ACC)
		CONTROL AND NEUTRAL CONDUCTORS (CNC)
		IRRIGATION CONDUIT
		EXTEND IRRIGATION CONDUIT
		DUCTILE IRON PIPE (SUPPLY LINE) (MAIN) (DIP)
		GALVANIZED STEEL PIPE (SUPPLY LINE) (MAIN) (GSP)
		GALVANIZED STEEL PIPE (SUPPLY LINE) (LATERAL) (GSP)
		PLASTIC PIPE (SUPPLY LINE) (MAIN)
		PLASTIC PIPE (SUPPLY LINE) (LATERAL)
		COPPER PIPE (SUPPLY LINE)
		DRIP IRRIGATION TUBING
		REMOTE CONTROL VALVE (RCV)
		REMOTE CONTROL VALVE (MASTER) (RCVM)
		REMOTE CONTROL VALVE (MASTER) W/FLOW METER (RCVMF)
		REMOTE CONTROL VALVE W/PRESSURE REGULATOR (RCVP)
		EXISTING MANUAL CONTROL VALVE (MCV)
		DRIP VALVE ASSEMBLY (DVA)
		WYE STRAINER ASSEMBLY (WSA)

EXISTING	NEW	ITEM DESCRIPTION
		GATE VALVE (GV)
		BALL VALVE (BV)
		QUICK COUPLING VALVE (QCV)
		CAM COUPLER ASSEMBLY (CCA)
		GARDEN VALVE ASSEMBLY (GARVA)
		PRESSURE REGULATING VALVE (PRV)
		PRESSURE RELIEF VALVE (PRLV)
		FLOW CONTROL VALVE (FCV)
		COMBINATION AIR RELEASE VALVE (CARV)
		CHECK VALVE (CV)
		FLUSH VALVE (FV)
		EXISTING NOZZLE LINE W/TURNING UNION
		EXISTING IRRIGATION SYSTEM
		EXISTING IRRIGATION SYSTEM TO BE REMOVED
		CHAIN LINK GATE
		QUICK COUPLING VALVE W/SPRINKLER PROTECTOR
		SPRINKLER W/SPRINKLER PROTECTOR
		CONNECT TO EXISTING SYSTEM
		CAP
		CAP EXISTING
		FIBER ROLL
		COMPOST SOCK

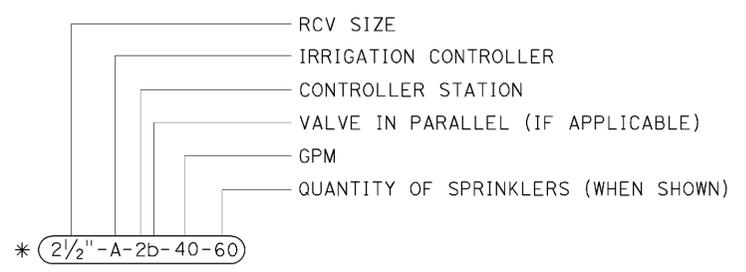

VALVE CODE

* VALVE CODES FOR EXISTING VALVES ARE SHOWN IN A DASHED ENCLOSURE.

RSP H2 DATED NOVEMBER 15, 2013 SUPERSEDES RSP H2 DATED JULY 19, 2013 AND STANDARD PLAN H2 DATED MAY 20, 2011 - PAGE 219 OF THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP H2


Dist	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	Piu	89	20.0/20.6	216	235

Gregory A. Balzer
LICENSED LANDSCAPE ARCHITECT

November 15, 2013
PLANS APPROVAL DATE

THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

TO ACCOMPANY PLANS DATED 01-19-16



STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION
LANDSCAPE AND EROSION CONTROL SYMBOLS
NO SCALE

TO ACCOMPANY PLANS DATED 01-19-16

TABLE 1

TAPER LENGTH CRITERIA AND CHANNELIZING DEVICE SPACING							
SPEED (S)	MINIMUM TAPER LENGTH * FOR WIDTH OF OFFSET 12 FEET (W)				MAXIMUM CHANNELIZING DEVICE SPACING		
	TANGENT 2L	MERGING L	SHIFTING L/2	SHOULDER L/3	X	Y	Z **
					TAPER	TANGENT	CONFLICT
mph	ft	ft	ft	ft	ft	ft	ft
20	160	80	40	27	20	40	10
25	250	125	63	42	25	50	12
30	360	180	90	60	30	60	15
35	490	245	123	82	35	70	17
40	640	320	160	107	40	80	20
45	1080	540	270	180	45	90	22
50	1200	600	300	200	50	100	25
55	1320	660	330	220	55	110	27
60	1440	720	360	240	60	120	30
65	1560	780	390	260	65	130	32
70	1680	840	420	280	70	140	35

* - For other offsets, use the following merging taper length formula for L:
 For speed of 40 mph or less, $L = WS^2/60$
 For speed of 45 mph or more, $L = WS$

Where: L = Taper length in feet
 W = Width of offset in feet
 S = Posted speed limit, off-peak 85th-percentile speed prior to work starting, or the anticipated operating speed in mph

** - Use for taper and tangent sections where there are no pavement markings or where there is a conflict between existing pavement markings and channelizers (CA).

TABLE 2

LONGITUDINAL BUFFER SPACE AND FLAGGER STATION SPACING				
SPEED *	Min D **	DOWNGRADE Min D ***		
		-3%	-6%	-9%
		ft	ft	ft
mph	ft	ft	ft	ft
20	115	116	120	126
25	155	158	165	173
30	200	205	215	227
35	250	257	271	287
40	305	315	333	354
45	360	378	400	427
50	425	446	474	507
55	495	520	553	593
60	570	598	638	686
65	645	682	728	785
70	730	771	825	891

* - Speed is posted speed limit, off-peak 85th-percentile speed prior to work starting, or the anticipated operating speed in mph
 ** - Longitudinal buffer space or flagger station spacing
 *** - Use on sustained downgrade steeper than -3 percent and longer than 1 mile.

TABLE 3

ADVANCE WARNING SIGN SPACING			
ROAD TYPE	DISTANCE BETWEEN SIGNS *		
	A	B	C
	ft	ft	ft
URBAN - 25 mph OR LESS	100	100	100
URBAN - MORE THAN 25 mph TO 40 mph	250	250	250
URBAN - MORE THAN 40 mph	350	350	350
RURAL	500	500	500
EXPRESSWAY / FREEWAY	1000	1500	2640

* - The distances are approximate, are intended for guidance purposes only, and should be applied with engineering judgment. These distances should be adjusted by the Engineer for field conditions, if necessary, by increasing or decreasing the recommended distances.

STATE OF CALIFORNIA
 DEPARTMENT OF TRANSPORTATION

TRAFFIC CONTROL SYSTEM TABLES FOR LANE AND RAMP CLOSURES

NO SCALE

RSP T9 DATED JULY 19, 2013 SUPERSEDES RSP T9 DATED APRIL 19, 2013 THAT SUPPLEMENTS THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP T9

NOTES:

See Revised Standard Plan RSP T9 for tables.

Use cone spacing X for taper segment, Y for tangent segment or Z for conflict situations, as appropriate, per Table 1, unless X, Y, or Z cone spacing is shown on this sheet.

Unless otherwise specified in the special provisions, all temporary warning signs shall have black legend on fluorescent orange background.

California codes are designated by (CA). Otherwise, Federal (MUTCD) codes are shown.

Dist	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	Piu	89	20.0/20.6	218	235

Devinder Singh
REGISTERED CIVIL ENGINEER



October 30, 2015
PLANS APPROVAL DATE

Devinder Singh
No. C50470
Exp. 6-30-17
CIVIL
STATE OF CALIFORNIA

THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

TYPICAL LANE CLOSURE WITH REVERSIBLE CONTROL

TO ACCOMPANY PLANS DATED 01-19-16

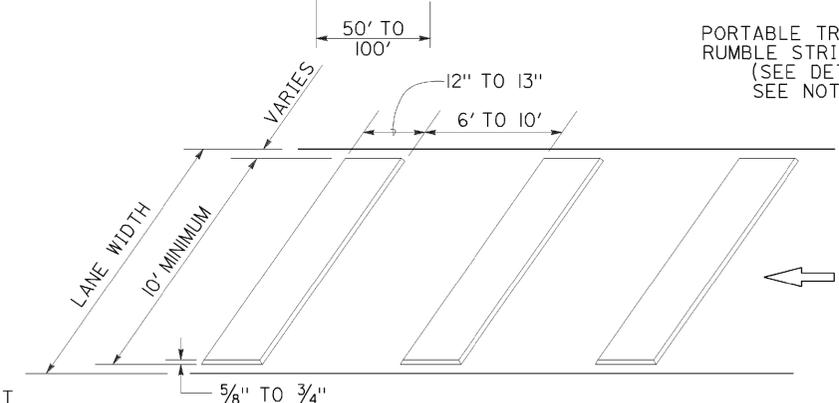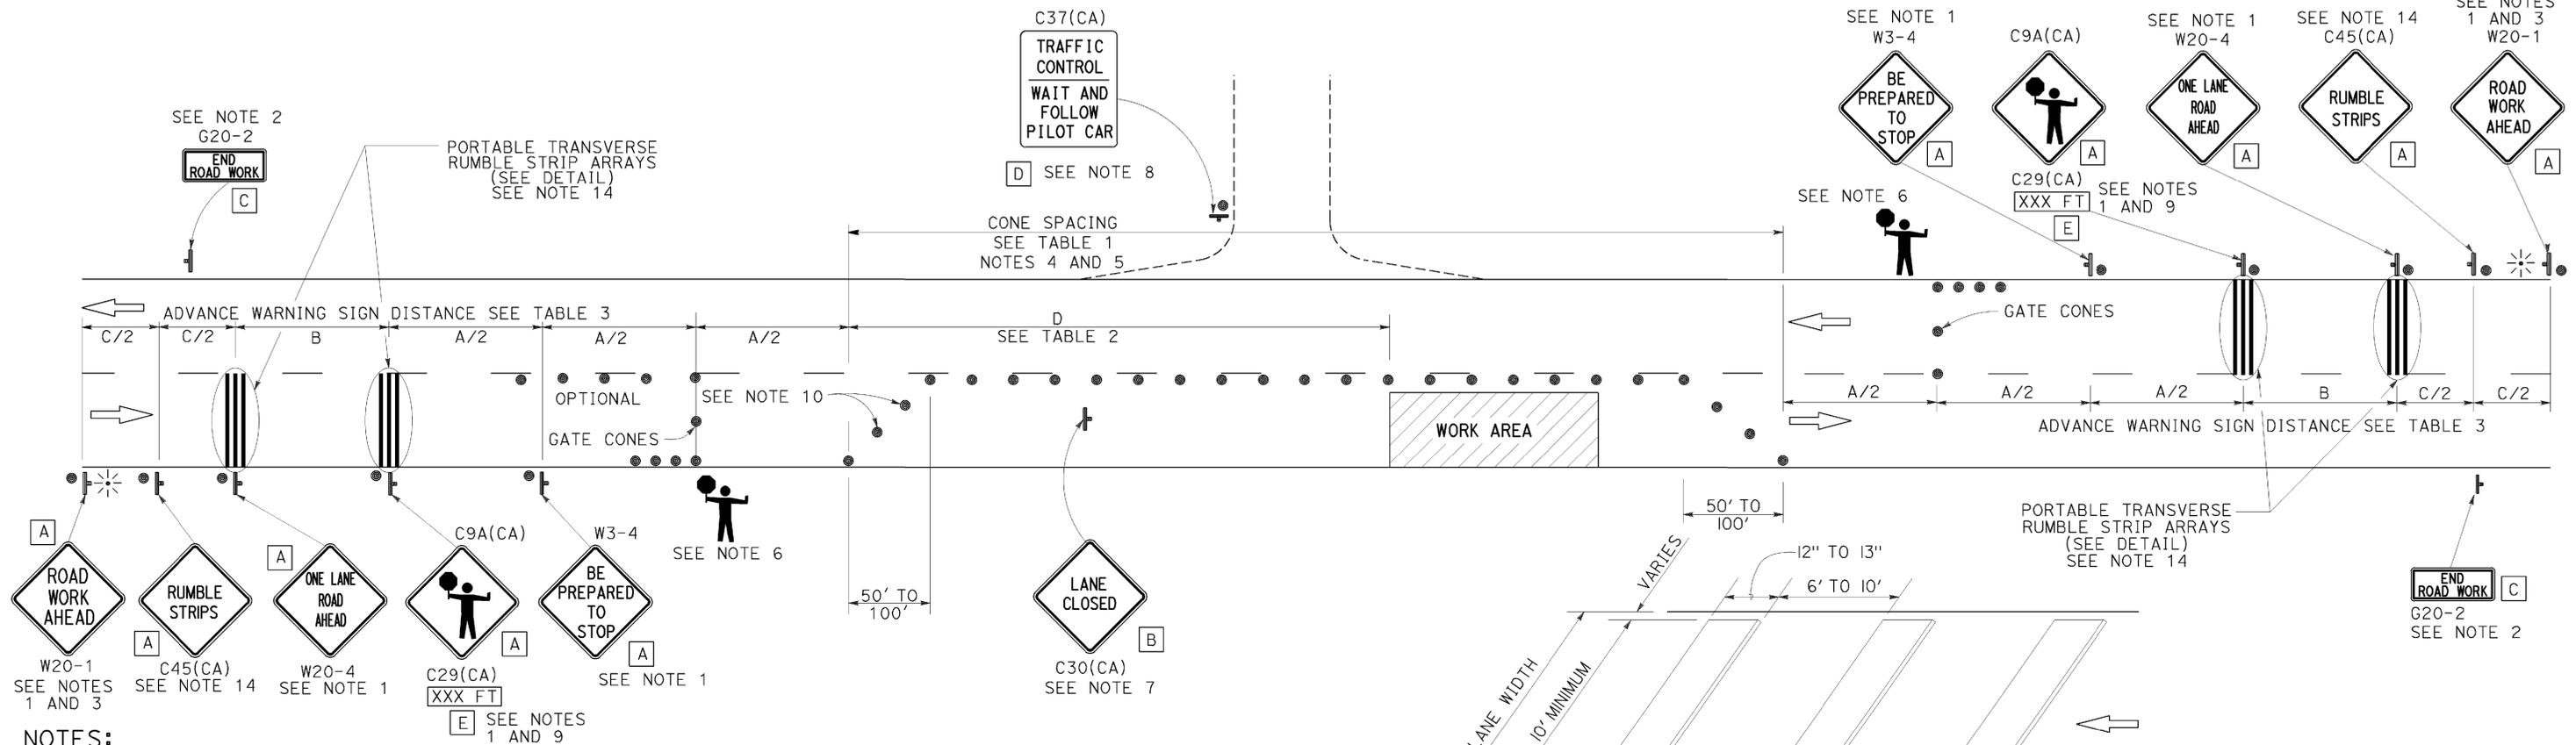

LEGEND

- TRAFFIC CONE
- ⊥ TEMPORARY TRAFFIC CONTROL SIGN
- ⚡ PORTABLE FLASHING BEACON
- 🚧 FLAGGER

SIGN PANEL SIZE (Min)

- A 48" x 48"
- B 30" x 30"
- C 36" x 18"
- D 36" x 42"
- E 20" x 7"

NOTES:

- Each advance warning sign in each direction of travel shall be equipped with at least two flags for daytime closure. Each flag shall be at least 16" x 16" in size and shall be orange or fluorescent red-orange in color. Flashing beacons shall be placed at the locations indicated for lane closure during hours of darkness.
- A G20-2 "END ROAD WORK" sign, as appropriate, shall be placed at the end of the lane control unless the end of work area is obvious, or ends within a larger project's limits.
- If the W20-1 sign would follow within 2000' of a stationary W20-1 or G20-1 "ROAD WORK NEXT _____ MILES", use a W20-4 sign for the first advance warning sign.
- All cones used for lane closures during the hours of darkness shall be fitted with retroreflective bands (or sleeves) as specified in the specifications.
- Portable delineators, placed at one-half the spacing indicated for traffic cones, may be used instead of cones for daytime closures only.
- Additional advance flaggers may be required. Flagger should stand in a conspicuous place, be visible to approaching traffic as well as approaching vehicles after the first vehicle has stopped. During the hours of darkness, the flagging-station and flagger shall be illuminated and clearly visible to approaching traffic. The illumination footprint of the lighting on the ground shall be at least 20' in diameter. Place a minimum of four cones at 50' intervals in advance of flagger station as shown.
- Place C30(CA) "LANE CLOSED" sign at 500' to 1000' intervals throughout extended work areas. They are optional if the work area is visible from the flagger station.
- When a pilot car is used, place a C37(CA) "TRAFFIC CONTROL-WAIT AND FOLLOW PILOT CAR" sign with black legend on white background at all intersections, driveways and alleys without a flagger within traffic control area. Signs shall be clean and visible at all times. Where traffic can not be effectively self-regulated, at least one flagger shall be used at each intersection within traffic control area.
- An optional C29(CA) sign may be placed below the C9A(CA) sign.
- Either traffic cones or barricades shall be placed on the taper. Barricades shall be Type I, II, or III.
- The color of the portable transverse rumble strips shall be black or orange. Use 2 arrays, each array shall consist of 3 rumble strips.
- Portable transverse rumble strips shall not be placed on sharp horizontal or vertical curves nor shall they be placed through pedestrian crossings.
- If the portable transverse rumble strips become out of alignment (skewed) by more than 6 inches, measured from one end to the other, they shall be readjusted to bring the placement back to the original location.
- Portable transverse rumble strips are not required if any one of the following conditions is satisfied:
 - Work duration occupies a location for four hours or less
 - Posted speed limit is below 45 MPH
 - Work is of emergency nature
 - Work zone is in snow or icy weather conditions

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

**TRAFFIC CONTROL SYSTEM
FOR LANE CLOSURE ON
TWO LANE CONVENTIONAL
HIGHWAYS**

NO SCALE

RSP T13 DATED OCTOBER 30, 2015 SUPERSEDES
RSP T13 DATED OCTOBER 17, 2014, RSP T13 DATED JULY 18, 2014
AND RSP T13 DATED APRIL 19, 2013 AND STANDARD PLAN T13 DATED
MAY 20, 2011 - PAGE 241 OF THE STANDARD PLANS BOOK DATED 2010.


REVISED STANDARD PLAN RSP T13

Dist	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	Piu	89	20.0/20.6	219	235

REGISTERED CIVIL ENGINEER
October 21, 2011
 PLANS APPROVAL DATE

THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

TO ACCOMPANY PLANS DATED 01-19-16

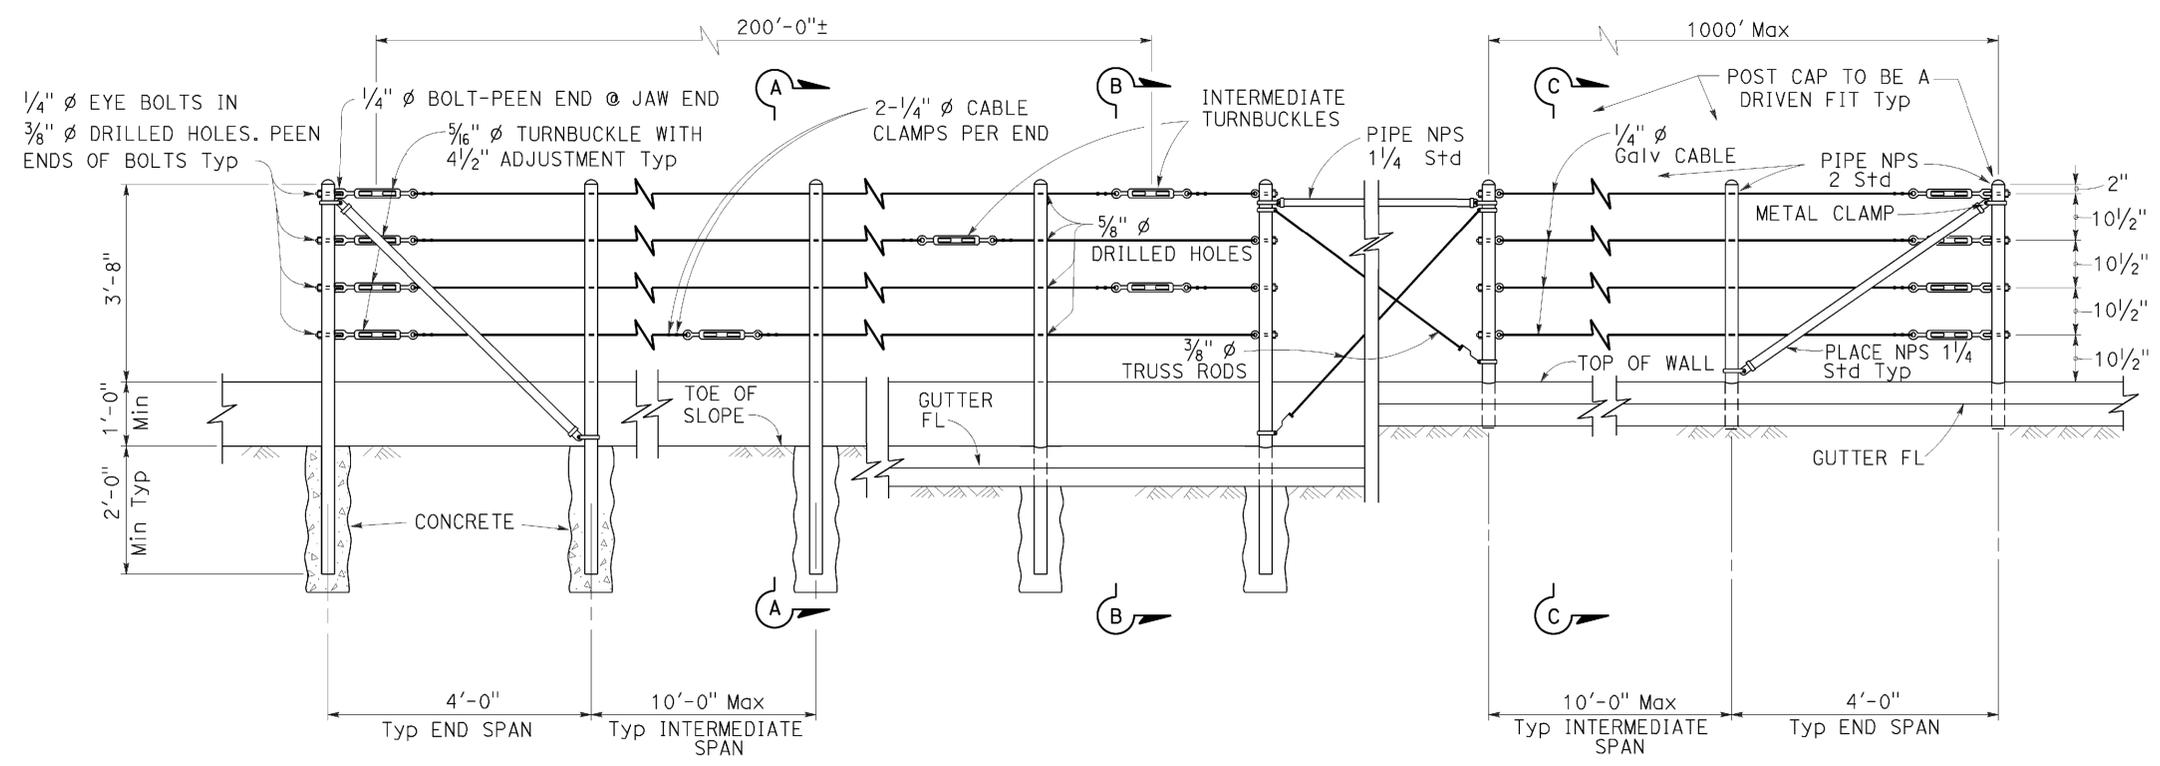


EXISTING WALL (WITHOUT GUTTER) Existing
RETAINING WALL (WITH GUTTER) Existing
RETAINING WALL (WITH GUTTER) New construction


ELEVATION

NOTES:


1. Maximum distance between turnbuckles shall be 200'-0"±.
2. Intermediate turnbuckles to be placed in adjacent spans.
3. Cable shall not be spliced between intermediate turnbuckles and end posts.
4. Posts to be vertical.
5. Alignment of holes in posts may vary to conform to slope of top of retaining wall.
6. The Contractor shall verify all dependent dimensions in the field before ordering or fabricating any material.
7. Line posts shall be braced horizontally and trussed diagonally in both directions at intervals not to exceed 1000'.
8. Post pockets to be centered in top of wall.
9. Typical end spans, braced in both directions, shall be constructed at changes in line where the angle of deflection is 15° or more.
10. Provide thimbles at all cable loops.

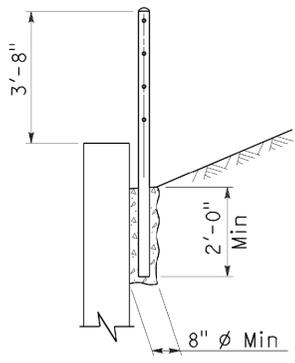


SECTION A-A
Existing

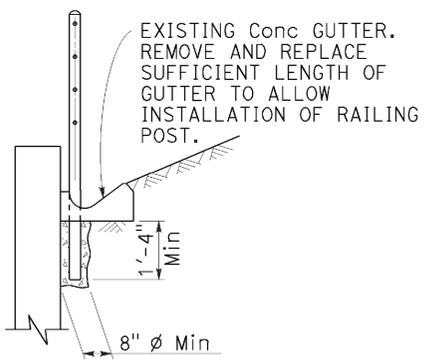


SECTION B-B
Existing

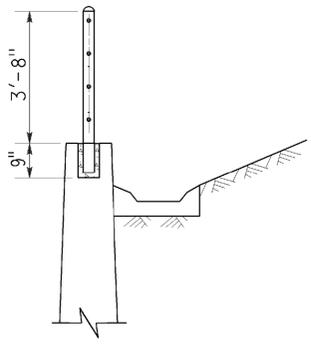


SECTION C-C
New construction

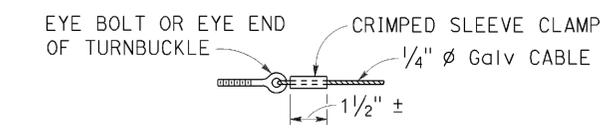

ALTERNATIVE CABLE CONNECTION

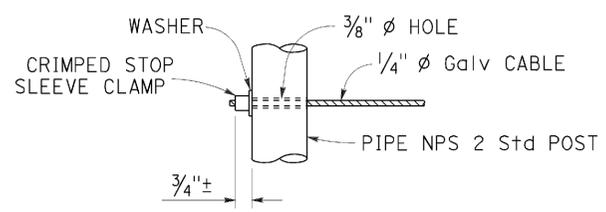

ALTERNATIVE DEAD END ANCHORAGE

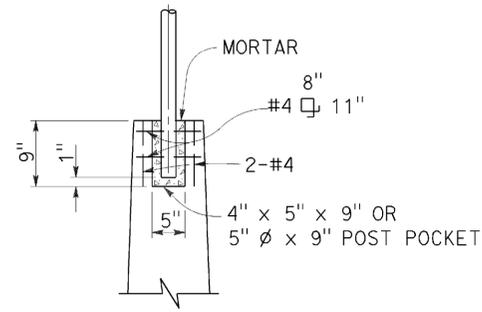

POST POCKET

STATE OF CALIFORNIA
 DEPARTMENT OF TRANSPORTATION
CABLE RAILING

NO SCALE

RSP B11-47 DATED OCTOBER 21, 2011 SUPERSEDES STANDARD PLAN B11-47
 DATED MAY 20, 2011 - PAGE 293 OF THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP B11-47

2010 REVISED STANDARD PLAN RSP B11-47

Dist	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	Piu	89	20.0/20.6	220	235

Theresa Gabriel
REGISTERED ELECTRICAL ENGINEER

October 30, 2015
PLANS APPROVAL DATE

Theresa
Aziz Gabriel
No. E15129
Exp. 6-30-16
ELECTRICAL

THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

TO ACCOMPANY PLANS DATED 01-19-16

SOFFIT AND WALL-MOUNTED LUMINAIRES

- PENDANT SOFFIT LUMINAIRE, 70 W HPS UNLESS OTHERWISE SPECIFIED
- FLUSH-MOUNTED SOFFIT LUMINAIRE, 70 W HPS UNLESS OTHERWISE SPECIFIED
- WALL-MOUNTED LUMINAIRE, 70 W HPS UNLESS OTHERWISE SPECIFIED
- EXISTING SOFFIT OR WALL-MOUNTED LUMINAIRE TO REMAIN UNMODIFIED
- EXISTING SOFFIT OR WALL-MOUNTED LUMINAIRE TO BE MODIFIED AS SPECIFIED

NOTE:
Arrow indicates "street side" of luminaire.

COMMONLY USED SYMBOLS FOR UNITED STATES CUSTOMARY UNITS OF MEASUREMENT:

SYMBOL	DEFINITIONS
Ω	OHMS
min	MINUTE
s	SECOND
bps	BITS PER SECOND
Bps	BYTES PER SECOND
A	AMPERE
v	VOLT
V(dc)	VOLT (DIRECT CURRENT)
V(ac)	VOLT (ALTERNATING CURRENT)
FC	FOOT - CANDLE
W	WATTS
VA	VOLT-AMPERE
M	MEGA
k	KILO
m	MILLI
μ	MICRO
P	PICO
HZ	HERTZ

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

ELECTRICAL SYSTEMS (LEGEND AND ABBREVIATIONS)

NO SCALE

RSP ES-1A DATED OCTOBER 30, 2015 SUPERSEDES RSP ES-1A DATED JULY 19, 2013 AND STANDARD PLAN ES-1A DATED MAY 20, 2011 - PAGE 425 OF THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP ES-1A

LEGEND:

- AB** ABANDON. IF APPLIED TO CONDUIT, REMOVE CONDUCTORS
- BC** INSTALL PULL BOX IN EXISTING CONDUIT RUN
- BP** PEDESTRIAN BARRICADE, TYPE AS INDICATED ON PLAN
- CB** INSTALL CONDUIT INTO EXISTING PULL BOX
- CC** CONNECT NEW AND EXISTING CONDUIT. REMOVE EXISTING CONDUCTORS AND INSTALL CONDUCTORS AS INDICATED
- CF** CONDUIT TO REMAIN FOR FUTURE USE. REMOVE CONDUCTORS. INSTALL PULL TAPE
- DH** DETECTOR HANDHOLE
- FA** FOUNDATION TO BE ABANDONED
- IS** INSTALL SIGN ON SIGNAL MAST ARM
- NS** NO SLIP BASE ON STANDARD
- PEC** PHOTOELECTRIC CONTROL
- PEU** PHOTOELECTRIC UNIT
- RC** EQUIPMENT OR MATERIAL TO BE REMOVED AND BECOME THE PROPERTY OF THE CONTRACTOR
- RE** REMOVE ELECTROLIER, FUSES AND BALLAST. TAPE ENDS OF CONDUCTORS
- RL** RELOCATE EQUIPMENT
- RR** REMOVE AND REUSE EQUIPMENT
- RS** REMOVE AND SALVAGE EQUIPMENT
- SC** SPLICE NEW TO EXISTING CONDUCTORS
- SD** SERVICE DISCONNECT
- TSP** TELEPHONE SERVICE POINT

ABBREVIATIONS

- | | | | |
|-------|---|-------|---|
| AC+ | UNDERGROUNDED CONDUCTOR | MAT | MAST ARM MOUNTING TOP ATTACHMENT |
| APS | ACCESSIBLE PEDESTRIAN SIGNAL | MAS | MAST ARM MOUNTING SIDE ATTACHMENT |
| Batt | BATTERY | MBPS | MANUAL BYPASS SWITCH |
| BBS | BATTERY BACKUP SYSTEM | M/M | MULTIPLE TO MULTIPLE TRANSFORMER |
| BC | BOLT CIRCLE | Mtg | MOUNTING |
| BIK | BLACK | MV | MERCURY VAPOR LIGHTING FIXTURE |
| BP | BYPASS | MVDS | MICROWAVE VEHICLE DETECTION SYSTEM |
| BPB | BICYCLE PUSH BUTTON | N | NEUTRAL (GROUNDED CONDUCTOR) |
| C | CONDUIT | NB | NEUTRAL BUS |
| CB | CIRCUIT BREAKER | NC | NORMALLY CLOSE |
| CCTV | CLOSED CIRCUIT TELEVISION | NO | NORMALLY OPEN |
| Ckt | CIRCUIT | P | CIRCUIT BREAKER'S POLE |
| CMS | CHANGEABLE MESSAGE SIGN | PB | PULL BOX |
| Ctid | CALTRANS IDENTIFICATION | PBA | PUSH BUTTON ASSEMBLY |
| Comm | COMMUNICATION | PEC | PHOTOELECTRIC CONTROL |
| Cntl | CONTROL | Ped | PEDESTRIAN |
| DF | DEPARTMENT-FURNISHED | PEU | PHOTOELECTRIC UNIT |
| DLC | LOOP DETECTOR LEAD-IN CABLE | PT | CONDUIT WITH PULL TAPE |
| EMS | EXTINGUISHABLE MESSAGE SIGN | PTR | POWER TRANSFER RELAY |
| EVUC | EMERGENCY VEHICLE UNIT CABLE | RE | RELOCATED EQUIPMENT |
| EVUD | EMERGENCY VEHICLE UNIT DETECTOR | RM | RAMP METERING |
| FB | FLASHING BEACON | RWIS | ROADSIDE WEATHER INFORMATION SYSTEM |
| FBCA | FLASHING BEACON CONTROL ASSEMBLY | SB | SLIP BASE |
| FBS | FLASHING BEACON WITH SLIP BASE | SIC | SIGNAL INTERCONNECT CABLE |
| FO | FIBER OPTIC | Sig | SIGNAL |
| G | EQUIPMENT GROUNDING CONDUCTOR | SMA | SIGNAL MAST ARM |
| GB | GROUND BUS | SNS | STREET NAME SIGN |
| GFCI | GROUND FAULT CIRCUIT INTERRUPTER | SP | SERVICE POINT |
| Grn | GREEN | TB | TERMINAL BOARD |
| HAR | HIGHWAY ADVISORY RADIO | TDC | TELEPHONE DEMARCATION CABINET |
| Hex | HEXAGONAL | Temp | TEMPERATURE |
| HPS | HIGH PRESSURE SODIUM | TMS | TRAFFIC MONITORING STATION |
| IISNS | INTERNALLY ILLUMINATED STREET NAME SIGN | TOS | TRAFFIC OPERATIONS SYSTEM |
| ISL | INDUCTION SIGN LIGHTING | UPS | UNINTERRUPTABLE POWER SUPPLY |
| LED | LIGHT EMITTING DIODE | UPSC | UNINTERRUPTABLE POWER SUPPLY CONTROLLER |
| LMA | LUMINAIRE MAST ARM | Veh | VEHICLE |
| LPS | LOW PRESSURE SODIUM | VIVDS | VIDEO IMAGE VEHICLE DETECTION SYSTEM |
| Ltg | LIGHTING | Wh+ | WHITE |
| Lum | LUMINAIRE | WIM | WEIGH-IN-MOTION |
| M | METERED | Xfmr | TRANSFORMER |

MISCELLANEOUS ELECTROLIERS

NEW	EXISTING	
		LUMINAIRE ON WOOD POLE
		NON-STANDARD ELECTROLIER (SEE PROJECT LEGEND)
		CITY ELECTROLIER
		ELECTROLIER FOUNDATION (FUTURE INSTALLATION)

NOTES:

- LED luminaires shall be 235 W when installed on Type 21, 21D, 30, 31 and 32 Standards, unless otherwise specified. LED luminaires shall be 165 W when installed on other type standards or poles, unless otherwise specified.
- Luminaires shall be the cutoff type, ANSI Type III medium cutoff lighting distribution, unless otherwise specified.

STANDARD ELECTROLIER

NEW	EXISTING	STANDARD TYPE
		15
		15D
		15 STRUCTURE
		15D STRUCTURE
		21
		21D
		21 STRUCTURE
		21D STRUCTURE
		30
		31
		32

Dist	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	Piu	89	20.0/20.6	221	235

Theresa Gabriel
REGISTERED ELECTRICAL ENGINEER

October 30, 2015
PLANS APPROVAL DATE

Theresa Aziz Gabriel
No. E15129
Exp. 6-30-16
ELECTRICAL
STATE OF CALIFORNIA

THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

TO ACCOMPANY PLANS DATED 01-19-16

CONDUIT

NEW	EXISTING	
---	---	LIGHTING CONDUIT, UNLESS OTHERWISE INDICATED OR NOTED
---	---	TRAFFIC SIGNAL CONDUIT
---C---	---c---	COMMUNICATION CONDUIT
---T---	---t---	TELEPHONE CONDUIT
---F---	---f---	FIRE ALARM CONDUIT
---FO---	---fo---	FIBER OPTIC CONDUIT
---	---	CONDUIT TERMINATION
		CONDUIT RISER ATTACHED TO THE STRUCTURE OR SERVICE POLE

SIGNAL EQUIPMENT

NEW	EXISTING	
		PEDESTRIAN SIGNAL HEAD
		PUSH BUTTON ASSEMBLY POST
		PEDESTRIAN BARRICADE
		VEHICLE SIGNAL HEAD (WITH BACKPLATE AND 3-SECTIONS: RED, YELLOW AND GREEN)
		VEHICLE SIGNAL HEAD WITH ANGLE VISOR
		MODIFICATIONS OF BASIC SYMBOL: "L" INDICATES ALL NON-ARROW SECTIONS LOUVERED "LG" INDICATES LOUVERED GREEN SECTION ONLY "PV" INDICATES ALL 12" SECTIONS PROGRAMMED VISIBILITY "8" INDICATES ALL 8" SECTIONS (ONLY WHEN SPECIFIED)
		VEHICLE SIGNAL HEAD CONSISTING OF RED, YELLOW AND GREEN LEFT ARROW SECTIONS
		VEHICLE SIGNAL HEAD CONSISTING OF RED AND YELLOW SECTIONS WITH AN UP GREEN ARROW SECTION
		VEHICLE SIGNAL HEAD (5 SECTION) CONSISTING OF RED, YELLOW AND GREEN SECTIONS WITH YELLOW AND GREEN RIGHT ARROW SECTIONS
		TYPE 15TS STANDARD WITH VEHICLE SIGNAL HEAD AND LUMINAIRE
		TYPE 21TS STANDARD WITH VEHICLE SIGNAL HEAD AND LUMINAIRE
		STANDARD WITH LUMINAIRE AND SIGNAL MAST ARMS AND ATTACHED VEHICLE SIGNAL HEADS
		TYPE 1 STANDARD WITH ATTACHED VEHICLE SIGNAL HEADS
		STANDARD WITH A SIGNAL MAST ARM, ATTACHED VEHICLE SIGNAL HEADS AND INTERNALLY ILLUMINATED STREET NAME SIGN
		CONTROLLER ASSEMBLY. DOOR INDICATES FRONT OF CABINET

SERVICE EQUIPMENT

NEW	EXISTING	
---OH---	---oh---	OVERHEAD LINES
		WOOD POLE, "U" INDICATES UTILITY OWNED
		POLE GUY WITH ANCHOR
		UTILITY TRANSFORMER - GROUND MOUNTED
		SERVICE EQUIPMENT ENCLOSURE TYPE. DOOR INDICATES FRONT OF ENCLOSURE
		TELEPHONE DEMARCATION CABINET

POLE-MOUNTED SERVICE DESIGNATION

	TYPE H SERVICE, 28'-10"	TYPE OF INSTALLATION AND POLE HEIGHT ABOVE GRADE
--	-------------------------	--

FLASHING BEACON

NEW	EXISTING	
		FLASHING BEACON (ONE VEHICLE SIGNAL HEAD WITH BACKPLATE AND VISOR) "R" INDICATES RED INDICATION, "Y" INDICATES YELLOW INDICATION
		FLASHING BEACON WITH TYPE 15-FBS STANDARD AND A SIGN.
		FLASHING BEACON WITH TYPES 9, 9A OR 9B SIGN UNLESS OTHERWISE SPECIFIED OR INDICATED

SIGNAL EQUIPMENT Cont

NEW	EXISTING	
		GUARD POST
		TYPE 1 STANDARD WITH RAMP METERING SIGN
		OPTICAL DETECTOR FOR THE EMERGENCY VEHICLE DETECTION

NOTES:

- All signal sections shall be 12" unless shown otherwise.
- Signal heads shall be provided with backplates unless shown otherwise.

ILLUMINATED OVERHEAD SIGN

NEW	EXISTING	
		SINGLE POST, SINGLE ILLUMINATED SIGN, BALANCED BUTTERFLY
		SINGLE POST, DOUBLE ILLUMINATED SIGN, BALANCED BUTTERFLY
		SINGLE POST, SINGLE ILLUMINATED SIGN, FULL CANTILEVER
		DOUBLE POST, SINGLE ILLUMINATED SIGN
		SINGLE ILLUMINATED SIGN MOUNTED ON STRUCTURE
		DOUBLE POST, SINGLE ILLUMINATED SIGN WITH ELECTROLIER

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

**ELECTRICAL SYSTEMS
(LEGEND AND ABBREVIATIONS)**


NO SCALE

RSP ES-1B DATED OCTOBER 30, 2015 SUPERSEDES RSP ES-1B DATED JULY 19, 2013 AND STANDARD PLAN ES-1B DATED MAY 20, 2011 - PAGE 426 OF THE STANDARD PLANS BOOK DATED 2010.


REVISED STANDARD PLAN RSP ES-1B

EQUIPMENT IDENTIFICATION


ILLUMINATED SIGN IDENTIFICATION NUMBER:

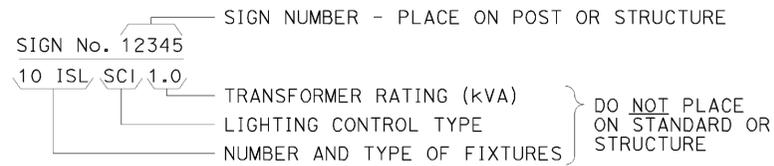


ELECTROLIER OR EQUIPMENT IDENTIFICATION NUMBER:

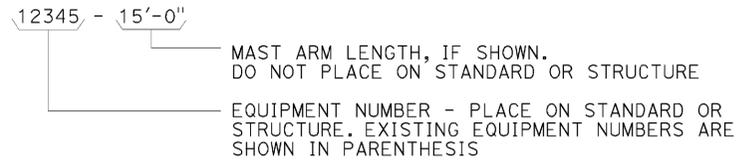


CONDUIT AND CONDUCTOR IDENTIFICATION:

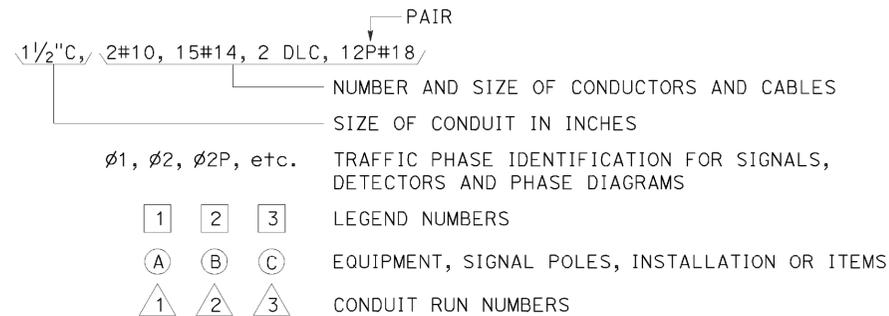


SIGNAL AND LIGHTING STANDARD (TYPICAL DESIGNATION):

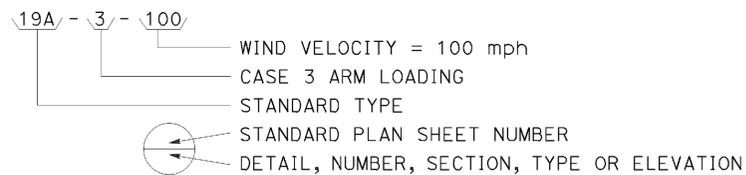


MISCELLANEOUS EQUIPMENT

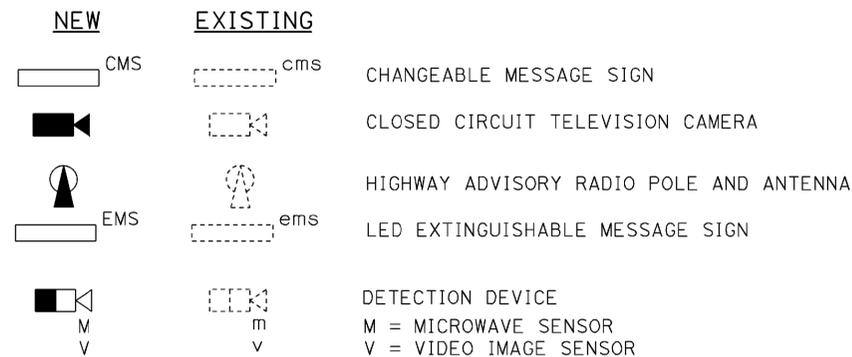



WIRING DIAGRAM LEGEND

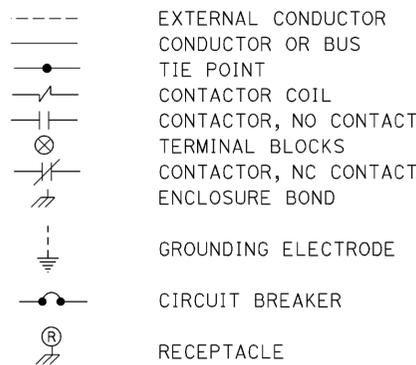

PULL BOXES

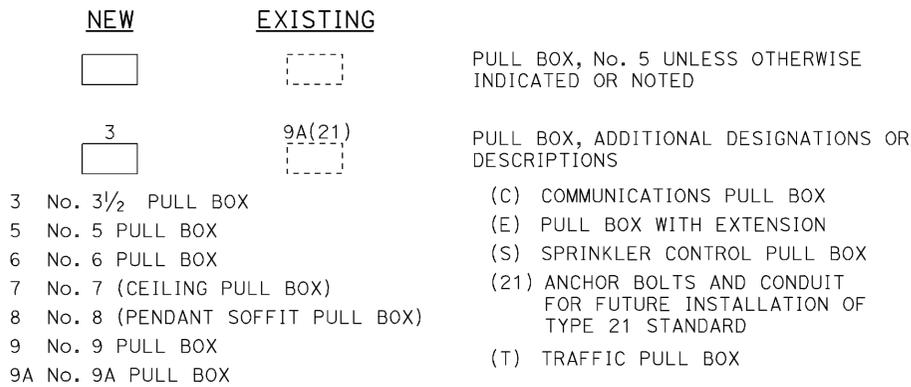

VEHICLE DETECTORS

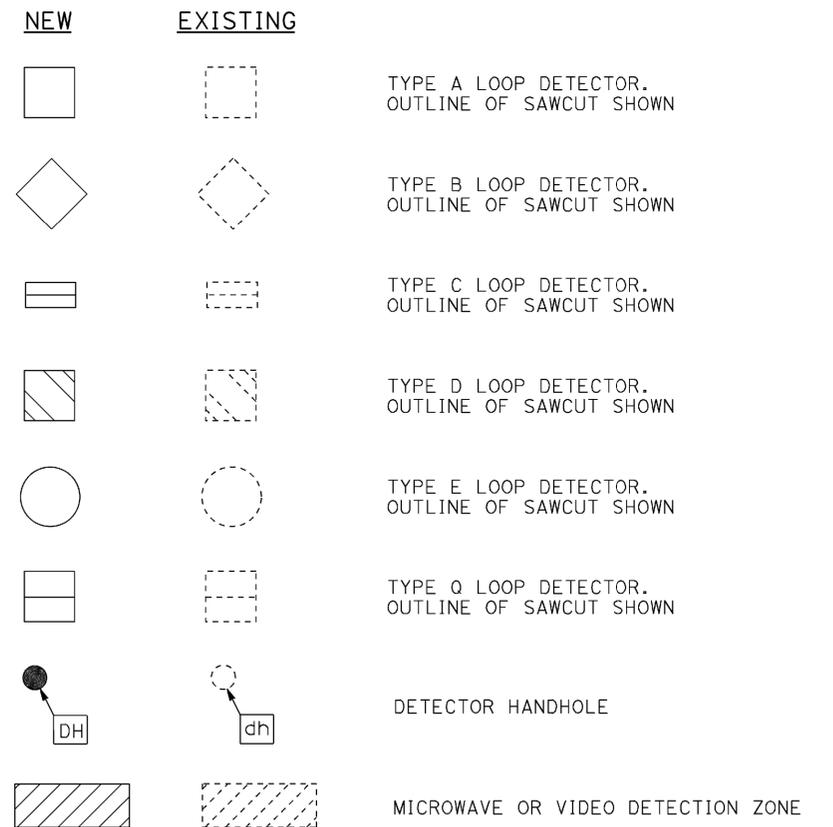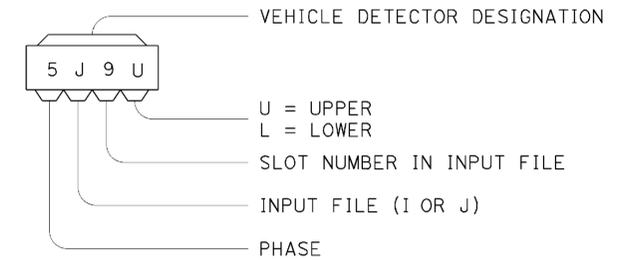

STATE OF CALIFORNIA
 DEPARTMENT OF TRANSPORTATION

ELECTRICAL SYSTEMS (LEGEND AND ABBREVIATIONS)

NO SCALE

RSP ES-1C DATED OCTOBER 30, 2015 SUPERSEDES RSP ES-1C DATED JULY 19, 2013 AND STANDARD PLAN ES-1C DATED MAY 20, 2011 - PAGE 427 OF THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP ES-1C

DIST	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET NO.	TOTAL SHEETS
02	Plu	89	20.0/20.6	223	235

Theresa Gabriel
 REGISTERED ELECTRICAL ENGINEER
 October 30, 2015
 PLANS APPROVAL DATE



THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

TO ACCOMPANY PLANS DATED 01-19-16

NOTES:

1. The plan shows the approximate location of devices within the enclosure. Components may be rearranged, however, the "working" clearances within the service equipment enclosure shall be maintained.
2. In unpaved areas a raised portland cement concrete pad 2'-0" x 4" x width of foundation shall be constructed in front of new service equipment enclosure installation. Pad shall be set to elevation of foundation.
3. Plug-in circuit breakers may be mounted in the vertical or horizontal position. Cable-in/cable-out circuit breakers shall be mounted in the vertical position.
4. Type III-AF and Type III-BF service equipment enclosures shall have the meter viewing windows located on the front side of the service equipment enclosures.
5. Type III-AR and Type III-BR service equipment enclosure shall be similarly constructed as Type III-AF and Type III-BF respectively, except the meter viewing windows shall be located on the back side of the service equipment enclosures.

STATE OF CALIFORNIA
 DEPARTMENT OF TRANSPORTATION
**ELECTRICAL SYSTEMS
 (SERVICE EQUIPMENT ENCLOSURE
 NOTES TYPE III SERIES)**


NO SCALE

RSP ES-2C DATED OCTOBER 30, 2015 SUPERSEDES STANDARD PLAN ES-2C DATED MAY 20, 2011 - PAGE 430 OF THE STANDARD PLANS BOOK DATED 2010.


REVISED STANDARD PLAN RSP ES-2C

2010 REVISED STANDARD PLAN RSP ES-2C


DATE PLOTTED => 19-JAN-2016
 TIME PLOTTED => 13:15

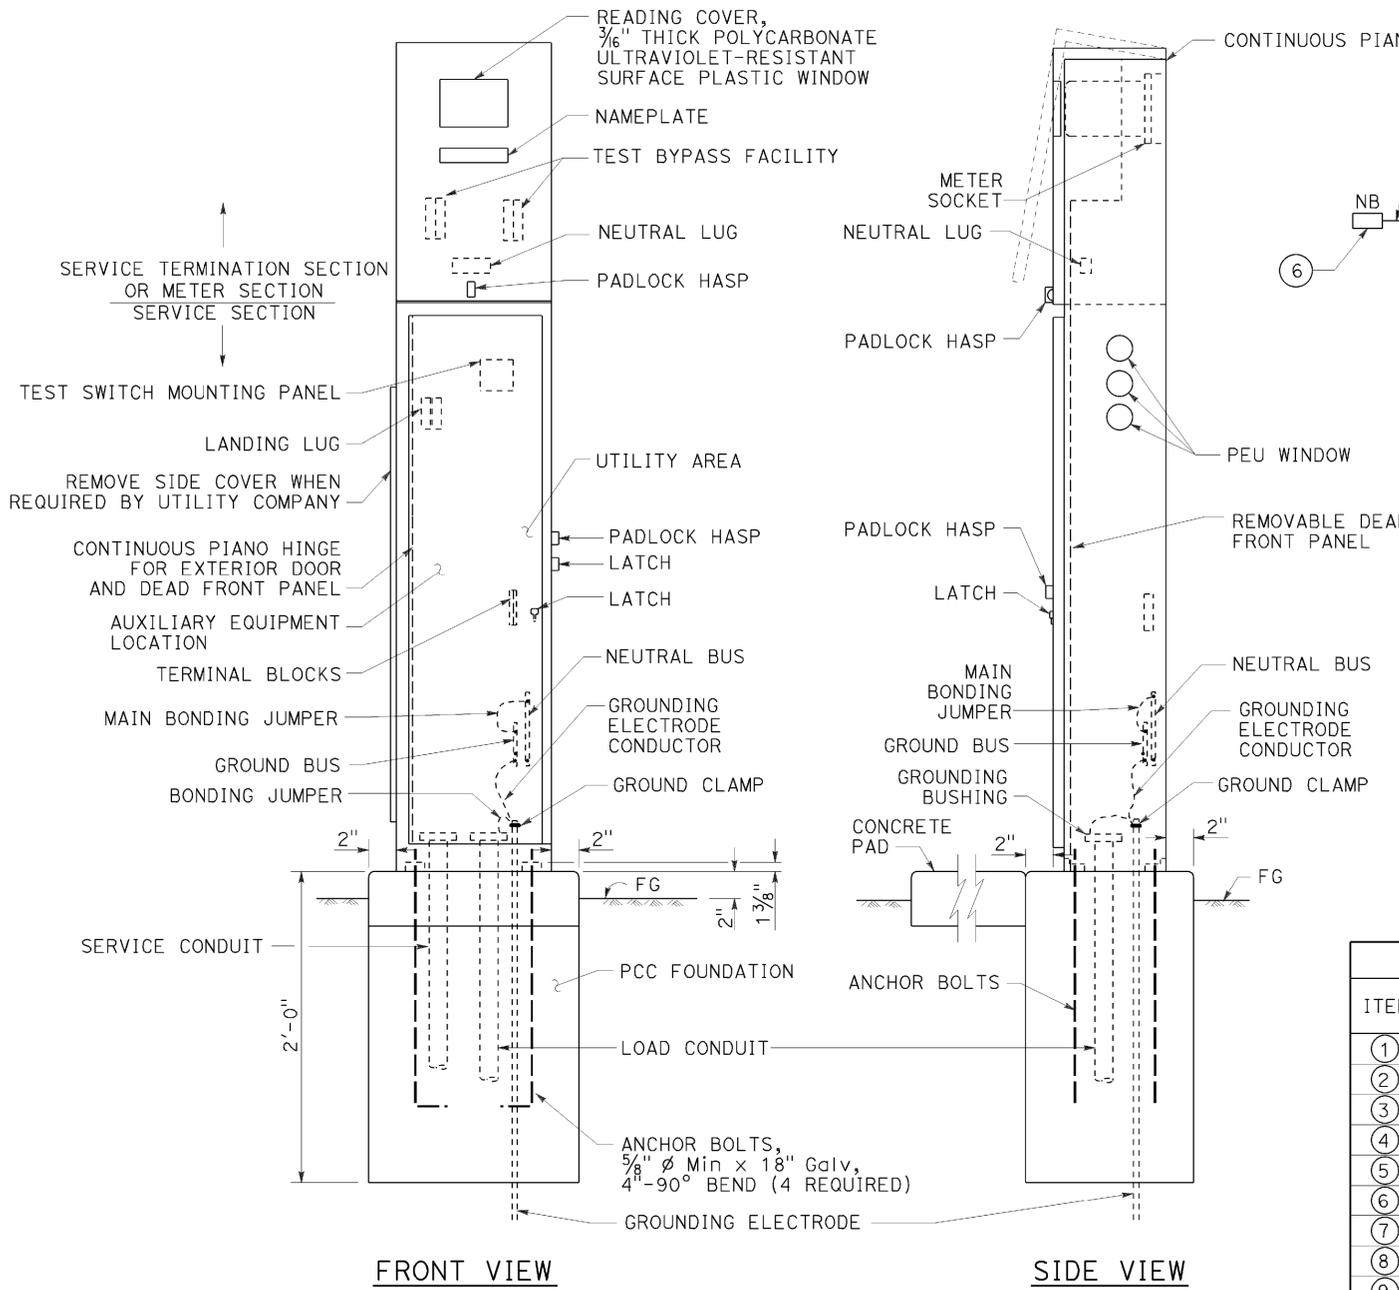


TYPE III-AF SERVICE EQUIPMENT ENCLOSURE (TYPICAL)
DETAIL A

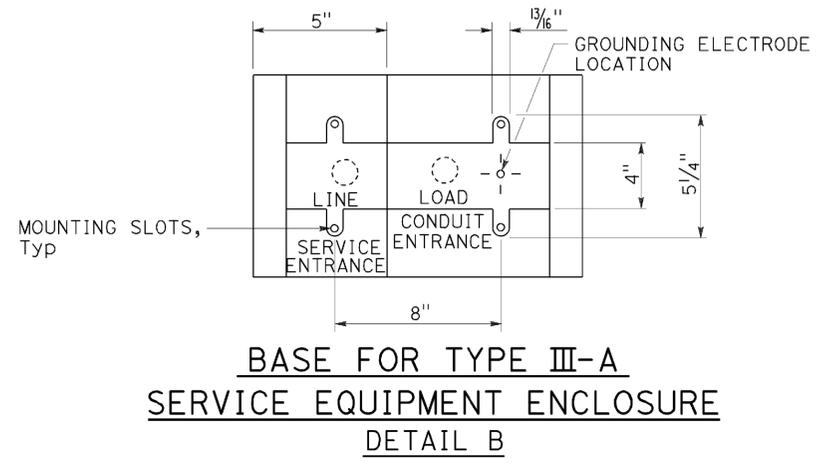

BASE FOR TYPE III-A SERVICE EQUIPMENT ENCLOSURE
DETAIL B

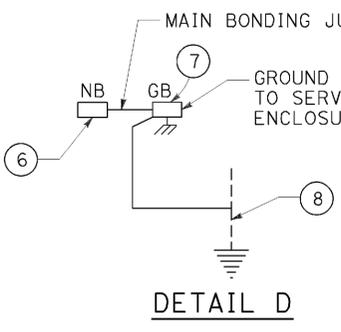

DETAIL D

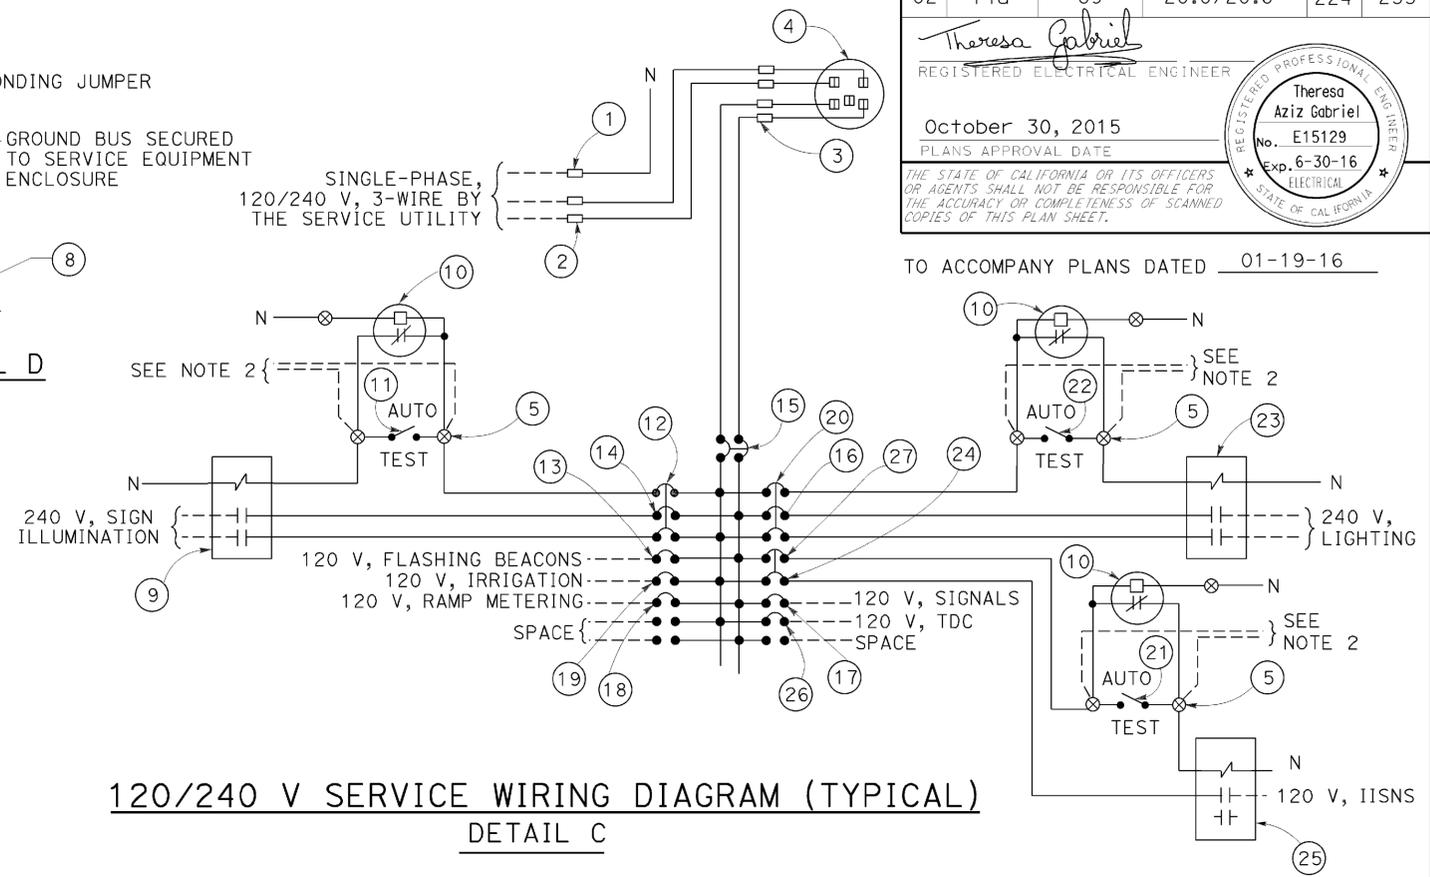

120/240 V SERVICE WIRING DIAGRAM (TYPICAL)
DETAIL C

TYPE III-A SERVICE EQUIPMENT ENCLOSURE LEGEND (120/240 V)					
ITEM	COMPONENT	NAMEPLATE DESCRIPTION	ITEM	COMPONENT	NAMEPLATE DESCRIPTION
①	NEUTRAL LUG		⑭	30 A, 240 V, 2P, CB	SIGN ILLUMINATION
②	LANDING LUG		⑮	100 A, 240 V, 2P, CB	MAIN BREAKER
③	TEST BYPASS FACILITY		⑯	30 A, 240 V, 2P, CB	LIGHTING
④	METER SOCKET AND SUPPORT		⑰	50 A, 120 V, 1P, CB	SIGNALS
⑤	TERMINAL BLOCKS		⑱	30 A, 120 V, 1P, CB	RAMP METERING
⑥	NEUTRAL BUS		⑲	20 A, 120 V, 1P, CB	IRRIGATION
⑦	GROUND BUS		⑳	15 A, 120 V, 1P, CB	LIGHTING CONTROL
⑧	GROUNDING ELECTRODE		㉑	15 A, 1P, TEST SWITCH	IISNS TEST SWITCH
⑨	30 A, 2P, NO CONTACTOR	SIGN ILLUMINATION	㉒	15 A, 1P, TEST SWITCH	LIGHTING TEST SWITCH
⑩	PHOTOELECTRIC UNIT (NOTE 4)	PEU	㉓	60 A, 2P, NO CONTACTOR	LIGHTING
⑪	15 A, 1P, TEST SWITCH	SIGN ILLUMINATION TEST SWITCH	㉔	15 A, 120 V, 1P, CB	IISNS
⑫	15 A, 120 V, 1P, CB	SIGN ILLUMINATION CONTROL	㉕	30 A, 2P, NO CONTACTOR	IISNS
⑬	15 A, 120 V, 1P, CB	FLASHING BEACON	㉖	20 A, 120 V, 1P, CB	TELEPHONE DEMARCATION CABINET
			㉗	15 A, 120 V, 1P, CB	IISNS CONTROL

NOTES:

- Unless otherwise indicated on the plans, service equipment items shall be provided for each service equipment enclosure as shown.
- Connect to remote test switch mounted on lighting standards, sign post or structure when required.
- Items ① and ⑥ shall be isolated from the service equipment enclosure.
- Type V photoelectric control shall be used unless otherwise indicated on the plans.
- Item ⑫, ⑳ and ㉗ shall be ganged operated CB.

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

**ELECTRICAL SYSTEMS
(SERVICE EQUIPMENT ENCLOSURE
AND TYPICAL WIRING DIAGRAM,
TYPE III-A SERIES)**


NO SCALE

RSP ES-2D DATED OCTOBER 30, 2015 SUPERSEDES STANDARD PLAN ES-2D DATED MAY 20, 2011 - PAGE 431 OF THE STANDARD PLANS BOOK DATED 2010.


REVISED STANDARD PLAN RSP ES-2D

Dist	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	Plu	89	20.0/20.6	225	235

Theresa Gabriel
 REGISTERED ELECTRICAL ENGINEER
 October 30, 2015
 PLANS APPROVAL DATE
 THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.




TO ACCOMPANY PLANS DATED 01-19-16

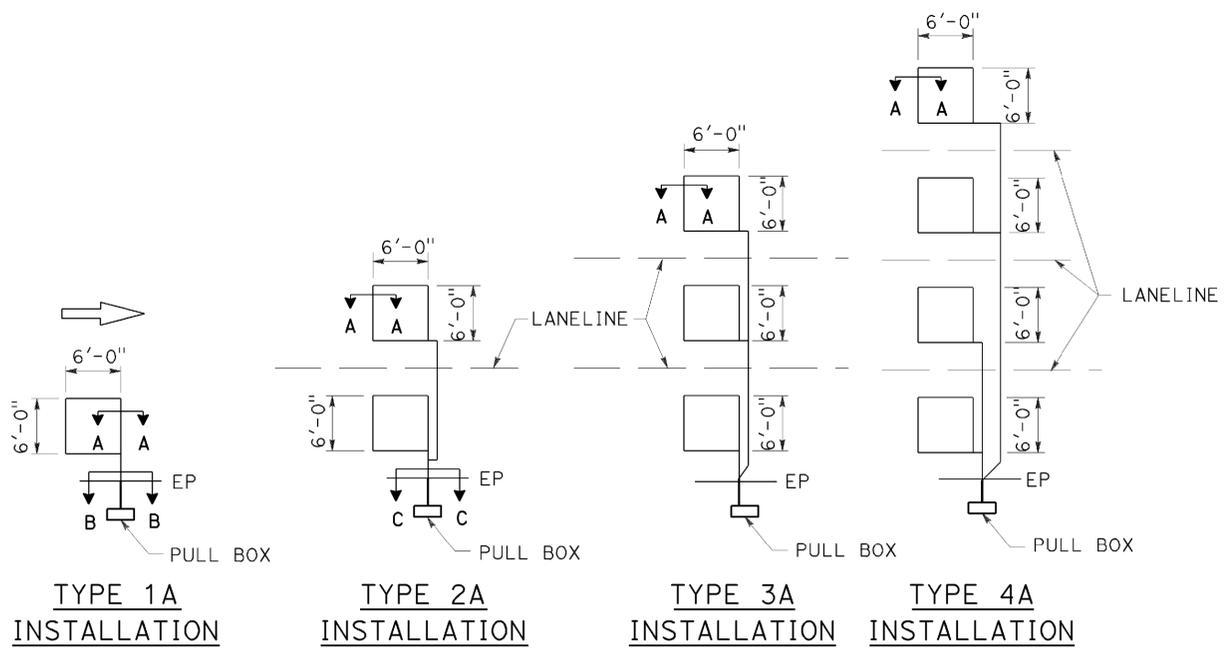


SAWCUT DETAILS

- Type A loop detector configurations illustrated
- 1A thru 4A = 1 Type A loop configuration in each lane.
 - 1B thru 4B = 1 Type B loop configuration in each lane.
 - 1C = 1 Type C loop configuration entering lanes as required.
 - 1D thru 4D = 1 Type D loop configuration in each lane.
 - 1E thru 4E = 1 Type E loop configuration in each lane.
 - 1Q thru 4Q = 1 Type Q loop configuration in each lane.
- Use Type A, B, C, D, E or Q loop detector configurations only when specified or shown on plans.

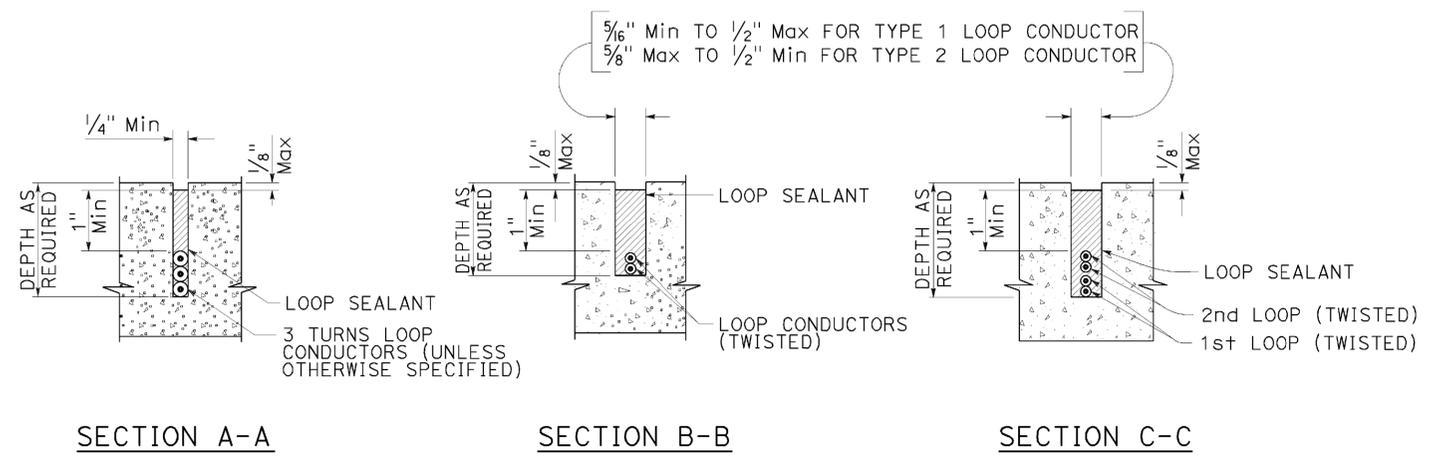


SLOT DETAILS - TYPE 1 AND TYPE 2 LOOP CONDUCTOR

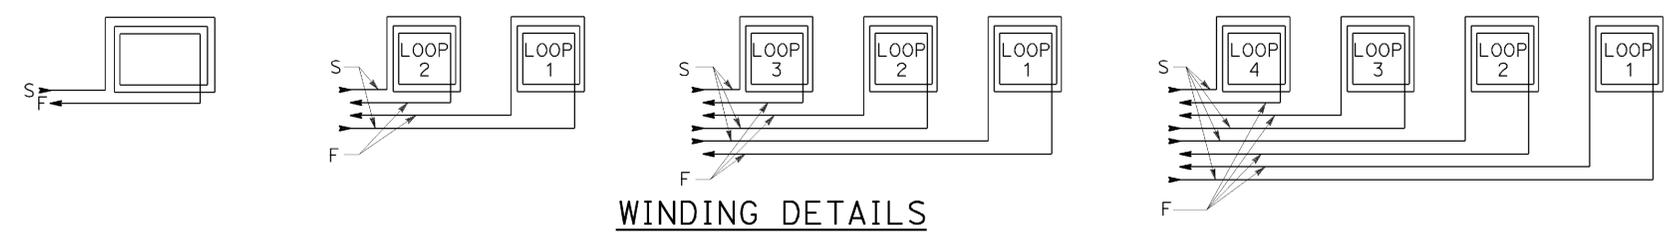

WINDING DETAILS

ABBREVIATIONS:
 S - START
 F - FINISH

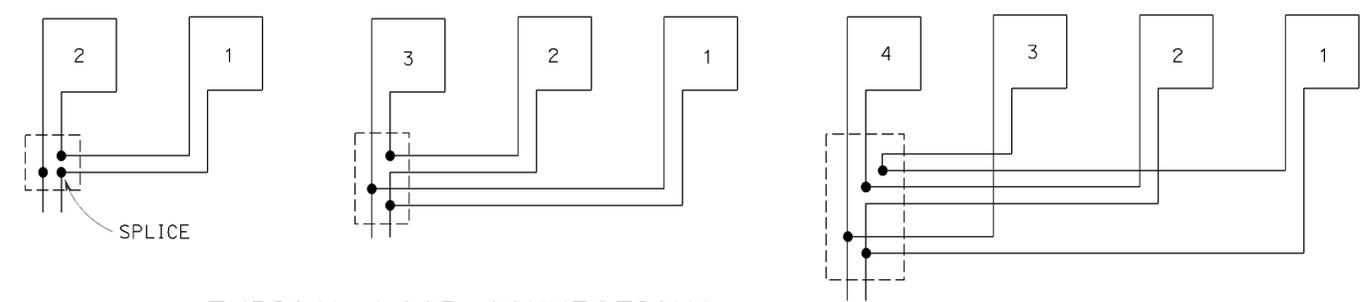

TYPICAL LOOP CONNECTIONS

Dashed lines represent the pull box

STATE OF CALIFORNIA
 DEPARTMENT OF TRANSPORTATION
**ELECTRICAL SYSTEMS
 (LOOP DETECTORS)**
 NO SCALE

RSP ES-5A DATED OCTOBER 30, 2015 SUPERSEDES STANDARD PLAN ES-5A DATED MAY 20, 2011 - PAGE 448 OF THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP ES-5A

2010 REVISED STANDARD PLAN RSP ES-5A


DATE PLOTTED => 19-JAN-2016
 TIME PLOTTED => 13:16

Dist	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	Piu	89	20.0/20.6	226	235


Theresa Gabriel
 REGISTERED ELECTRICAL ENGINEER
 October 30, 2015
 PLANS APPROVAL DATE
THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

REGISTERED PROFESSIONAL ENGINEER
 Theresa
 Aziz Gabriel
 No. E15129
 Exp. 6-30-16
 ELECTRICAL
 STATE OF CALIFORNIA


TO ACCOMPANY PLANS DATED 01-19-16

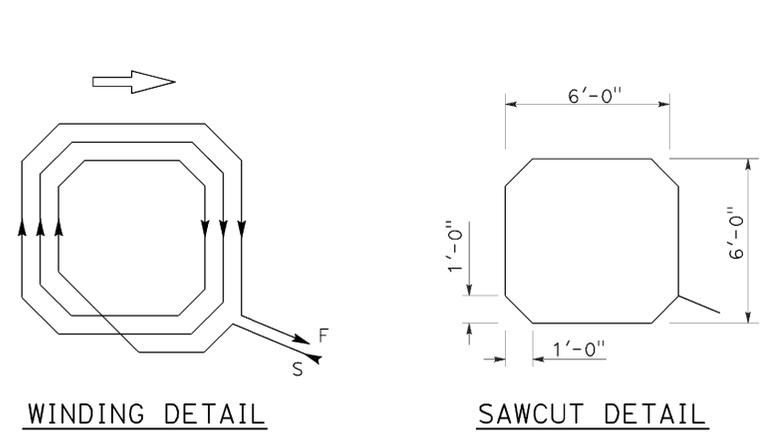


WINDING DETAIL
SAWCUT DETAIL
TYPE A LOOP DETECTOR CONFIGURATION

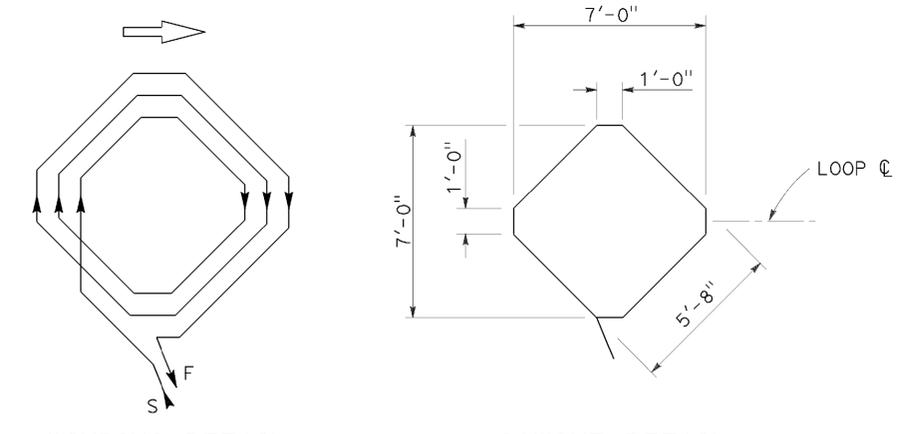


WINDING DETAIL
SAWCUT DETAIL
TYPE B LOOP DETECTOR CONFIGURATION

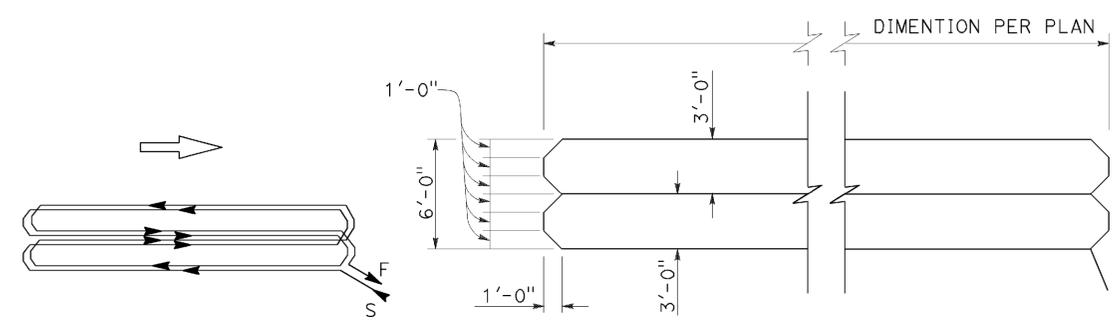


WINDING DETAIL
SAWCUT DETAIL
TYPE C LOOP DETECTOR CONFIGURATION

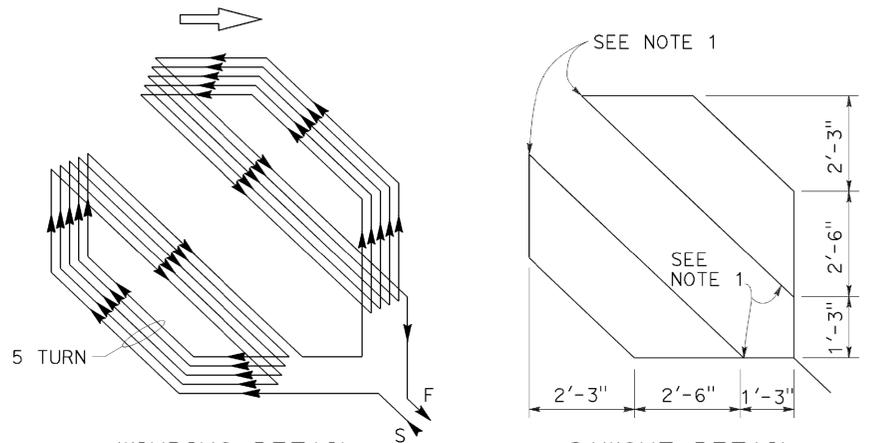


WINDING DETAIL
SAWCUT DETAIL
TYPE D LOOP DETECTOR CONFIGURATION

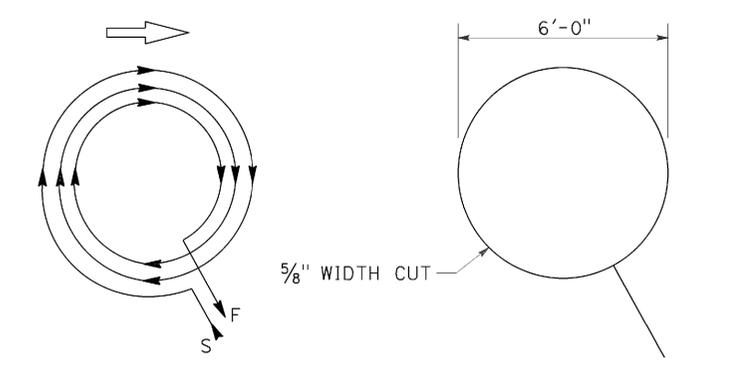

WINDING DETAIL
SAWCUT DETAIL
TYPE E LOOP DETECTOR CONFIGURATION

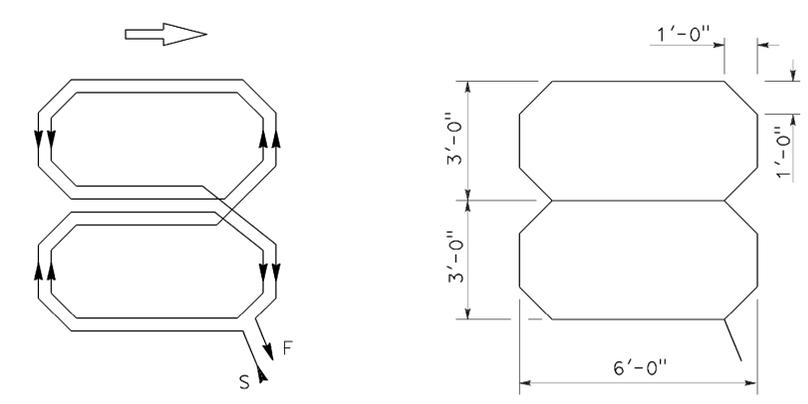

WINDING DETAIL
SAWCUT DETAIL
TYPE Q LOOP DETECTOR CONFIGURATION

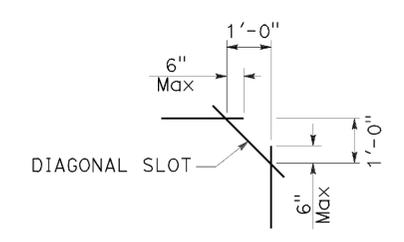

**PLAN VIEW OF
DIAGONAL SLOT
AT CORNERS**

- NOTES:**
1. Round corners of acute angle sawcuts to prevent damage to conductors.
 2. Typical distance separating loops from edge to edge is 10' for Type A, B, D and E installation in single lane.
 3. Use Type D loops for limit line detector installations in left turn and bicycle lanes.

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION
**ELECTRICAL SYSTEMS
(DETECTORS)**
NO SCALE

RSP ES-5B DATED OCTOBER 30, 2015 SUPERSEDES RSP ES-5B DATED JULY 19, 2013 AND STANDARD PLAN ES-5B DATED MAY 20, 2011 - PAGE 449 OF THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP ES-5B

2010 REVISED STANDARD PLAN RSP ES-5B

DIST	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	Piu	89	20.0/20.6	227	235


Theresa Gabriel
 REGISTERED ELECTRICAL ENGINEER
 October 30, 2015
 PLANS APPROVAL DATE

THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.


TO ACCOMPANY PLANS DATED 01-19-16

NOTES:


1. Back casting shape to fit curvature of pole.
2. Provide cover fitting for top of post, when PBA is mounted on push button assembly post.
3. Install push button on crosswalk side of standard.
4. Use R10 series regulatory signs and plaques for pedestrian and bicycle facilities.

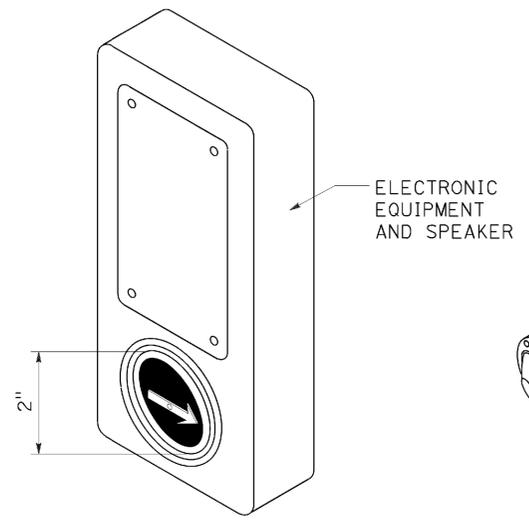

ACCESSIBLE PEDESTRIAN SIGNAL
DETAIL A

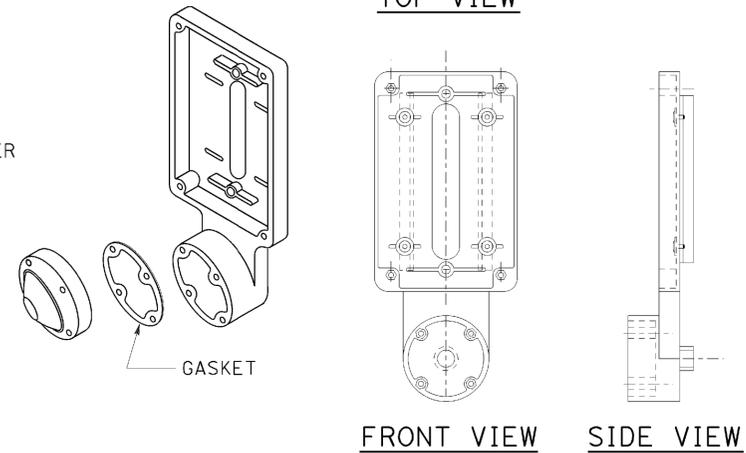

TYPE B PUSH BUTTON ASSEMBLY
DETAIL B

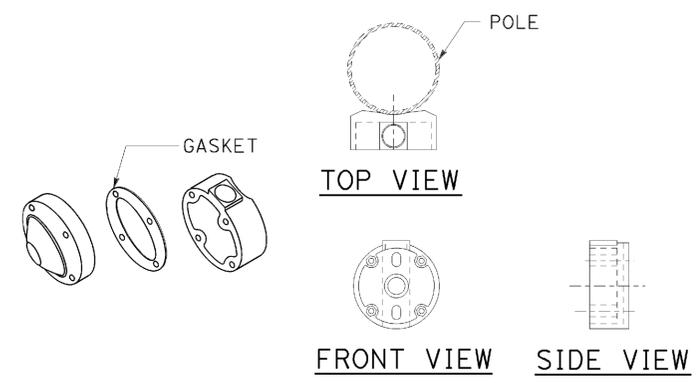

TYPE C PUSH BUTTON ASSEMBLY
DETAIL C

STATE OF CALIFORNIA
 DEPARTMENT OF TRANSPORTATION
ELECTRICAL SYSTEMS
(ACCESSIBLE PEDESTRIAN SIGNAL
AND PUSH BUTTON ASSEMBLIES)
 NO SCALE

RSP ES-5C DATED OCTOBER 30, 2015 SUPERSEDES RSP ES-5C DATED JULY 19, 2013 AND STANDARD PLAN ES-5C DATED MAY 20, 2011 - PAGE 450 OF THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP ES-5C


2010 REVISED STANDARD PLAN RSP ES-5C
 DATE PLOTTED => 19-JAN-2016
 TIME PLOTTED => 13:17

Dist	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	Plu	89	20.0/20.6	228	235


Theresa Gabriel
 REGISTERED ELECTRICAL ENGINEER
 October 30, 2015
 PLANS APPROVAL DATE
THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

TO ACCOMPANY PLANS DATED 01-19-16


2010 REVISED STANDARD PLAN RSP ES-5D

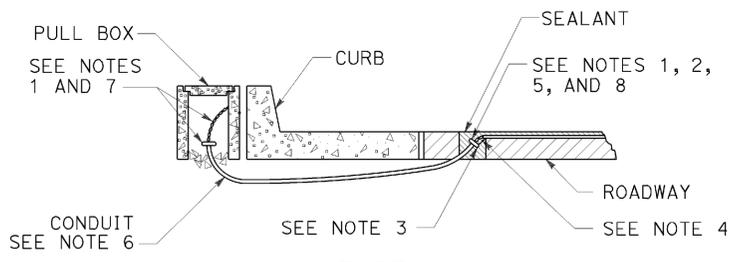


**TYPE A
CURB TERMINATION DETAIL**

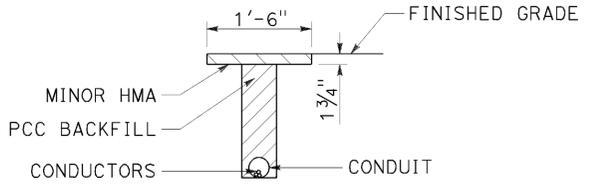


**"T" TRENCH
DETAIL 1**

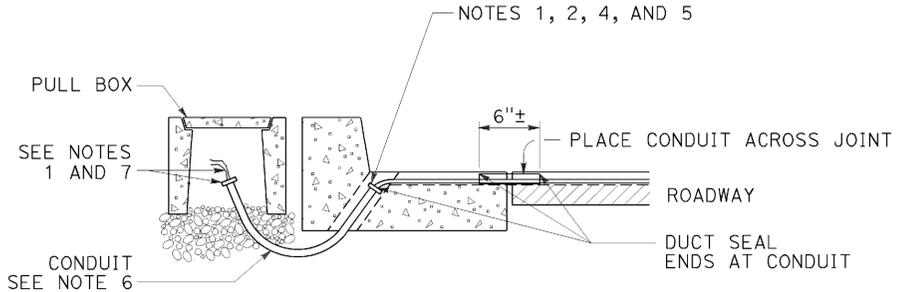


CROSS SECTION

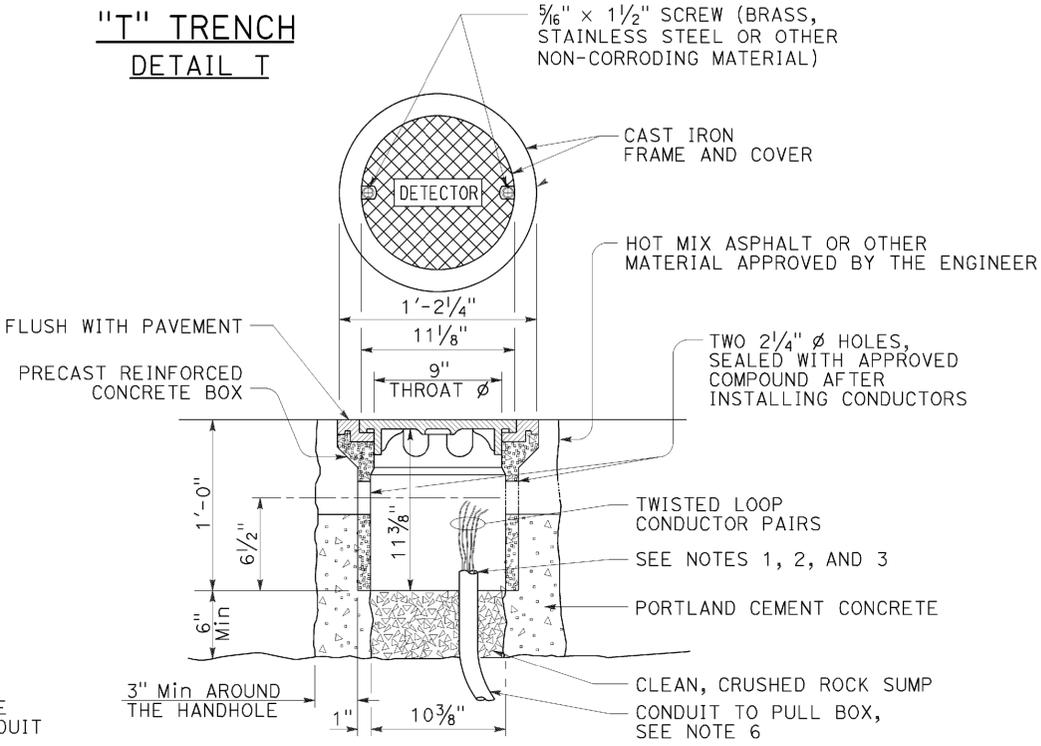


DETECTOR HANDHOLE DETAIL

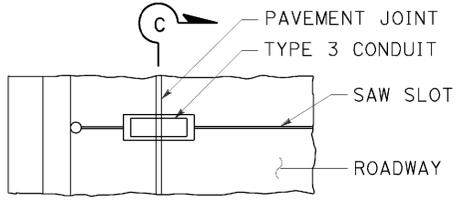


PLAN VIEW

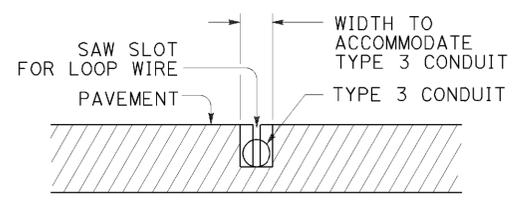


SECTION C-C

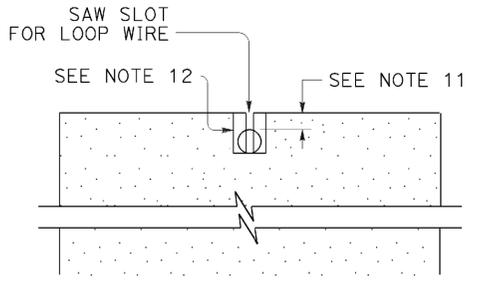


SECTION A-A

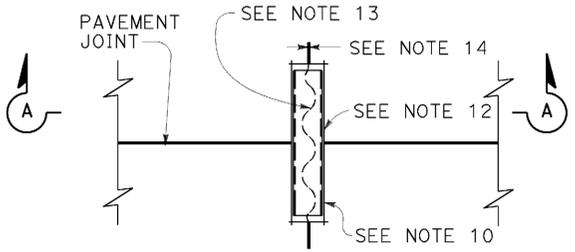


**PLAN VIEW
TYPICAL LOOP LEAD-IN DETAIL
AT PAVEMENT JOINT**

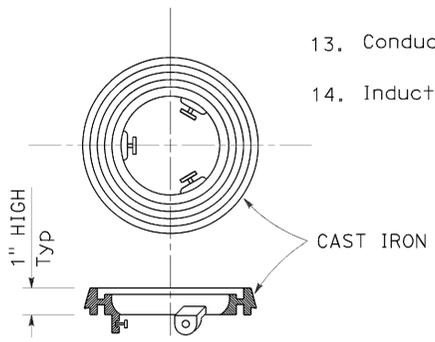

LOCKING GRADE RING

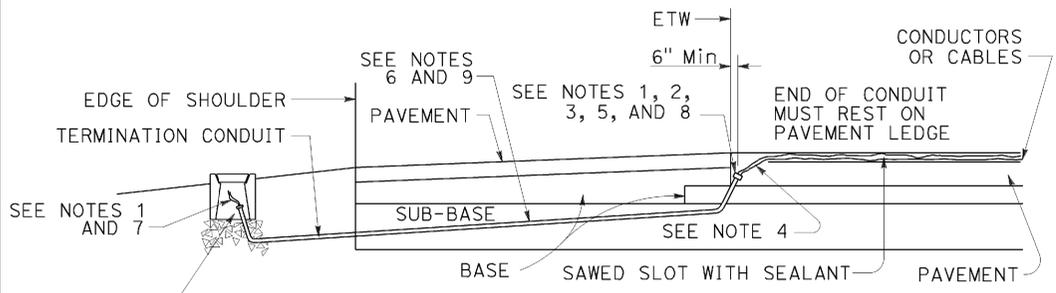

CROSS SECTION

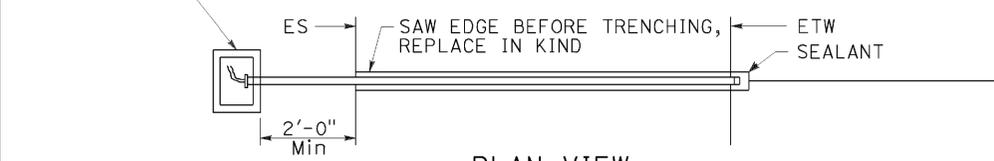

**PLAN VIEW
SHOULDER TERMINATION DETAILS**

NOTES:

- Bushing shall be used at end of conduit.
- Tape detector conductors or cables 3" each side of bushings.
- Install duct seal compound to each end of termination conduit before installing sealant.
- Round all sharp edges where detector conductors or cables have to pass.
- End of conduit shall be 3/8" below roadway surface.
- Conduit size Loop conductors
 1"C minimum 1 to 2 pairs
 1 1/2"C minimum 3 to 4 pairs
 2"C minimum 5 or more pairs
- Splice detector conductors or cables to detector lead-in-cable.
- Location of detector handhole when shown on plans.
- When the shoulder and traveled way are paved with the same material and there is no joint between them, the conduit shall extend only 2'-0" into the shoulder pavement.
- 3/4"C, Type 3 conduit 6" long minimum, plug both ends with duct compound to keep out sealant.
- 1/2" Minimum between top of conduit and pavement surface.
- Sawcut shall not exceed 1" in width and 1/8" longer than conduit to be installed.
- Conductors with 1/2" minimum slack inside conduit.
- Inductive loop detector saw slot.

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

**ELECTRICAL SYSTEMS
(CURB AND SHOULDER TERMINATION,
TRENCH, AND HANDHOLE DETAILS)**


NO SCALE

RSP ES-5D DATED OCTOBER 30, 2015 SUPERSEDES RSP ES-5D DATED JULY 19, 2013 AND STANDARD PLAN ES-5D DATED MAY 20, 2011 - PAGE 451 OF THE STANDARD PLANS BOOK DATED 2010.



REVISED STANDARD PLAN RSP ES-5D

TO ACCOMPANY PLANS DATED 01-19-16

- NOTES:**
- Standards shall be 10'-0" ± 2" for vehicle signals and 7'-0" ± 2" for pedestrian signals unless shorter pole is noted on project plans.
 - Top of standards shall be 4 1/2" OD.
 - Conduits shall extend 2" maximum above finished surface of foundation and for Types 1-A, 1-C and 1-D shall be sloped toward handhole.
 - Anchor bolts shall be bonded to conduit or grounding conductor.
 - For additional notes and details, see Revised Standard Plans RSP ES-7M and RSP ES-7N.
 - Pour foundation concrete against undisturbed soil.
 - For standards with handhole, locate in the downstream side of traffic.
 - Coupling nuts to be used only when shown or specified on project plans.

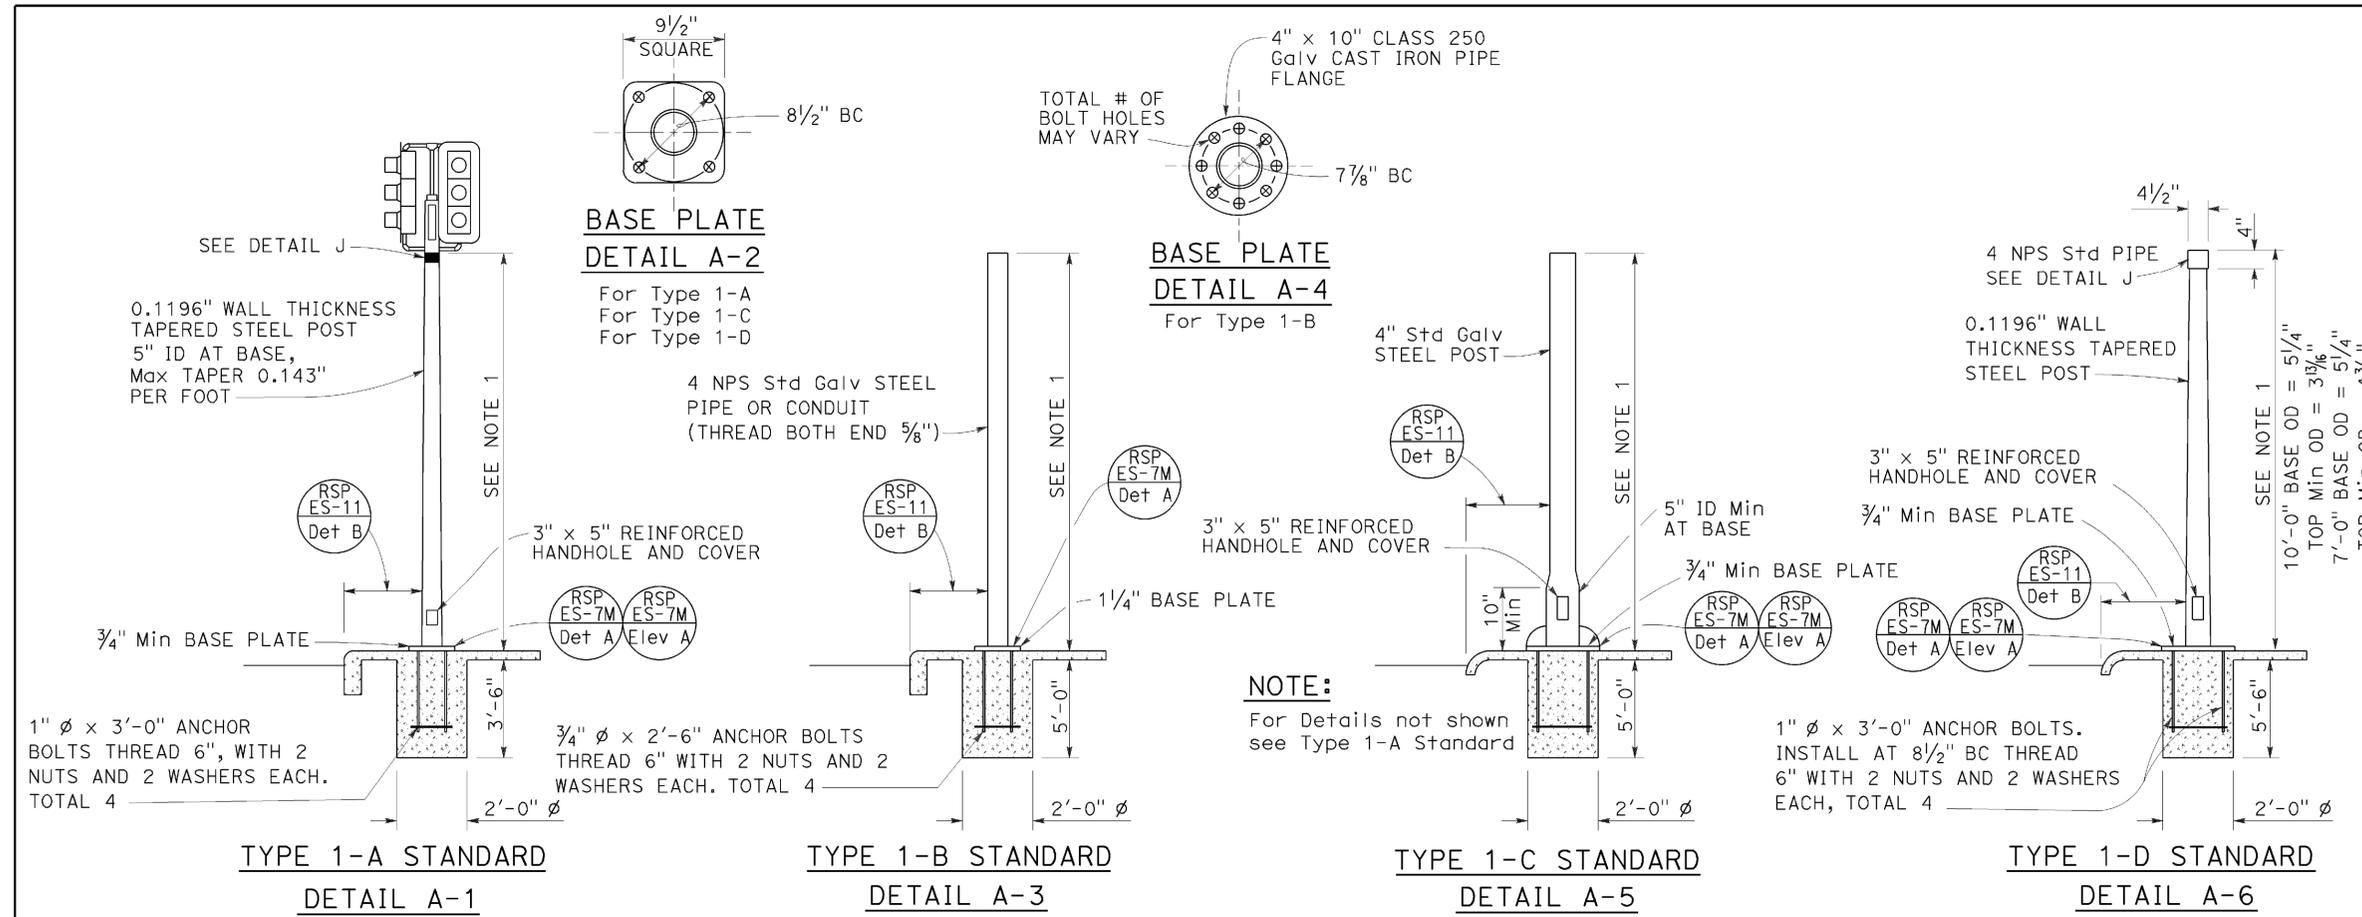


**TYPE 1 SIGNAL STANDARDS
DETAIL A**

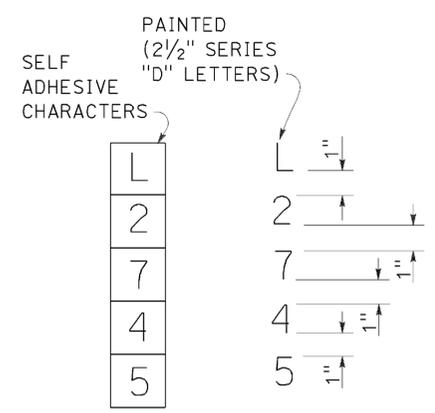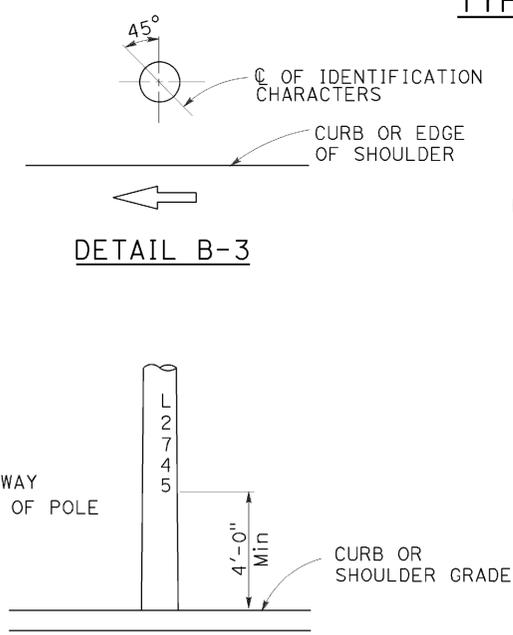


**TYPICAL IDENTIFICATION CHARACTER FORMAT
DETAIL B-2**

**IDENTIFICATION CHARACTER DETAIL
DETAIL B-1**

**LOCATION OF EQUIPMENT IDENTIFICATION CHARACTERS ON STANDARDS AND POSTS
DETAIL B**

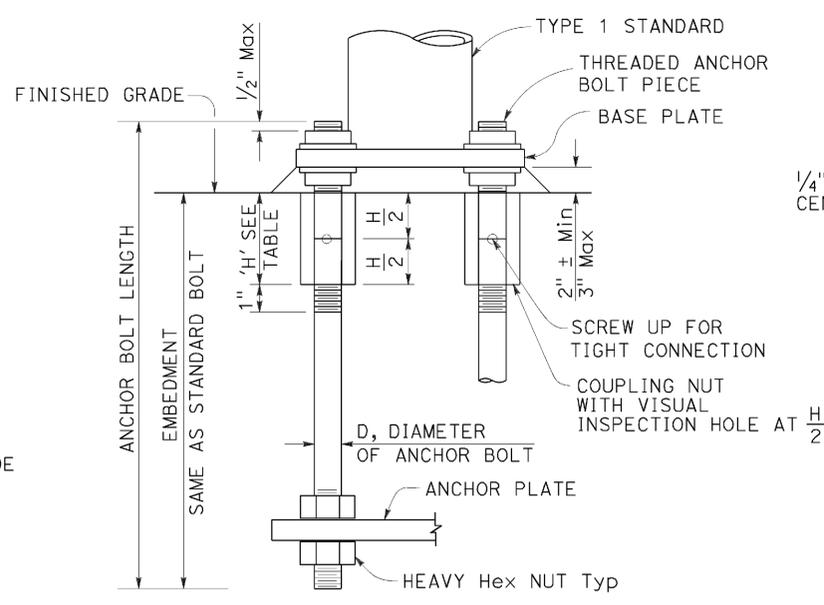

**ANCHOR BOLTS WITH SLEEVE NUTS
DETAIL C
(See Note 8)**

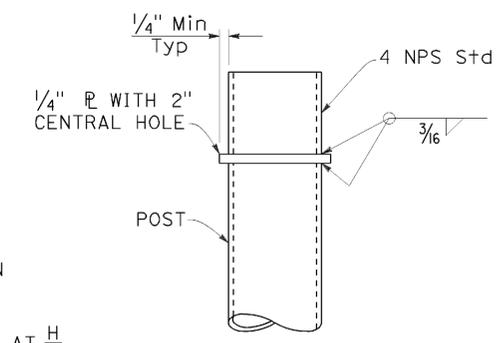

DETAIL J

BOLT DIAMETER	NUT TABLE THICKNESS 'H'
3/4"	2 1/4"
1"	3"

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

**ELECTRICAL SYSTEMS
(SIGNAL AND LIGHTING STANDARD, TYPE 1
AND EQUIPMENT IDENTIFICATION CHARACTERS)**

NO SCALE

RSP ES-7B DATED OCTOBER 30, 2015 SUPERSEDES STANDARD PLAN ES-7B DATED MAY 20, 2011 - PAGE 463 OF THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP ES-7B

2010 REVISED STANDARD PLAN RSP ES-7B

DATE PLOTTED => 19-JAN-2016
TIME PLOTTED => 13:18


Dist	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	Piu	89	20.0/20.6	230	235

Stanley P. Johnson
 REGISTERED CIVIL ENGINEER
 October 30, 2015
 PLANS APPROVAL DATE
 THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.
 Stanley P. Johnson
 REGISTERED PROFESSIONAL ENGINEER
 No. C57793
 Exp. 3-31-16
 CIVIL
 STATE OF CALIFORNIA


TO ACCOMPANY PLANS DATED 01-19-16

NOTES:


1. See Revised Standard Plans RSP ES-4A and RSP ES-4D for attachment fitting details.
2. For wiring diagram, see Standard Plan ES-14B.
3. For additional notes and details, see Revised Standard Plans RSP ES-7M and RSP ES-7N.
4. Handhole shall be located on the downstream side of traffic.
5. See project plans for type of standard to be installed.

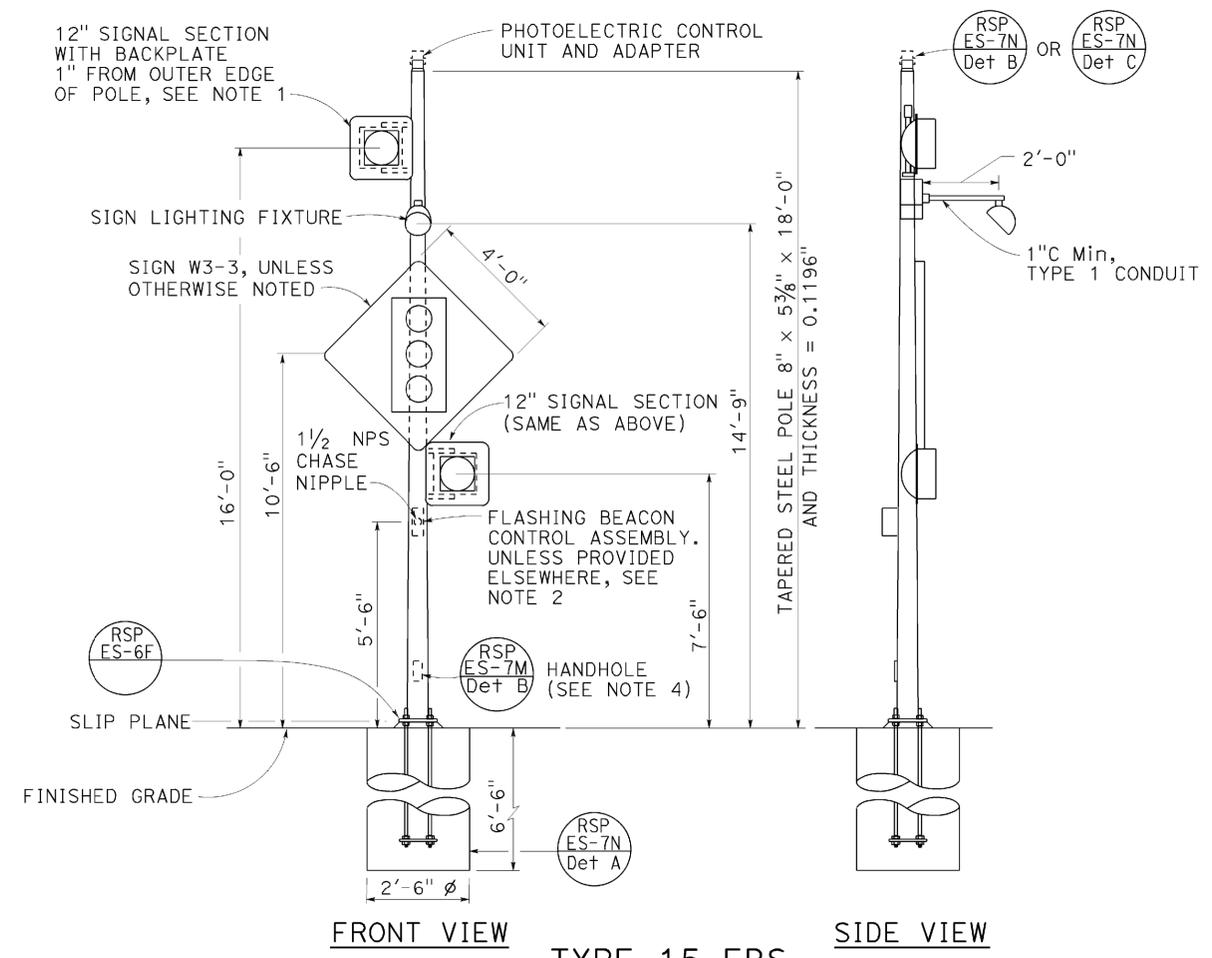


TYPE 15-FBS
ADVANCE FLASHING BEACON WITH SLIP BASE INSTALLATION
DETAIL A

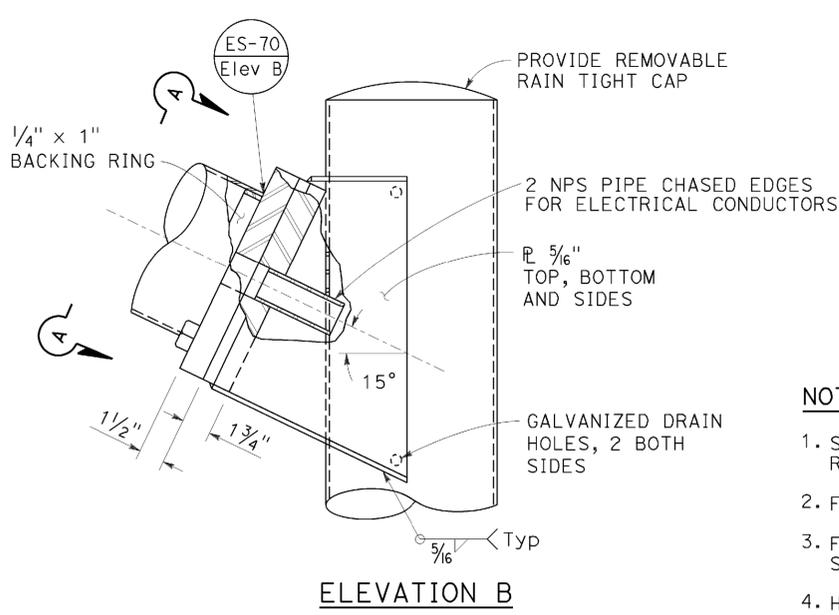


ELEVATION B

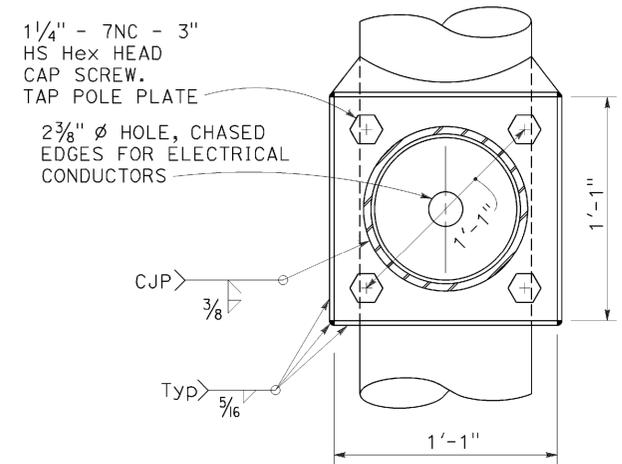


VIEW A-A
FLASHING BEACON MAST ARM
CONNECTION DETAIL
DETAIL B

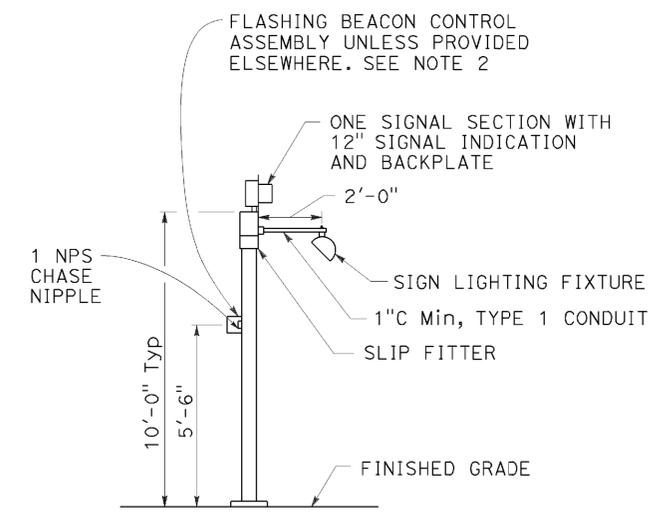

TYPE 1-A, 1-B, 1-C, AND 1-D
ADVANCE FLASHING
BEACON INSTALLATION
DETAIL D
 See Note 5

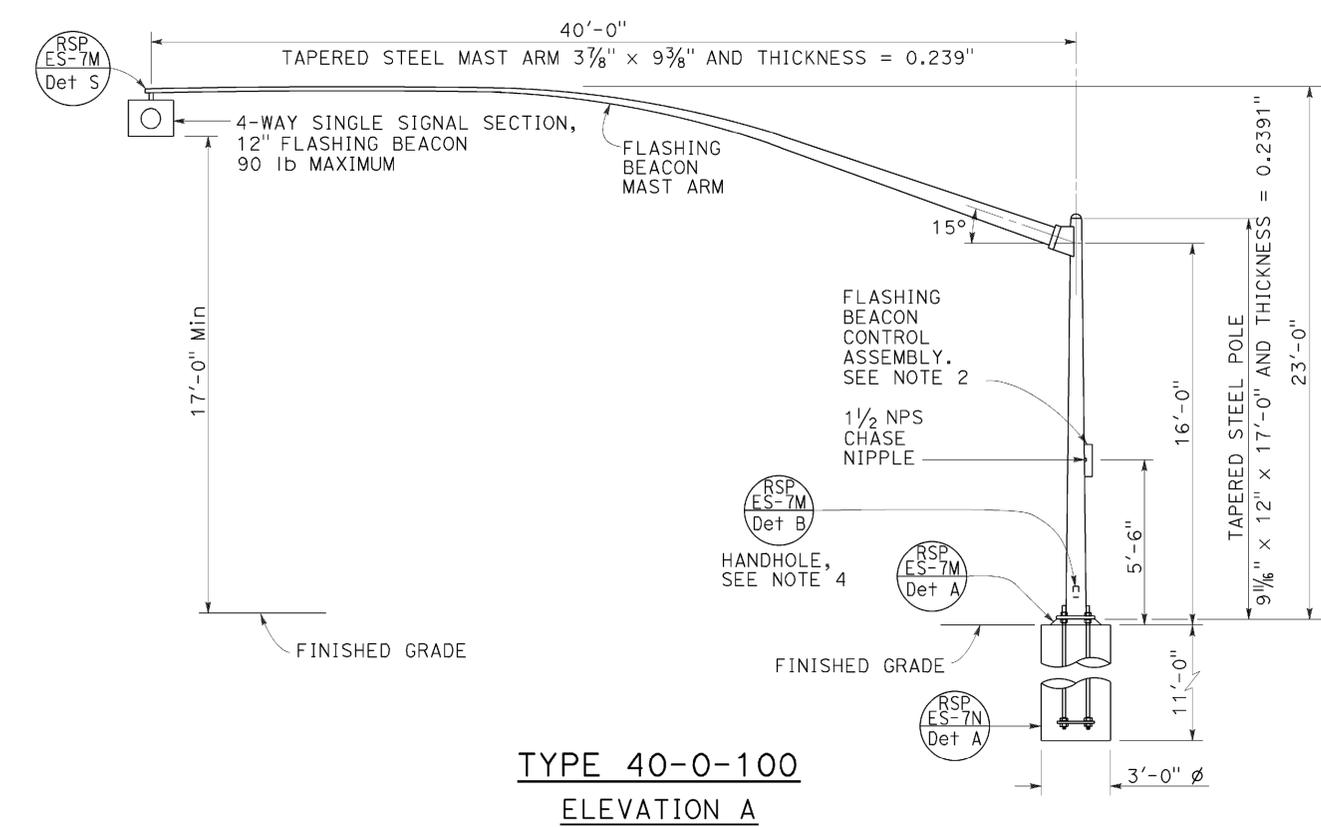

TYPE 40-0-100
ELEVATION A

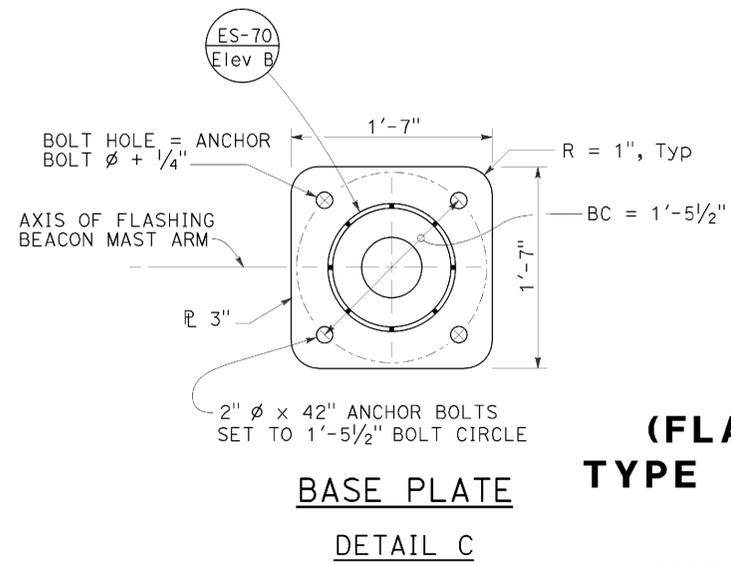

BASE PLATE
DETAIL C

ELECTRICAL SYSTEMS
(FLASHING BEACON ON A TYPE 1, TYPE 15-FBS, AND TYPE 40 STANDARD)
 NO SCALE

RSP ES-7J DATED OCTOBER 30, 2015 SUPERSEDES RSP ES-7J DATED JULY 19, 2013 AND STANDARD PLAN ES-7J DATED MAY 20, 2011 - PAGE 471 OF THE STANDARD PLANS BOOK DATED 2010.


REVISED STANDARD PLAN RSP ES-7J

2010 REVISED STANDARD PLAN RSP ES-7J

4" x 6 1/2" ROUNDED RECTANGLE HANDHOLE REINFORCED WITH RING WELDED TO OUTSIDE OF POLE. SEE NOTE 4, 1/8" COVER PLATE

AFTER PLUMBING STANDARD, PLACE MORTAR ALL AROUND BOLTS. FINISH WITH SLOPE RANGING FROM 45° TO 90° INCLUDES DRAIN HOLES


4 SIDES (ES-6B Det N)

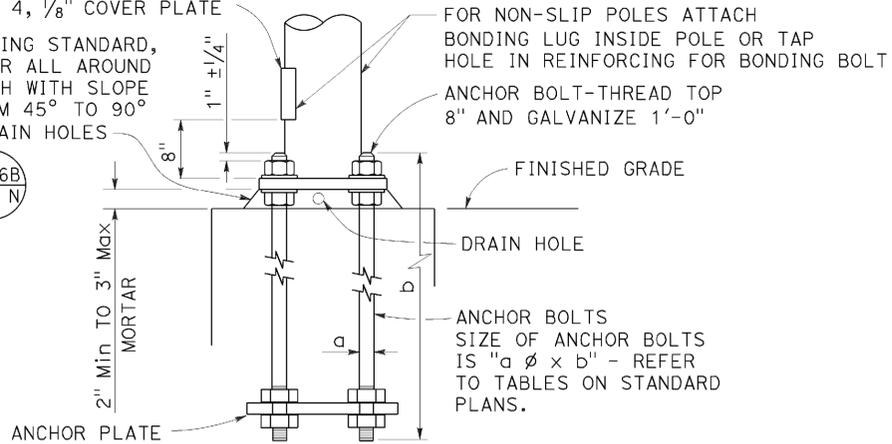

HANDHOLE AND ANCHORAGE
DETAIL A

IDENTIFICATION NUMBER


1. Attach a stamped metal tag with pole's identification number above the handhole. 1/4" high number, minimum.
2. Attach a stamped metal tag with mast arm's identification number to the bottom of the signal mast arm near the pole plate. 1/4" high number, minimum.

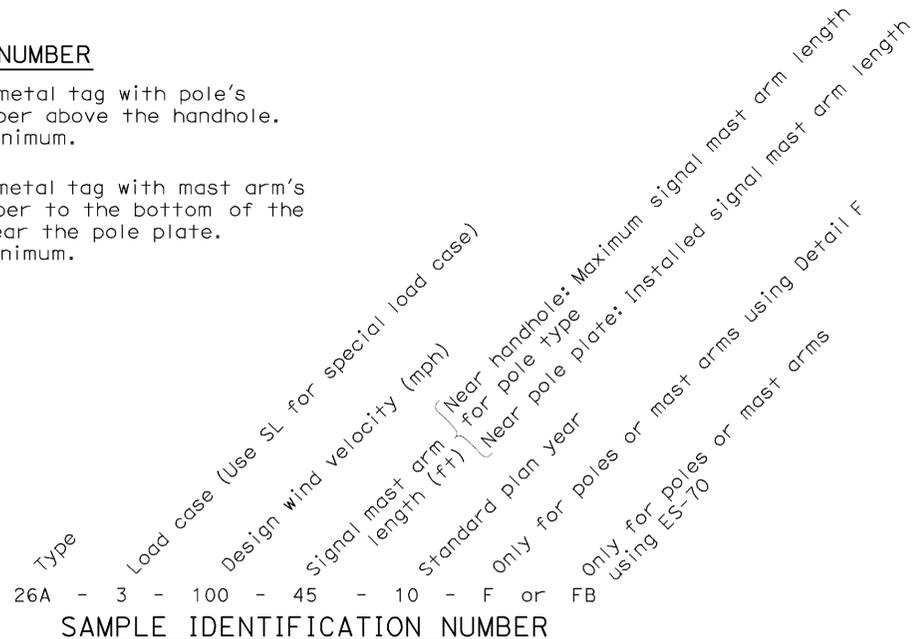


SAMPLE IDENTIFICATION NUMBER

NOTES:


1. Provide a Hex nut, leveling nut and 2 washers for each bolt.
2. Luminaire mast arms shall be round, tapered steel tubes, taper of 0.1375" to 0.143-inch per foot with an end section 2 3/8" OD for mounting hardware. Extensions of 2 NPS Standard pipe and 7" long may be used at the option of the manufacturer. When low pressure sodium luminaires are required, the extension shall be 1'-3".
3. Signal mast arms shall be round, tapered steel tubes, maximum taper 0.143-inch per foot.
4. Handhole reinforcement ring shall be 1/4" x 2" for 0.1196" to 0.2391" thick poles, 3/8" x 2" for 0.3125" thick poles.
5. Handholes shall be located on the downstream side of traffic.
6. Detail F, fatigue resistant weld, is required at socket welded signal mast arm plate and pole base plate.
7. Cap screws shall be tightened by the turn-of-nut method 1/3 turn from a snug tight condition. No washer will be required.
8. Outside diameter, wall thickness, and corresponding section properties of poles and mast arms as shown in the Standard Plans are minimums. Unless otherwise specified, alternative sections shall require approval by the Engineer.
9. Wind Loading (3 seconds gust): 100 mph
10. Unit Stresses (Structural steel):
fy = 55,000 psi (tapered steel tube and anchor bolts)
fy = 50,000 psi (unless otherwise noted)
11. Unit Stresses (Reinforced concrete):
f'c = 3,625 psi
fy = 60,000 psi

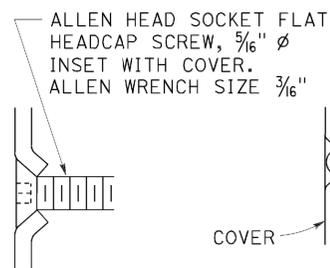


TYPICAL DETAIL
DETAIL B-1

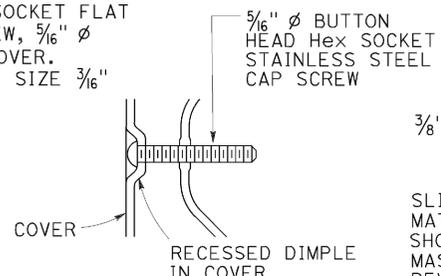

ALTERNATIVE DETAIL
DETAIL B-2

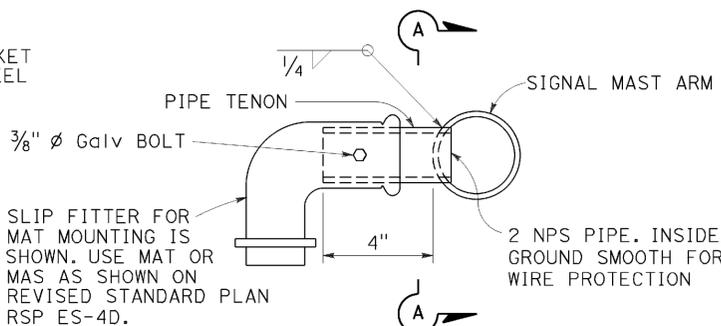

SIDE TENON
DETAIL S-1

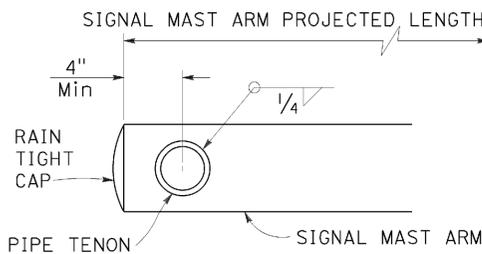


SECTION A-A

PIPE TENONS
DETAIL S


WELD SIZE	WALL THICKNESS
1/8"	0.1196"
3/16"	0.1793"
1/4"	0.2391"

2 NPS PIPE, CHASED FOR WIRE PROTECTION SEE NOTE 2

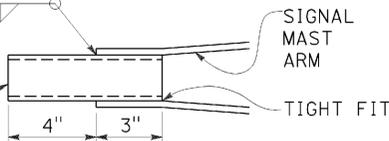


TIP TENON
DETAIL TS


WELD SIZE	WALL THICKNESS
3/16"	0.1196"
1/4"	0.1793"
5/16"	0.2391"
3/8"	0.3125"

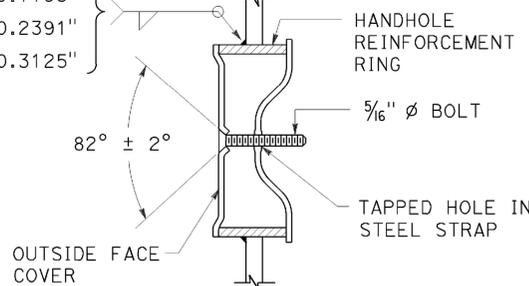


TAMPER RESISTANT HANDHOLE COVER
DETAIL B

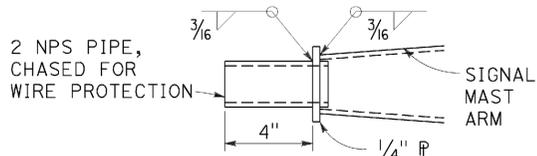

TIP TENON
DETAIL TL
This detail supersedes Detail S when so designated

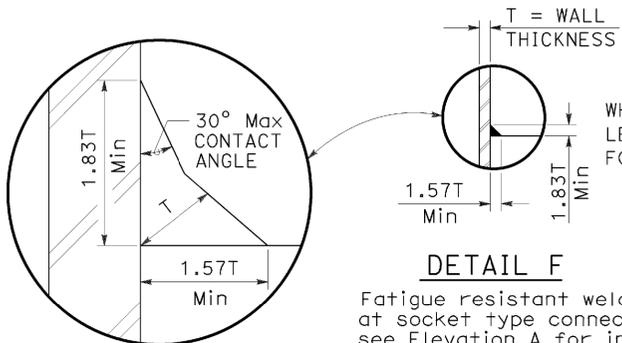

DETAIL F
Fatigue resistant weld at socket type connection see Elevation A for inner weld

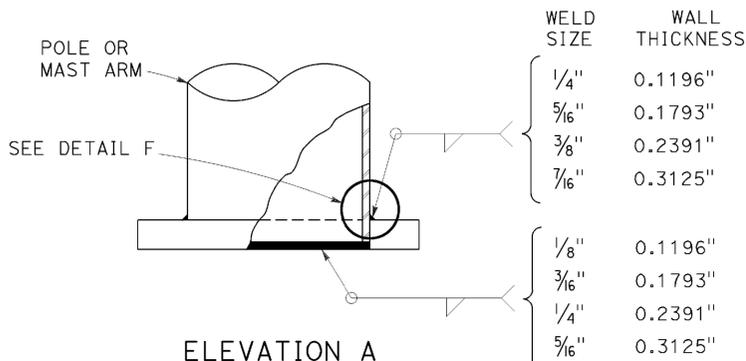

ELEVATION A

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

ELECTRICAL SYSTEMS
(SIGNAL AND LIGHTING STANDARD,
DETAIL No. 1)

NO SCALE

RSP ES-7M DATED OCTOBER 30, 2015 SUPERSEDES STANDARD PLAN ES-7M DATED MAY 20, 2011 - PAGE 474 OF THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP ES-7M


TO ACCOMPANY PLANS DATED 01-19-16

DIST	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	Piu	89	20.0/20.6	231	235


October 30, 2015
PLANS APPROVAL DATE

Stanley P. Johnson
REGISTERED CIVIL ENGINEER
No. C57793
Exp. 3-31-16
CIVIL
STATE OF CALIFORNIA

THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.




TO ACCOMPANY PLANS DATED 01-19-16

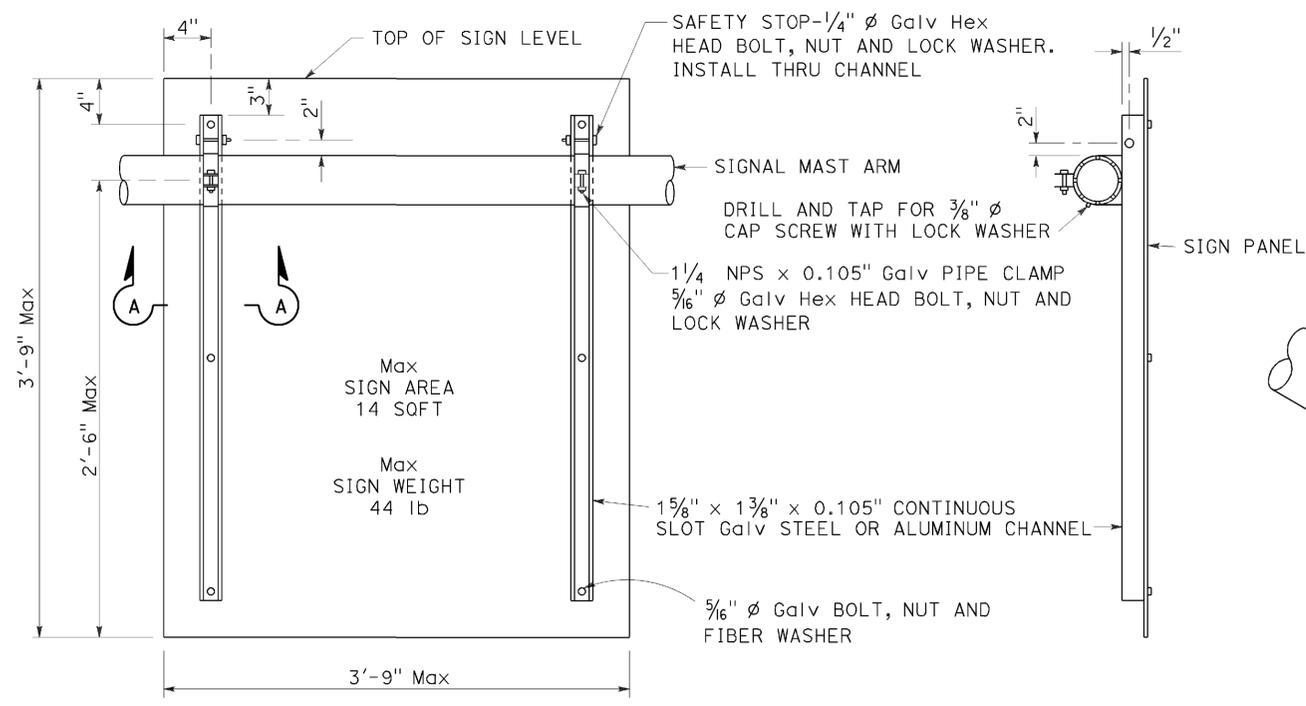

REAR VIEW


SIDE VIEW

SIGN MOUNTING DETAILS
DETAIL U

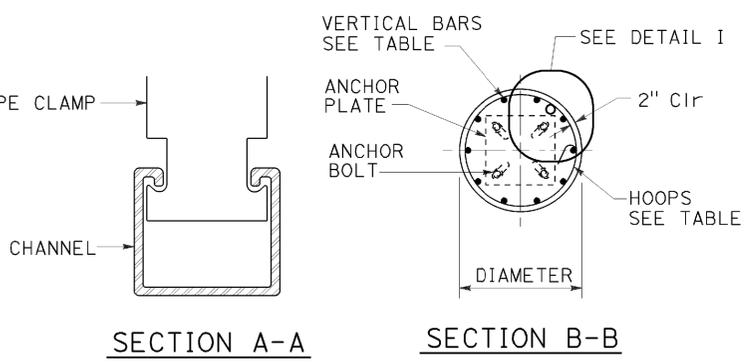


SECTION A-A


SECTION B-B

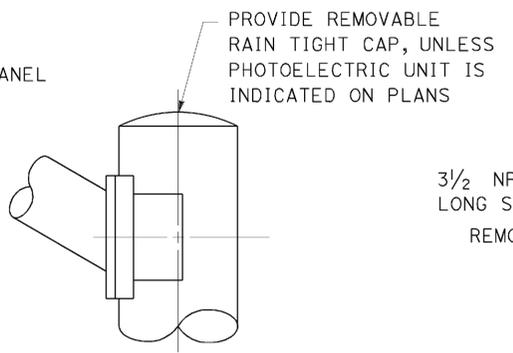

STANDARD TOP
DETAIL B-1

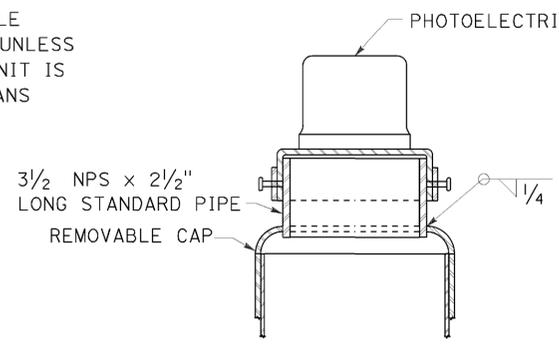


MOUNTING ADAPTER FOR
PHOTOELECTRIC UNIT
DETAIL B-2

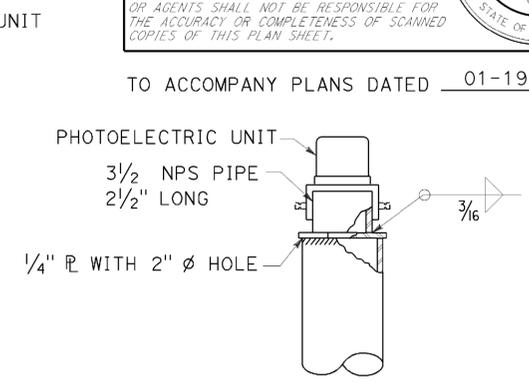

ALTERNATIVE
MOUNTING ADAPTER
DETAIL B-3


POLE TOP DETAILS
DETAIL B

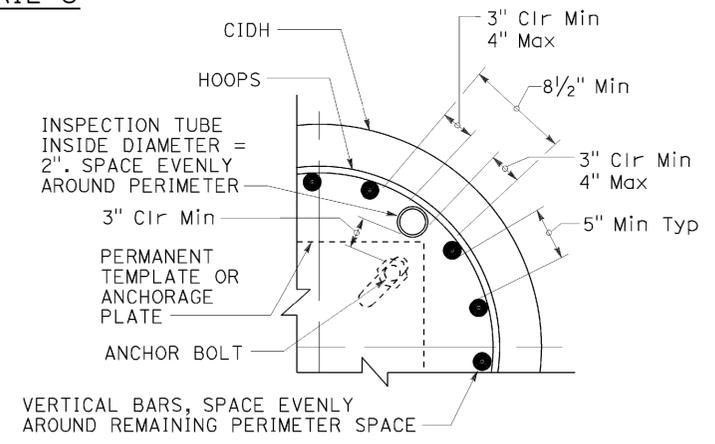


INSPECTION TUBE PLACEMENT
DETAIL I

CIDH DIAMETER	VERTICAL BARS	HOOPS (WELDED)	INSPECTION TUBE
2 ft	8-#5	#4 AT 6	2
2.5 ft	10-#6		4*
3 ft	12-#7	#5 AT 6	4
3.5 ft	14-#8		5
4 ft	18-#9	2-#4 AT 7	6
5 ft	22-#10	2-#5 AT 7	7
6 ft	26-#11	2-#6 AT 7	7

* FOR SLIP BASE VERSIONS WITH 3 ANCHOR BOLTS USE 3 INSPECTION TUBES.

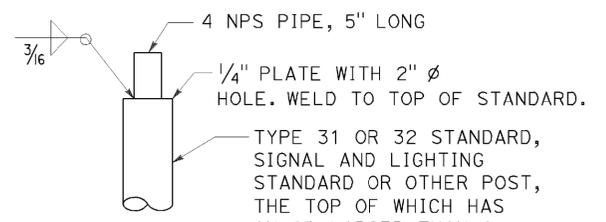

DETAIL C-1

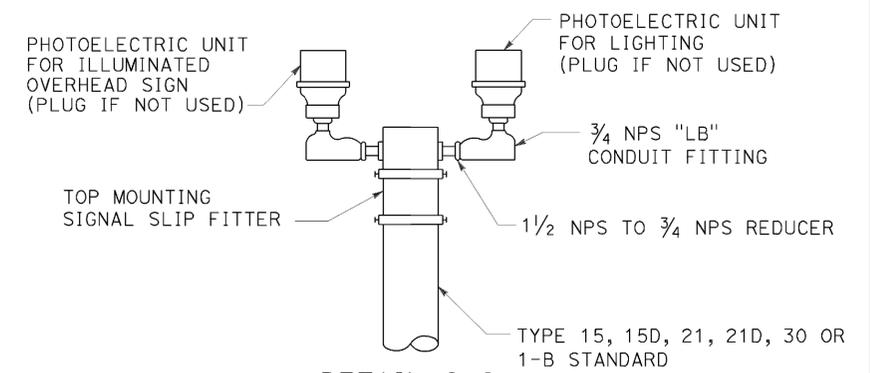


DUAL PHOTOELECTRIC UNIT MOUNTING DETAIL
DETAIL C

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION


ELECTRICAL SYSTEMS
(SIGNAL AND LIGHTING STANDARD,
DETAIL No. 2)
NO SCALE

RSP ES-7N DATED OCTOBER 30, 2015 SUPERSEDES STANDARD PLAN ES-7N DATED MAY 20, 2011 - PAGE 475 OF THE STANDARD PLANS BOOK DATED 2010.


REVISED STANDARD PLAN RSP ES-7N

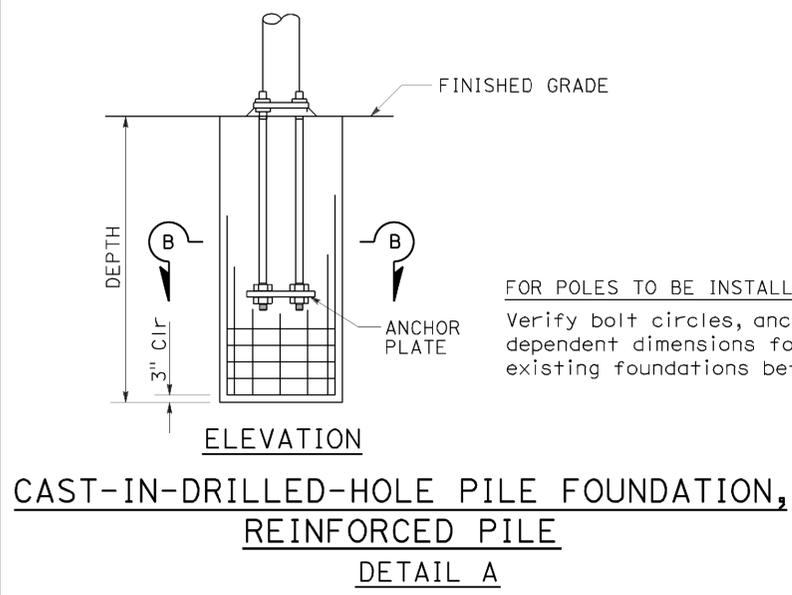

DETAIL A

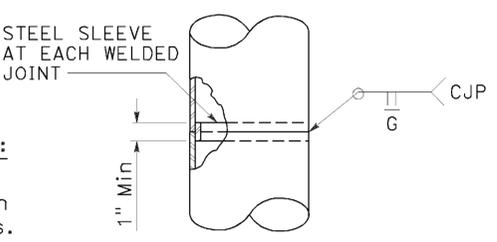

FOR UNIFORM TUBE THICKNESS
DETAIL T-1

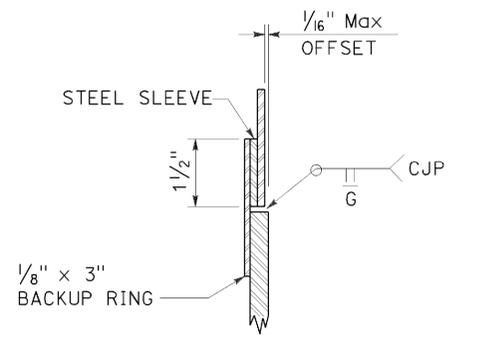

AT TUBE THICKNESS CHANGE
DETAIL T-2


POLE SPLICES
DETAIL T

DIST	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET NO.	TOTAL SHEETS
02	Piu	89	20.0/20.6	233	235


Theresa Gabriel
 REGISTERED ELECTRICAL ENGINEER
 October 30, 2015
 PLANS APPROVAL DATE
 THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

REGISTERED PROFESSIONAL ENGINEER
 Theresa Aziz Gabriel
 No. E15129
 Exp. 6-30-16
 ELECTRICAL
 STATE OF CALIFORNIA


TO ACCOMPANY PLANS DATED 01-19-16

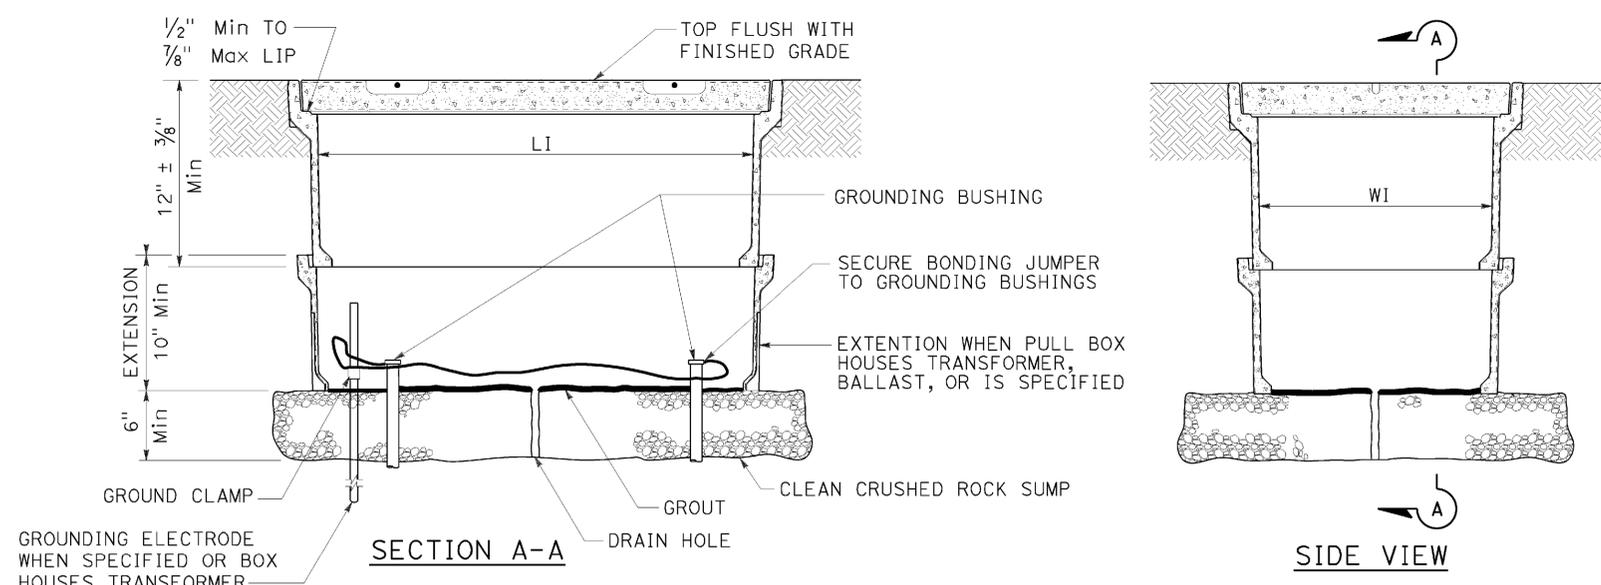


INSTALLATION DETAILS
DETAIL A

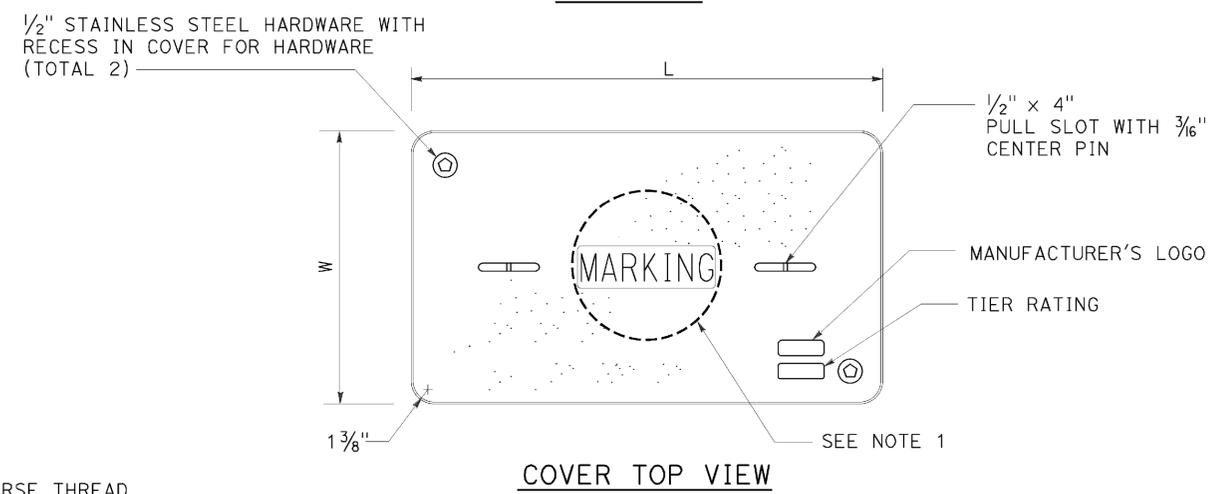

COVER TOP VIEW

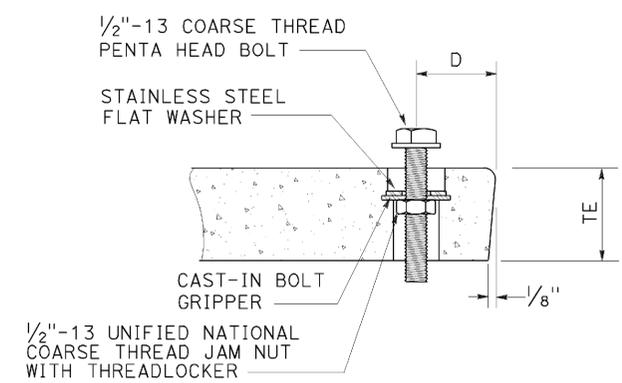

TYPICAL COVER CAPTIVE BOLT
OR SIMILAR

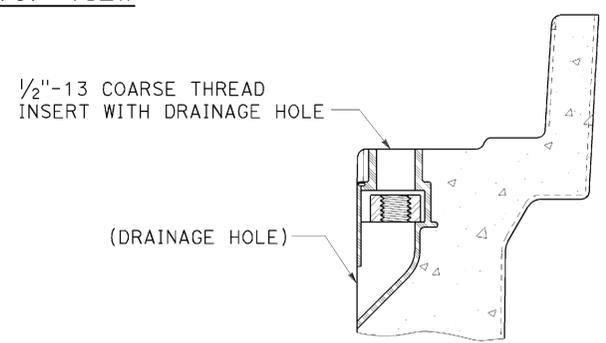

TYPICAL THREADED INSERT
OR SIMILAR

NOTES:

- Pull box covers shall be marked as follows: "SERVICE" Service circuits between service point and service disconnect; "SPRINKLER-CONTROL" sprinkler control circuits, 50 V or less; "CALTRANS" on all pull boxes, except pull boxes marked "SPRINKLER-CONTROL"; and "TELEPHONE" Telephone service;
 - No. 3 1/2 pull box.
 - "SIGNAL" - Traffic signal circuits with or without lighting or sign lighting circuits.
 - "LIGHTING" - Lighting or sign lighting circuits where voltage is under 600 V.
 - No. 5, 6, 9 or 9A pull box.
 - "TRAFFIC SIGNAL" - Traffic signal circuits with or without lighting or sign lighting circuits.
 - "LIGHTING" - Lighting or sign lighting circuits where voltage is under 600 V.
 - "LIGHTING-HIGH VOLTAGE" - Lighting or sign lighting circuits where voltage is above 600 V.
 - "IRRIGATION" - Circuits to irrigation controller 120 V or more.
 - "RAMP METER" - Ramp meter circuits.
 - "COUNT STATION" - Count or speed monitor circuits.
 - "COMMUNICATIONS" - Communication circuits.
 - "TOS COMMUNICATIONS" - TOS communication line.
 - "TOS POWER" - TOS power.
 - "TDC POWER" - Telephone demarcation cabinet power.
 - "CCTV" - Closed circuit television circuits.
 - "TMS" - Traffic monitoring station circuits.
 - "CMS" - Changeable message sign circuits.
 - "HAR" - Highway advisory radio circuits.
 - "BOOSTER PUMP" - Booster pump circuit.
- The nominal dimensions of the opening in which the cover sets shall be the same as the cover dimensions except the length and width dimensions shall be 1/8" greater.
- Covers and boxes shall be interchangeable with California standard male and female gages. When interchanged with a standard male or female gage, the top surfaces shall be flush within 1/8". Top outside radius of covers and pull boxes shall have a 1/8" radius.
- Pull box extension may be another pull box as long as the bottom edge of the pull box can fit into the cover opening.
- Dimensions for the cover for non-traffic pull box are nominal values.

DIMENSION TABLE										
PULL BOX	PULL BOX				COVER					
	MINIMUM DEPTH BOX	MINIMUM DEPTH EXTENSION	MINIMUM WEIGHT	LI Min	WI Min	TE	D	L	W	MINIMUM WEIGHT
No. 3 1/2	12"	N/A	40 lb	1' - 3"	9"	1 3/4"	1 3/4"	1'-3 1/4" - 1'-3 3/8"	10" - 10 1/8"	30 lb
No. 5	12"	10"	55 lb	1' - 8"	11"	2"	1 3/4"	1'-11 1/4"	1'-1 3/4"	60 lb
No. 6	12"	10"	70 lb	2' - 4 1/4"	1' - 3 1/4"	2"	2"	2'-6 1/2"	1'-5 1/2"	85 lb


STATE OF CALIFORNIA
 DEPARTMENT OF TRANSPORTATION
ELECTRICAL SYSTEMS
(NON-TRAFFIC PULL BOX)
 NO SCALE

RSP ES-8A DATED OCTOBER 30, 2015 SUPERSEDES RSP ES-8A DATED JULY 19, 2013 AND RSP ES-8A DATED JANUARY 20, 2012 THAT SUPPLEMENTS THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP ES-8A


2010 REVISED STANDARD PLAN RSP ES-8A

DATE PLOTTED => 19-JAN-2016
TIME PLOTTED => 13:19




TO ACCOMPANY PLANS DATED 01-19-16


STANDARD TYPE	SETBACK (DIMENSION A)
32	30'-0" (Min)
31	20'-0" (Min)
15, 15D, 15-SB, 21, 21D, 30	ARM LENGTH (Min)

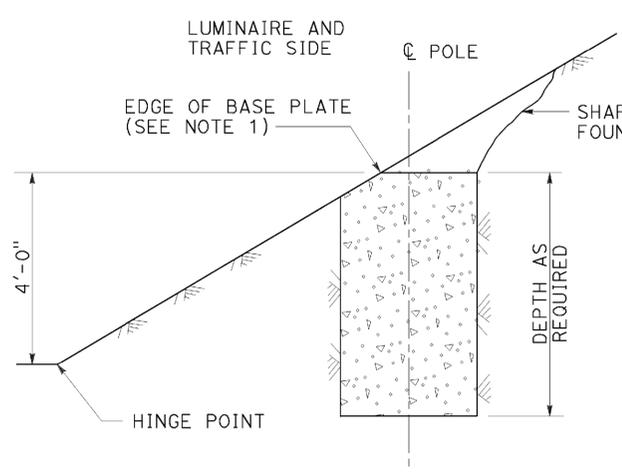

**CUT SLOPES
STEEPER THAN 4:1,
LESS THAN 2:1
DETAIL A-1**
See Note 2 and 3

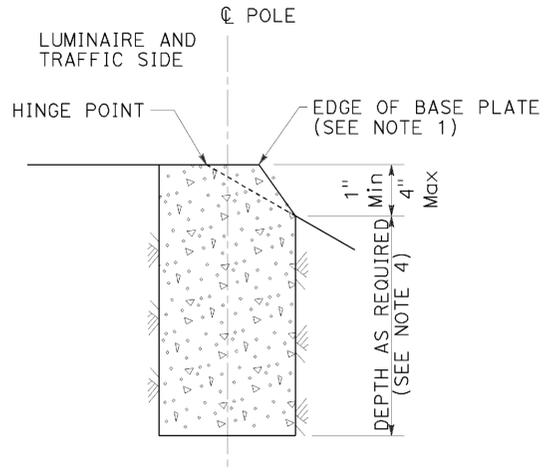

**FILL SLOPES
STEEPER THAN 4:1,
LESS THAN 2:1
DETAIL A-2**
See Note 2 and 3

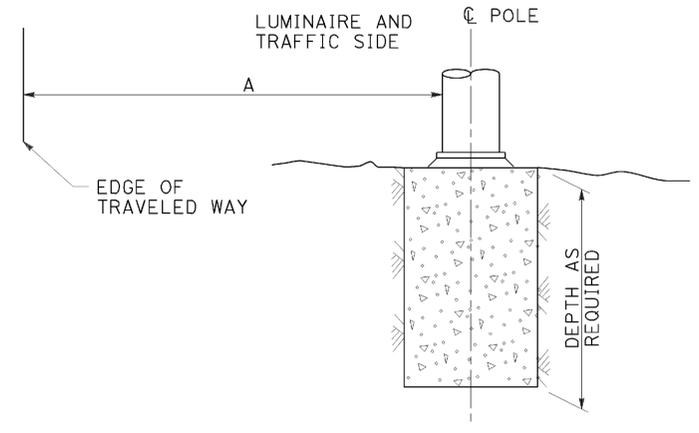


**FLAT SECTIONS, CUT OR FILL SLOPES
4:1 OR FLATTER
DETAIL A-3**
See Note 2


**FOUNDATIONS ADJACENT TO ALL ROADWAYS EXCEPT
IN SIDEWALK, MEDIAN AND ISLAND AREAS
DETAIL A**

NOTES:

1. Where a portion of the foundation is above grade, the top edges shall have a 1" chamfer.
2. Slopes shall be horizontal to vertical ratio (Horizontal : Vertical).
3. Horizontal setbacks on cut and fill slopes steeper than 4:1 shall not exceed the distance shown for flat sections.
4. CIDH embedment depth shall be increased beyond standard depths by the diameter of the CIDH.

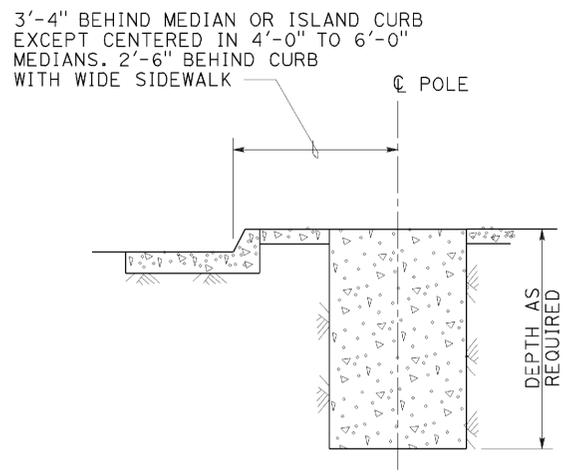

**MEDIAN, ISLAND
OR WIDE SIDEWALK
DETAIL B-1**
7' Wide and wider

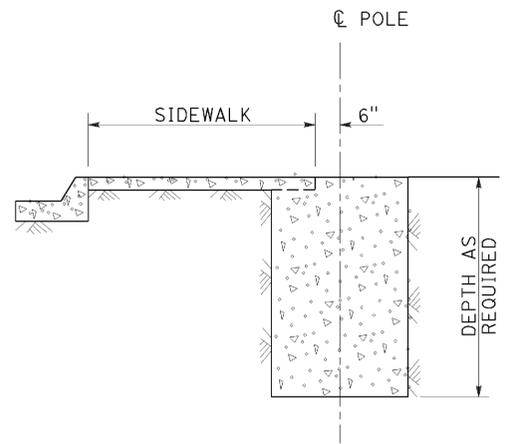

**NARROW SIDEWALK
DETAIL B-2**
Less than 7' wide

**FOUNDATIONS IN SIDEWALK, MEDIAN AND ISLAND AREAS
DETAIL B**

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION
**ELECTRICAL SYSTEMS
(FOUNDATION INSTALLATIONS)**
NO SCALE

RSP ES-11 DATED JULY 19, 2013 SUPERSEDES STANDARD PLAN ES-11
DATED MAY 20, 2011 - PAGE 488 OF THE STANDARD PLANS BOOK DATED 2010.


REVISED STANDARD PLAN RSP ES-11

Dist	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
02	Plu	89	20.0/20.6	235	235

Theresa Gabriel
 REGISTERED ELECTRICAL ENGINEER
 October 30, 2015
 PLANS APPROVAL DATE


THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

TO ACCOMPANY PLANS DATED 01-19-16

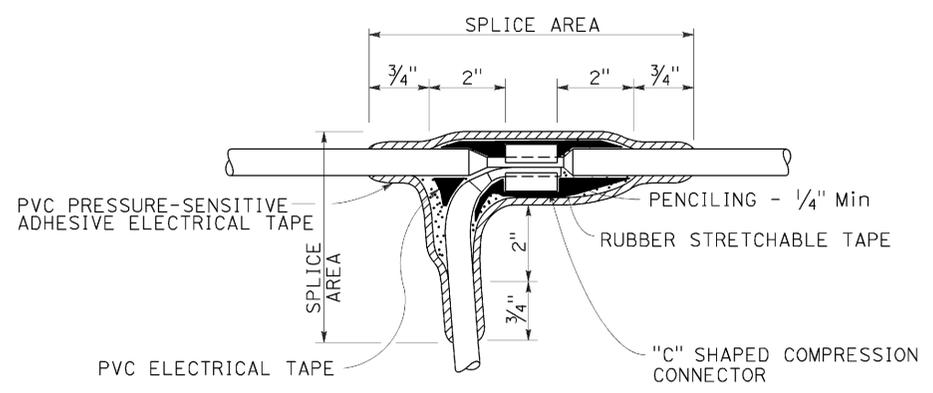

TYPE C SPLICE

See Note 3

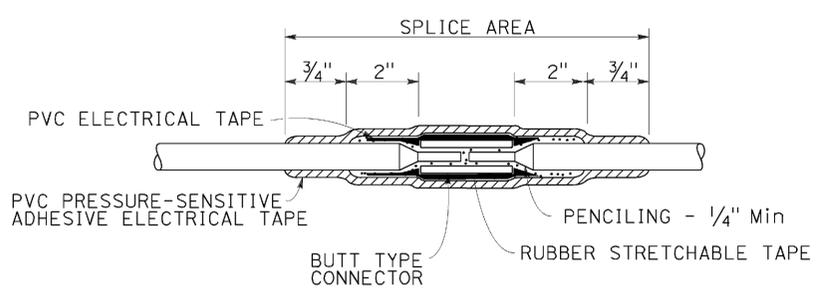


TYPE S SPLICE

See Note 4


NOTES:

1. Dimensions are minimum.
2. Rubber tapes shall be rolled after application.
3. Between 1 free-end and 1 through conductor.
4. Between 2 free-end conductors.
5. Between 3 free-end conductors.

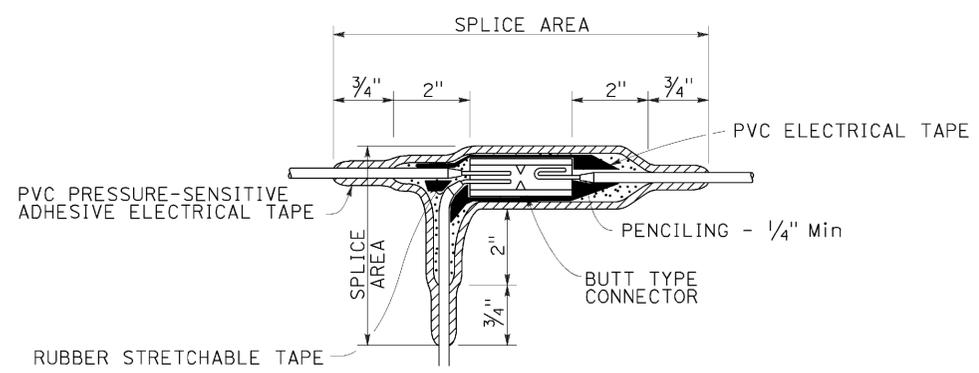

TYPE ST SPLICE

See Note 5

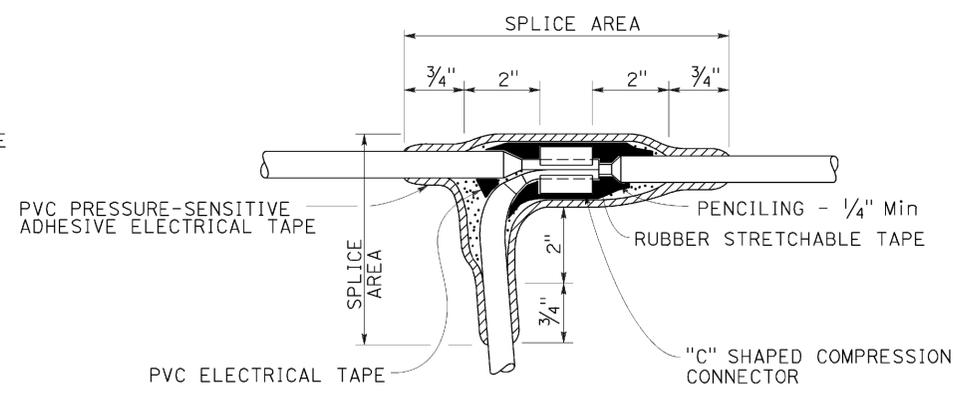

TYPE T SPLICE

See Note 5

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

**ELECTRICAL SYSTEMS
(SPLICING DETAILS)**

NO SCALE

RSP ES-13A DATED OCTOBER 30, 2015 SUPERSEDES STANDARD PLAN ES-13A DATED MAY 20, 2011 - PAGE 491 OF THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP ES-13A

2010 REVISED STANDARD PLAN RSP ES-13A

DATE PLOTTED => 19-JAN-2016
TIME PLOTTED => 13:20