


**** WARNING ** WARNING ** WARNING ** WARNING ****
This document is intended for informational purposes only.

Users are cautioned that Caltrans does not assume any liability or responsibility based on these electronic files or for any defective or incomplete copying, excerpting, scanning, faxing or downloading of the contract documents. As always, for the official paper versions of the bidders and non-bidder packages, write to the California Department of Transportation, Plans and Bid Documents, Room 0200, P.O. Box 942874, Sacramento, CA 94272-0001, telephone (916) 654-4490 or fax (916) 654-7028. Office hours are 7:30 a.m. to 4:15 p.m. When ordering bidder or non-bidder packages it is important that you include a telephone and fax number, P.O. Box and street address so that you can receive addenda.

Note: Addenda information is NOT included with the electronic documents available via electronic file transfer. Only bidder or non-bidder package holders listed with the Caltrans Plans and Bid Documents section as described above will receive addenda information.

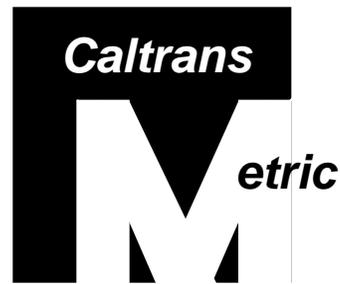

STATE OF CALIFORNIA

DEPARTMENT OF TRANSPORTATION

**NOTICE TO CONTRACTORS
AND
SPECIAL PROVISIONS**

**FOR BUILDING CONSTRUCTION AND HIGHWAY PLANTING
ADJACENT TO STATE HIGHWAY IN**

RIVERSIDE COUNTY NEAR PALM SPRINGS AT THE WHITEWATER SAFETY ROADSIDE REST AREA.

DISTRICT 08, ROUTE 10

**For Use in Connection with Standard Specifications Dated JULY 1999, Standard Plans Dated JULY 1999, and Labor
Surcharge and Equipment Rental Rates.**

CONTRACT NO. 08-456204

08-Riv-10-42.2

Bids Open: July 12, 2001
Dated: June 11, 2001

OSD

IMPORTANT SPECIAL NOTICES

- **Payment Bonds**
Attention is directed to Section 5 of the Special Provisions, regarding contract bonds. The payment bond shall be in a sum not less than one hundred percent of the total amount payable by the terms of the contract.
- Attention is directed to Section 11-2, "Portland Cement Concrete," of these Special Provisions which contains Section 90, "Portland Cement Concrete," of the Standard Specifications.
- Attention is directed to "Miscellaneous Metal," in Section 8-1, "Miscellaneous," of these Special Provisions for new requirements for miscellaneous metal.

TABLE OF CONTENTS

NOTICE TO CONTRACTORS.....	1
COPY OF ENGINEER'S ESTIMATE	3
SPECIAL PROVISIONS	5
SECTION 1. SPECIFICATIONS AND PLANS	5
SECTION 2. PROPOSAL REQUIREMENTS AND CONDITIONS.....	5
2-1.01 GENERAL.....	5
2-1.02 DISABLED VETERAN BUSINESS ENTERPRISE (DVBE).....	5
2-1.03 DVBE GOAL FOR THIS PROJECT.....	6
2-1.04 SUBMISSION OF DVBE INFORMATION	7
2-1.05 SMALL BUSINESS PREFERENCE.....	7
2-1.06 CALIFORNIA COMPANY PREFERENCE.....	8
SECTION 3. AWARD AND EXECUTION OF CONTRACT.....	8
SECTION 4. BEGINNING OF WORK, TIME OF COMPLETION AND LIQUIDATED DAMAGES	9
SECTION 5. GENERAL	9
SECTION 5-1. MISCELLANEOUS	9
5-1.01 PLANS AND WORKING DRAWINGS	9
5-1.011 EXAMINATION OF PLANS, SPECIFICATIONS, CONTRACT, AND SITE OF WORK	9
5-1.012 DIFFERING SITE CONDITIONS.....	10
5-1.015 LABORATORY	10
5-1.017 CONTRACT BONDS	10
5-1.018 EXCAVATION SAFETY PLANS	10
5-1.019 COST REDUCTION INCENTIVE.....	11
5-1.02 LABOR NONDISCRIMINATION	11
5-1.03 INTEREST ON PAYMENTS	11
5-1.031 FINAL PAYMENT AND CLAIMS.....	12
5-1.04 PUBLIC SAFETY	12
5-1.05 SURFACE MINING AND RECLAMATION ACT.....	13
5-1.06 REMOVAL OF ASBESTOS AND HAZARDOUS SUBSTANCES.....	13
5-1.07 YEAR 2000 COMPLIANCE.....	13
5-1.08 SUBCONTRACTOR AND DVBE RECORDS.....	14
5-1.086 PERFORMANCE OF DVBE SUBCONTRACTORS AND SUPPLIERS	14
5-1.09 SUBCONTRACTING.....	14
5-1.10 PROMPT PROGRESS PAYMENT TO SUBCONTRACTORS	15
5-1.11 AREAS FOR CONTRACTOR'S USE.....	15
5-1.12 PAYMENTS.....	15
SECTION 6. (BLANK).....	16
SECTION 7. (BLANK).....	16
SECTION 8. MATERIALS	16
SECTION 8-1. MISCELLANEOUS	16
8-1.01 SUBSTITUTION OF NON-METRIC MATERIALS AND PRODUCTS	16
8-1.02 PREQUALIFIED AND TESTED SIGNING AND DELINEATION MATERIALS	22
8-1.03 SLAG AGGREGATE.....	27
SECTION 8-2. CONCRETE.....	27
8-2.01 PORTLAND CEMENT CONCRETE.....	27
SECTION 8-3. (BLANK)	27
SECTION 9. (BLANK).....	27
SECTION 10. CONSTRUCTION DETAILS.....	27
SECTION 10-1. GENERAL	27
10-1.01 ORDER OF WORK.....	27
10-1.02 WATER POLLUTION CONTROL.....	28
WATER POLLUTION CONTROL PROGRAM PREPARATION, APPROVAL AND UPDATES	29
WPCP IMPLEMENTATION	29
MAINTENANCE	30
PAYMENT	30

10-1.03	PRESERVATION OF PROPERTY	31
10-1.04	RELIEF FROM MAINTENANCE AND RESPONSIBILITY	31
10-1.05	PROGRESS SCHEDULE	31
10-1.06	OBSTRUCTIONS	31
10-1.07	CONSTRUCTION AREA TRAFFIC CONTROL DEVICES	31
10-1.08	CONSTRUCTION AREA SIGNS	32
10-1.09	MAINTAINING TRAFFIC.....	32
10-1.10	TRAFFIC CONTROL SYSTEM FOR LANE CLOSURE.....	33
10-1.11	TRAFFIC CONTROL SYSTEM FOR RAMP CLOSURES.....	33
10-1.12	TEMPORARY CRASH CUSHION MODULE.....	34
10-1.13	EXISTING HIGHWAY FACILITIES	35
	EXISTING HIGHWAY IRRIGATION FACILITIES	35
	REMOVE PAVEMENT MARKING.....	35
	REMOVE ROADSIDE SIGN	35
	REMOVE CONCRETE.....	35
	REMOVE REDWOOD HEADER AND REPAIR SIDEWALK	36
	REMOVE PICNIC TABLES	36
	REMOVE TREE.....	36
10-1.14	ROADSIDE SIGNS.....	36
10-1.15	INSTALL ROADSIDE SIGN PANEL ON EXISTING POST	36
10-1.16	THERMOPLASTIC PAVEMENT MARKING	36
10-1.17	EARTHWORK.....	37
10-1.18	MISCELLANEOUS CONCRETE CONSTRUCTION	37
10-1.19	PREFABRICATED PICNIC TABLES AND BENCHES	38
10-1.20	ROCK BLANKET (TYPE 2).....	38
	MATERIALS.....	38
	MEASUREMENT AND PAYMENT	38
10-1.21	ROCK OUTCROPPINGS	38
10-1.22	IRRIGATION CROSSOVERS	38
SECTION 10-2	HIGHWAY PLANTING AND IRRIGATION SYSTEMS	39
10-2.01	GENERAL.....	39
	PROGRESS INSPECTIONS.....	39
	COST BREAK-DOWN	39
10-2.02	EXISTING HIGHWAY PLANTING	42
	MAINTAIN EXISTING PLANTS.....	42
	REMOVE EXISTING LAWN (SOD) FOR TRENCHING.....	42
10-2.03	EXISTING HIGHWAY IRRIGATION FACILITIES.....	43
	CHECK AND TEST EXISTING IRRIGATION FACILITIES.....	43
	MAINTAIN EXISTING IRRIGATION FACILITIES	43
	REMOVE EXISTING IRRIGATION FACILITIES.....	44
10-2.04	HIGHWAY PLANTING.....	44
	ROADSIDE CLEARING	44
	PESTICIDES	45
	CULTIVATE	46
	PLANTING.....	46
	TURF (SOD).....	46
	PLANT ESTABLISHMENT WORK.....	47
10-2.05	IRRIGATION SYSTEMS	47
	VALVE BOXES.....	47
	ELECTRIC AUTOMATIC IRRIGATION COMPONENTS	48
	IRRIGATION SYSTEMS FUNCTIONAL TEST	48
	PIPE	48
	SPRINKLERS.....	49
	FINAL IRRIGATION SYSTEM CHECK	49
SECTION 11.	MODIFIED STANDARD SPECIFICATION SECTIONS	49
SECTION 11-1.	(BLANK)	49
SECTION 11-2.	PORTLAND CEMENT CONCRETE.....	49
SECTION 12.	BUILDING WORK.....	72
SECTION 12-1.	GENERAL REQUIREMENTS	72

12-1.01	SCOPE	72
12-1.02	ABBREVIATIONS	72
12-1.03	GUARANTEE	73
12-1.04	AREAS FOR CONTRACTOR'S USE	74
12-1.05	COOPERATION	74
12-1.07	PROGRESS SCHEDULE	74
12-1.08	SCHEDULE OF VALUES	74
12-1.09	INSPECTION	75
12-1.10	OBSTRUCTIONS	75
12-1.11	PRESERVATION OF PROPERTY	75
12-1.12	UTILITY CONNECTION	75
12-1.13	TEMPORARY UTILITIES	76
12-1.14	SANITARY FACILITIES	76
12-1.15	REFERENCES	76
12-1.16	MEASUREMENT AND PAYMENT	76
12-1.17	SUBSTITUTION OF NON-METRIC MATERIALS AND PRODUCTS	76
SECTION 12-2.	SITework	87
12-2.01	REMOVING PORTIONS OF EXISTING FACILITIES	87
12-2.02	RELOCATING MATERIALS AND EQUIPMENT	88
12-2.03	EARTHWORK FOR BUILDING WORK	88
12-2.04	AGGREGATE BASE	91
12-2.05	PAINTED PAVEMENT MARKINGS	92
12-2.06	SEPTIC SEWAGE DISPOSAL SYSTEM	93
12-2.07	PARKING BUMPERS	96
12-2.08	ACCESSIBLE PARKING AND AUTHORIZATION SIGNS	96
SECTION 12-3.	CONCRETE AND REINFORCEMENT	97
12-3.01	CAST-IN-PLACE CONCRETE	97
12-3.02	DRILL AND BOND DOWELS	102
SECTION 12-4.	MASONRY	103
12-4.01	CONCRETE MASONRY UNITS	103
SECTION 12-5.	METALS	107
12-5.01	BUILDING MISCELLANEOUS METAL	107
SECTION 12-6.	WOOD AND PLASTICS	109
12-6.01	ROUGH CARPENTRY	109
12-6.02	FINISH CARPENTRY	112
SECTION 12-7.	THERMAL AND MOISTURE PROTECTION	114
12-7.01	WATER REPELLENT COATING	114
12-7.02	RIGID ROOF INSULATION	115
12-7.03	METAL ROOFING	116
12-7.04	SHEET METAL FLASHING	119
12-7.05	SKYLIGHTS	120
12-7.06	SEALANTS AND CAULKING	121
SECTION 12-8.	DOORS AND WINDOWS	122
12-8.01	HINGED DOORS	122
12-8.02	FINISH HARDWARE	123
SECTION 12-9.	FINISHES	126
12-9.01	CERAMIC TILE	126
12-9.02	PAINTING	132
SECTION 12-10.	SPECIALTIES	137
12-10.01	METAL TOILET PARTITION DOORS	137
12-10.02	LOUVERS	138
12-10.03	INFORMATION DISPLAY CASES	138
12-10.04	SIGNS	139
12-10.05	TOILET ROOM ACCESSORIES	140
SECTION 12-11 THRU 12-14.	(BLANK)	141
SECTION 12-15.	MECHANICAL	141
12-15.01	MECHANICAL WORK	141
12-15.02	PIPE, FITTINGS AND VALVES	142
12-15.03	PLUMBING FIXTURES	145

SECTION 12-16. ELECTRICAL	146
12-16.01 ELECTRICAL WORK.....	146
12-16.02 BASIC MATERIALS AND METHODS.....	147
12-16.03 TELEPHONE SERVICE.....	150
12-16.04 ELECTRICAL EQUIPMENT.....	151
12-16.05 LIGHTING	151

STANDARD PLANS LIST

The Standard Plan sheets applicable to this contract include, but are not limited to those indicated below. The Revised Standard Plans (RSP) and New Standard Plans (NSP) which apply to this contract are included as individual sheets of the project plans.

A10A	Abbreviations
A10B	Symbols
A24C	Pavement Markings - Symbols and Numerals
A73C	Delineators, Channelizers and Barricades
A88A	Curb Ramp Details
A88B	Curb Ramp Details
H1	Planting and Irrigation - Abbreviations
H2	Planting and Irrigation - Symbols
H3	Planting and Irrigation Details
H4	Planting and Irrigation Details
H5	Planting and Irrigation Details
H6	Planting and Irrigation Details
H7	Planting and Irrigation Details
H8	Planting and Irrigation Details
T14	Traffic Control System for Ramp Closure
RS2	Roadside Signs - Wood Post, Typical Installation Details No. 2
RS4	Roadside Signs, Typical Installation Details No. 4
ES-13A	Signal, Lighting and Electrical Systems - Splicing Details

DEPARTMENT OF TRANSPORTATION

NOTICE TO CONTRACTORS

CONTRACT NO. 08-456204

08-Riv-10-42.2

Sealed proposals for the work shown on the plans entitled:

STATE OF CALIFORNIA; DEPARTMENT OF TRANSPORTATION; PROJECT PLANS FOR BUILDING CONSTRUCTION AND HIGHWAY PLANTING ADJACENT TO STATE HIGHWAY IN RIVERSIDE COUNTY NEAR PALM SPRINGS AT THE WHITEWATER SAFETY ROADSIDE REST AREA.

will be received at the Department of Transportation, 3347 Michelson Drive, Suite 100, Irvine, CA 92612-1692, until 2 o'clock p.m. on July 12, 2001, at which time they will be publicly opened and read in Room C - 1116 at the same address.

Proposal forms for this work are included in a separate book entitled:

STATE OF CALIFORNIA; DEPARTMENT OF TRANSPORTATION; PROPOSAL AND CONTRACT FOR BUILDING CONSTRUCTION AND HIGHWAY PLANTING ADJACENT TO STATE HIGHWAY IN RIVERSIDE COUNTY NEAR PALM SPRINGS AT THE WHITEWATER SAFETY ROADSIDE REST AREA.

General work description: Building, sidewalk, and the landscape to be remodeled to ADA standards.

This project has a goal of 3 percent disabled veteran business enterprise (DVBE) participation.

No prebid meeting is scheduled for this project.

Bids are required for the entire work described herein.

At the time this contract is awarded, the Contractor shall possess either a Class A license or Class B license or a combination of Class C licenses which constitutes a majority of the work.

The Contractor must also be properly licensed at the time the bid is submitted, except that on a joint venture bid a joint venture license may be obtained by a combination of licenses after bid opening but before award in conformance with Business and Professions Code, Section 7029.1.

This contract is subject to state contract nondiscrimination and compliance requirements pursuant to Government Code, Section 12990.

Preference will be granted to bidders properly certified as a "Small Business" as determined by the Department of General Services, Office of Small Business Certification and Resources at the time of bid opening in conformance with the provisions in Section 2-1.05, "Small Business Preference," of the special provisions, and Section 1896 et seq, Title 2, California Code of Regulations. A form for requesting a "Small Business" preference is included with the bid documents. Applications for status as a "Small Business" must be submitted to the Department of General Services, Office of Small Business Certification and Resources, 1531 "I" Street, Second Floor, Sacramento, CA 95814, Telephone No. (916) 322-5060.

A reciprocal preference will be granted to "California company" bidders in conformance with Section 6107 of the Public Contract Code. (See Sections 2 and 3 of the special provisions.) A form for indicating whether bidders are or are not a "California company" is included in the bid documents and is to be filled in and signed by all bidders.

Project plans, special provisions, and proposal forms for bidding this project can only be obtained at the Department of Transportation, Plans and Bid Documents, Room 0200, MS #26, Transportation Building, 1120 N Street, Sacramento, California 95814, FAX No. (916) 654-7028, Telephone No. (916) 654-4490. Use FAX orders to expedite orders for project

plans, special provisions and proposal forms. FAX orders must include credit card charge number, card expiration date and authorizing signature. Project plans, special provisions, and proposal forms may be seen at the above Department of Transportation office and at the offices of the District Directors of Transportation at Irvine, Oakland, and the district in which the work is situated. Standard Specifications and Standard Plans are available through the State of California, Department of Transportation, Publications Unit, 1900 Royal Oaks Drive, Sacramento, CA 95815, Telephone No. (916) 445-3520.

Cross sections for this project are not available.

The successful bidder shall furnish a payment bond and a performance bond.

Pursuant to Section 1773 of the Labor Code, the general prevailing wage rates in the county, or counties, in which the work is to be done have been determined by the Director of the California Department of Industrial Relations. These wages are set forth in the General Prevailing Wage Rates for this project, available at the Labor Compliance Office at the offices of the District Director of Transportation for the district in which the work is situated, and available from the California Department of Industrial Relations' Internet Web Site at: <http://www.dir.ca.gov>. Future effective general prevailing wage rates which have been predetermined and are on file with the Department of Industrial Relations are referenced but not printed in the general prevailing wage rates.

DEPARTMENT OF TRANSPORTATION

Deputy Director Transportation Engineering

Dated June 11, 2001

JT

**COPY OF ENGINEER'S ESTIMATE
(NOT TO BE USED FOR BIDDING PURPOSES)**

08-

Item	Item Code	Item	Unit of Measure	Estimated Quantity
1 (S)	120090	CONSTRUCTION AREA SIGNS	LS	LUMP SUM
2 (S)	120100	TRAFFIC CONTROL SYSTEM	LS	LUMP SUM
3	150713	REMOVE PAVEMENT MARKING	M2	9
4	150742	REMOVE ROADSIDE SIGN	EA	4
5	153210	REMOVE CONCRETE	M3	380
6	160120	REMOVE TREE	EA	4
7 (S)	200001	HIGHWAY PLANTING	LS	LUMP SUM
8 (S)	021564	ROCK BLANKET (TYPE 2)	M2	47
9 (S)	021565	ROCK OUTCROPPINGS	EA	3
10 (S)	204098	MAINTAIN EXISTING PLANTS	LS	LUMP SUM
11 (S)	204099	PLANT ESTABLISHMENT WORK	LS	LUMP SUM
12 (S)	206401	MAINTAIN EXISTING IRRIGATION FACILITIES	LS	LUMP SUM
13 (S)	208000	IRRIGATION SYSTEM	LS	LUMP SUM
14 (S)	208731	200 MM CORRUGATED HIGH DENSITY POLYETHYLENE PIPE CONDUIT	M	48
15 (S)	562007	ROADSIDE SIGN (METAL POST)	EA	4
16 (S)	568017	INSTALL ROADSIDE SIGN PANEL ON EXISTING POST	EA	3
17	021566	MINOR CONCRETE (MOW STRIP)	M	22
18	731512	MINOR CONCRETE (EXPOSED AGGREGATE SIDEWALK)	M3	150
19	731521	MINOR CONCRETE (SIDEWALK)	M3	250
20	840515	THERMOPLASTIC PAVEMENT MARKING	M2	110

Item	Item Code	Item	Unit of Measure	Estimated Quantity
21	021567	PREFABRICATED PICNIC TABLES AND BENCHES	EA	7
22	994650	BUILDING WORK	LS	LUMP SUM

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISIONS

Annexed to Contract No. 08-456204

SECTION 1. SPECIFICATIONS AND PLANS

The work embraced herein shall conform to the provisions in the Standard Specifications dated July 1999, and the Standard Plans dated July 1999, of the Department of Transportation insofar as the same may apply, and these special provisions.

Amendments to the Standard Specifications set forth in these special provisions shall be considered as part of the Standard Specifications for the purposes set forth in Section 5-1.04, "Coordination and Interpretation of Plans, Standard Specifications and Special Provisions," of the Standard Specifications. Whenever either the term "Standard Specifications is amended" or the term "Standard Specifications are amended" is used in the special provisions, the indented text or table following the term shall be considered an amendment to the Standard Specifications. In case of conflict between such amendments and the Standard Specifications, the amendments shall take precedence over and be used in lieu of the conflicting portions.

In case of conflict between the Standard Specifications and these special provisions, the special provisions shall take precedence over and shall be used in lieu of the conflicting portions.

SECTION 2. PROPOSAL REQUIREMENTS AND CONDITIONS

2-1.01 GENERAL

The bidder's attention is directed to the provisions in Section 2, "Proposal Requirements and Conditions," of the Standard Specifications and these special provisions for the requirements and conditions which the bidder must observe in the preparation of the proposal form and the submission of the bid.

In addition to the subcontractors required to be listed in conformance with Section 2-1.054, "Required Listing of Proposed Subcontractors," of the Standard Specifications, each proposal shall have listed therein the name and address of each DVBE subcontractor to be used for credit in meeting the goal, and to whom the bidder proposes to directly subcontract portions of the work. The list of subcontractors shall also set forth the portion of work that will be performed by each subcontractor listed. A sheet for listing the subcontractors is included in the Proposal.

The Bidder's Bond form mentioned in the last paragraph in Section 2-1.07, "Proposal Guaranty," of the Standard Specifications will be found following the signature page of the Proposal.

In conformance with Public Contract Code Section 7106, a Noncollusion Affidavit is included in the Proposal. Signing the Proposal shall also constitute signature of the Noncollusion Affidavit.

Submit request for substitution of an "or equal" item, and the data substantiating the request to the Department of Transportation, District 8 Construction, MS 1104, 464 West 4th Street, 6th Floor, San Bernardino, Ca 92401-1400, so that the request is received by the Department by close of business on the fourth day, not including Saturdays, Sundays and legal holidays, following bid opening.

2-1.02 DISABLED VETERAN BUSINESS ENTERPRISE (DVBE)

Section 10115 of the Public Contract Code requires the Department to implement provisions to establish a goal for Disabled Veterans Business Enterprise (DVBE) in contracts.

It is the policy of the Department that Disabled Veteran Business Enterprise (DVBE) shall have the maximum opportunity to participate in the performance of contracts financed solely with state funds. The Contractor shall ensure that DVBEs have the maximum opportunity to participate in the performance of this contract and shall take all necessary and reasonable steps for this assurance. The Contractor shall not discriminate on the basis of race, color, national origin, or sex in the award and performance of subcontracts. Failure to carry out the requirements of this paragraph shall constitute a breach of contract and may result in termination of this contract or other remedy the Department may deem appropriate.

Bidder's attention is directed to the following:

Contract No. 04-209804

- A. "Disabled Veteran Business Enterprise" (DVBE) means a business concern certified as a DVBE by the Office of Small Business Certification and Resources, Department of General Services.
- B. A DVBE may participate as a prime contractor, subcontractor, joint venture partner with a prime or subcontractor, or vendor of material or supplies.
- C. Credit for DVBE prime contractors will be 100 percent.
- D. A DVBE joint venture partner must be responsible for specific contract items of work, or portions thereof. Responsibility means actually performing, managing and supervising the work with its own forces. The DVBE joint venture partner must share in the ownership, control, management responsibilities, risks and profits of the joint venture. The DVBE joint venturer must submit the joint venture agreement with the Caltrans Bidder DVBE Information form required in Section 2-1.04, "Submission of DVBE Information," elsewhere in these special provisions.
- E. A DVBE must perform a commercially useful function, i.e., must be responsible for the execution of a distinct element of the work and must carry out its responsibility by actually performing, managing and supervising the work.
- F. Credit for DVBE vendors of materials or supplies is limited to 60 percent of the amount to be paid to the vendor for the material unless the vendor manufactures or substantially alters the goods.
- G. Credit for trucking by DVBEs will be as follows:
 - 1. One hundred percent of the amount to be paid when a DVBE trucker will perform the trucking with his/her own trucks, tractors and employees.
 - 2. Twenty percent of the amount to be paid to DVBE trucking brokers who do not have a "certified roster."
 - 3. One hundred percent of the amount to be paid to DVBE trucking brokers who have signed agreements that all trucking will be performed by DVBE truckers if credit is toward the DVBE goal, a "certified roster" showing that all trucks are owned by DVBEs, and a signed statement on the "certified roster" that indicates that 100 percent of revenue paid by the broker will be paid to the DVBEs listed on the "certified roster."
 - 4. Twenty percent of the amount to be paid to trucking brokers who are not a DVBE but who have signed agreements with DVBE truckers assuring that at least 20 percent of the trucking will be performed by DVBE truckers if credit is toward the DVBE goal, a "certified roster" showing that at least 20 percent of the number of trucks are owned by DVBE truckers, and a signed statement on the "certified roster" that indicates that at least 20 percent of the revenue paid by the broker will be paid to the DVBEs listed on the "certified roster."

The "certified roster" referred to herein shall conform to the requirements in Section 2-1.04, "Submission Of DVBE Information," elsewhere in these special provisions.

- H. DVBEs and DVBE joint venture partners must be certified DVBEs as determined by the Department of General Services, Office of Small Business Certification and Resources, 1531 "I" Street, Second Floor, Sacramento, CA 95814, on the date bids for the project are opened before credit may be allowed toward the DVBE goal. It is the Contractor's responsibility to verify that DVBEs are certified.
- I. Noncompliance by the Contractor with these requirements constitutes a breach of this contract and may result in termination of the contract or other appropriate remedy for a breach of this contract.

2-1.03 DVBE GOAL FOR THIS PROJECT

The Department has established the following goal for Disabled Veteran Business Enterprise (DVBE) participation for this project:

Disabled Veteran Business Enterprise (DVBE): 3 percent.

It is the bidder's responsibility to make a sufficient portion of the work available to subcontractors and suppliers and to select those portions of the work or material needs consistent with the available DVBE subcontractors and suppliers, so as to assure meeting the goal for DVBE participation.

The Office of Small Business Certification and Resources, Department of General Services, may be contacted at (916) 322-5060 or visit their internet web site at <http://www.osmb.dgs.ca.gov/> for program information and certification status. The Department's Business Enterprise Program may also be contacted at (916) 227-9599 or the internet web site at <http://www.dot.ca.gov/hq/bep/>.

2-1.04 SUBMISSION OF DVBE INFORMATION

The required DVBE information shall be submitted on the "CALTRANS BIDDER - DVBE INFORMATION" form included in the Proposal. If this information is not submitted with the bid, the DVBE information forms shall be removed from the documents prior to submitting the bid.

It is the bidder's responsibility to make enough work available to DVBEs and to select those portions of the work or material needs consistent with the available DVBEs to meet the goal for DVBE participation or to provide information to establish that, prior to bidding, the bidder made adequate good faith efforts to do so.

If the DVBE information is not submitted with the bid, the apparent successful bidder (low bidder), the second low bidder and the third low bidder shall submit the DVBE information to the Department of Transportation, 1120 N Street, Room 0200, MS #26, Sacramento, California 95814 so the information is received by the Department no later than 4:00 p.m. on the fourth day, not including Saturdays, Sundays and legal holidays, following bid opening. DVBE information sent by U.S. Postal Service certified mail with return receipt and certificate of mailing and mailed on or before the third day, not including Saturdays, Sundays and legal holidays, following bid opening will be accepted even if it is received after the fourth day following bid opening. Failure to submit the required DVBE information by the time specified will be grounds for finding the bid or proposal nonresponsive. Other bidders need not submit DVBE information unless requested to do so by the Department.

The bidder's DVBE information shall establish that good faith efforts to meet the DVBE goal have been made. To establish good faith efforts, the bidder shall demonstrate that the goal will be met or that, prior to bidding, adequate good faith efforts to meet the goal were made.

Bidders are cautioned that even though their submittal indicates they will meet the stated DVBE goal, their submittal should also include their adequate good faith efforts information along with their DVBE goal information to protect their eligibility for award of the contract in the event the Department, in its review, finds that the goal has not been met.

The bidder's DVBE information shall include the names of DVBE firms that will participate, with a complete description of work or supplies to be provided by each, the dollar value of each DVBE transaction, and a written confirmation from the DVBE that it is participating in the contract. A copy of the DVBE's quote will serve as written confirmation that the DVBE is participating in the contract. When 100 percent of a contract item of work is not to be performed or furnished by a DVBE, a description of the exact portion of that work to be performed or furnished by that DVBE shall be included in the DVBE information, including the planned location of that work. The work that a DVBE prime contractor has committed to performing with its own forces as well as the work that it has committed to be performed by DVBE subcontractors, suppliers and trucking companies will count toward the goal.

If credit for trucking by a DVBE trucking broker is shown on the bidder's information as 100 percent of the revenue to be paid by the broker is to be paid to DVBE truckers, a "certified roster" of the broker's trucks to be used must be included. The "certified roster" must indicate that all the trucks are owned by certified DVBEs and must show the DVBE truck numbers, owner's name, Public Utilities Commission Cal-T numbers, and the DVBE certification numbers. The roster must indicate that all revenue paid by the broker will be paid to DVBEs listed on the "certified roster".

If credit for trucking by a trucking broker who is not a DVBE is shown in the bidder's information, a "certified roster" of the broker's trucks to be used must be included. The "certified roster" must indicate that at least 20 percent of the broker's trucks are owned by certified DVBEs and must show the DVBE truck numbers, owner's name, Public Utilities Commission Cal-T numbers, and the DVBE certification number. The roster must indicate that at least 20 percent of the revenue paid by the broker will be paid to DVBEs listed on the "certified roster".

A bidder shall be deemed to have made good faith efforts upon submittal, within time limits specified by the Department, of documentary evidence that all of the following actions were taken:

- A. Contact was made with the Office of Small Business Certification and Resources (OSBCR), Department of General Services or their web site at <http://www.osmb.dgs.ca.gov/> to identify Disabled Veteran Business Enterprises.
- B. Advertising was published in trade media and media focusing on Disabled Veteran Business Enterprises, unless time limits imposed by the Department do not permit that advertising.
- C. Invitations to bid were submitted to potential Disabled Veteran Business Enterprise contractors.
- D. Available Disabled Veteran Business Enterprises were considered.

2-1.05 SMALL BUSINESS PREFERENCE

Attention is directed to "Award and Execution of Contract" of these special provisions.

Attention is also directed to the Small Business Procurement and Contract Act, Government Code Section 14835, et seq and Title 2, California Code of Regulations, Section 1896, et seq.

Bidders who wish to be classified as a Small Business under the provisions of those laws and regulations, shall be certified as Small Business by the Department of General Services, Office of Small Business Certification and Resources, 1531 "I" Street, Second Floor, Sacramento, CA 95814.

To request Small Business Preference, bidders shall fill out and sign the Request for Small Business Preference form in the Proposal and shall attach a copy of their Office of Small Business Certification and Resources (OSBCR) small business certification letter to the form. The bidder's signature on the Request for Small Business Preference certifies, under penalty of perjury, that the bidder is certified as Small Business at the time of bid opening and further certifies, under penalty of perjury, that under the following conditions, at least 50 percent of the subcontractors to be utilized on the project are either certified Small Business or have applied for Small Business certification by bid opening date and are subsequently granted Small Business certification.

The conditions requiring the aforementioned 50 percent level of subcontracting by Small Business subcontractors apply if:

- A. The lowest responsible bid for the project exceeds \$100,000; and
- B. The project work to be performed requires a Class A or a Class B contractor's license; and
- C. Two or more subcontractors will be used.

If the above conditions apply and Small Business Preference is granted in the award of the contract, the 50 percent Small Business subcontractor utilization level shall be maintained throughout the life of the contract.

2-1.06 CALIFORNIA COMPANY PREFERENCE

Attention is directed to "Award and Execution of Contract" of these special provisions.

In conformance with the requirements of Section 6107 of the Public Contract Code, a "California company" will be granted a reciprocal preference for bid comparison purposes as against a nonresident contractor from any state that gives or requires a preference to be given contractors from that state on its public entity construction contracts.

A "California company" means a sole proprietorship, partnership, joint venture, corporation, or other business entity that was a licensed California contractor on the date when bids for the public contract were opened and meets one of the following:

- A. Has its principal place of business in California.
- B. Has its principal place of business in a state in which there is no local contractor preference on construction contracts.
- C. Has its principal place of business in a state in which there is a local contractor construction preference and the contractor has paid not less than \$5000 in sales or use taxes to California for construction related activity for each of the five years immediately preceding the submission of the bid.

To carry out the "California company" reciprocal preference requirements of Section 6107 of the Public Contract Code, all bidders shall fill out and sign the California Company Preference form in the Proposal. The bidder's signature on the California Company Preference form certifies, under penalty of perjury, that the bidder is or is not a "California company" and if not, the amount of the preference applied by the state of the nonresident Contractor.

A nonresident Contractor shall disclose any and all bid preferences provided to the nonresident Contractor by the state or country in which the nonresident Contractor has its principal place of business.

Proposals without the California Company Preference form filled out and signed may be rejected.

SECTION 3. AWARD AND EXECUTION OF CONTRACT

The bidder's attention is directed to the provisions in Section 3, "Award and Execution of Contract," of the Standard Specifications and these special provisions for the requirements and conditions concerning award and execution of contract.

The award of the contract, if it be awarded, will be to the lowest responsible bidder whose proposal complies with all the requirements prescribed and who has met the goal for DVBE participation or has demonstrated, to the satisfaction of the Department, adequate good faith efforts to do so. Meeting the goal for DVBE participation or demonstrating, to the satisfaction of the Department, adequate good faith efforts to do so is a condition for being eligible for award of contract.

A "Payee Data Record" form will be included in the contract documents to be executed by the successful bidder. The purpose of the form is to facilitate the collection of taxpayer identification data. The form shall be completed and returned to the Department by the successful bidder with the executed contract and contract bonds. For the purposes of the form, payee shall be deemed to mean the successful bidder. The form is not to be completed for subcontractors or suppliers. Failure to complete and return the "Payee Data Record" form to the Department as provided herein will result in the retention of 20 percent of payments due the contractor and penalties of up to \$20,000. This retention of payments for failure to complete the "Payee Data Record" form is in addition to any other retention of payments due the Contractor.

Attention is also directed to "Small Business Preference" of these special provisions. Any bidder who is certified as a Small Business by the Department of General Services, Office of Small Business Certification and Resources will be allowed a preference in the award of this contract, if it be awarded, under the following conditions:

- A. The apparent low bidder is not certified as a Small Business, or has not filled out and signed the Request for Small Business Preference included with the bid documents and attached a copy of their Office of Small Business Certification and Resources (OSBCR) small business certification letter to the form; and
- B. The bidder filled out and signed the Request for Small Business Preference form included with the bid documents and attached a copy of their Office of Small Business Certification and Resources (OSBCR) small business certification letter to the form.

The small business preference will be a reduction in the bid submitted by the small business contractor, for bid comparison purposes, by an amount equal to 5 percent of the amount bid by the apparent low bidder, the amount not to exceed \$50,000. If this reduction results in the small business contractor becoming the low bidder, then the contract will be awarded to the small business contractor on the basis of the actual bid of the small business contractor notwithstanding the reduced bid price used for bid comparison purposes.

Attention is also directed to "California Company Preference" of these special provisions.

The amount of the California company reciprocal preference shall be equal to the amount of the preference applied by the state of the nonresident contractor with the lowest responsive bid, except where the "California company" is eligible for a California Small Business Preference, in which case the preference applied shall be the greater of the two, but not both.

If the bidder submitting the lowest responsive bid is not a "California company" and with the benefit of the reciprocal preference, a "California company's" responsive bid is equal to or less than the original lowest responsive bid, the "California company" will be awarded the contract at its submitted bid price except as provided below.

Small business bidders shall have precedence over nonsmall business bidders in that the application of the "California company" preference for which nonsmall business bidders may be eligible shall not result in the denial of the award to a small business bidder.

SECTION 4. BEGINNING OF WORK, TIME OF COMPLETION AND LIQUIDATED DAMAGES

Attention is directed to the provisions in Sections 8-1.03, "Beginning of Work," 8-1.06, "Time of Completion," 8-1.07, "Liquidated Damages," and 20-4.08, "Plant Establishment Work," of the Standard Specifications and these special provisions.

The Contractor shall begin work within 15 calendar days after the contract has been approved by the Attorney General or the attorney appointed and authorized to represent the Department of Transportation.

The work (except plant establishment work) shall be diligently prosecuted to completion before the expiration of **150 WORKING DAYS** beginning on the fifteenth calendar day after approval of the contract.

The Contractor shall pay to the State of California the sum of \$250 per day, for each and every calendar day's delay in finishing the work (except plant establishment work) in excess of the number of working days prescribed above.

The Contractor shall diligently prosecute all work (including plant establishment) to completion before the expiration of **210 WORKING DAYS** beginning on the fifteenth calendar day after approval of the contract.

The Contractor shall pay to the State of California the sum of \$250 per day, for each and every calendar day's delay in completing the work in excess of the number of working days prescribed above.

In no case will liquidated damages of more than \$250 per day be assessed.

SECTION 5. GENERAL

SECTION 5-1. MISCELLANEOUS

5-1.01 PLANS AND WORKING DRAWINGS

When the specifications require working drawings to be submitted to the Division of Structure Design, the drawings shall be submitted to: Division of Structure Design, Documents Unit, Mail Station 9, 1801 30th Street, Sacramento, CA 95816, Telephone 916 227-8252.

5-1.011 EXAMINATION OF PLANS, SPECIFICATIONS, CONTRACT, AND SITE OF WORK

The second paragraph of Section 2-1.03, "Examination of Plans, Specifications, Contract, and Site of Work," of the Standard Specifications is amended to read:

- Where the Department has made investigations of site conditions, including subsurface conditions in areas where work is to be performed under the contract, or in other areas, some of which may constitute possible local material sources, bidders or Contractors may, upon written request, inspect the records of the Department as to those investigations subject to and upon the conditions hereinafter set forth.

Attention is directed to "Differing Site Conditions" of these special provisions regarding physical conditions at the site which may differ from those indicated in "Materials Information," log of test borings or other geotechnical information obtained by the Department's investigation of site conditions.

5-1.012 DIFFERING SITE CONDITIONS

Attention is directed to Section 5-1.116, "Differing Site Conditions," of the Standard Specifications.

During the progress of the work, if subsurface or latent conditions are encountered at the site differing materially from those indicated in the "Materials Information," log of test borings, other geotechnical data obtained by the Department's investigation of subsurface conditions, or an examination of the conditions above ground at the site, the party discovering those conditions shall promptly notify the other party in writing of the specific differing conditions before they are disturbed and before the affected work is performed.

The Contractor will be allowed 15 days from the notification of the Engineer's determination of whether or not an adjustment of the contract is warranted, in which to file a notice of potential claim in conformance with the provisions of Section 9-1.04, "Notice of Potential Claim," of the Standard Specifications and as specified herein; otherwise the decision of the Engineer shall be deemed to have been accepted by the Contractor as correct. The notice of potential claim shall set forth in what respects the Contractor's position differs from the Engineer's determination and provide any additional information obtained by the Contractor, including but not limited to additional geotechnical data. The notice of potential claim shall be accompanied by the Contractor's certification that the following were made in preparation of the bid: a review of the contract, a review of the "Materials Information," a review of the log of test borings and other records of geotechnical data to the extent they were made available to bidders prior to the opening of bids, and an examination of the conditions above ground at the site. Supplementary information, obtained by the Contractor subsequent to the filing of the notice of potential claim, shall be submitted to the Engineer in an expeditious manner.

5-1.015 LABORATORY

When a reference is made in the specifications to the "Laboratory," the reference shall mean the Division of Materials Engineering and Testing Services and the Division of Structural Foundations of the Department of Transportation, or established laboratories of the various Districts of the Department, or other laboratories authorized by the Department to test materials and work involved in the contract. When a reference is made in the specifications to the "Transportation Laboratory," the reference shall mean the Division of Materials Engineering and Testing Services and the Division of Structural Foundations, located at 5900 Folsom Boulevard, Sacramento, CA 95819, Telephone (916) 227-7000.

5-1.017 CONTRACT BONDS

Attention is directed to Section 3-1.02, "Contract Bonds," of the Standard Specifications and these special provisions.

The payment bond shall be in a sum not less than one hundred percent of the total amount payable by the terms of the contract.

5-1.018 EXCAVATION SAFETY PLANS

Section 5-1.02A, "Trench Excavation Safety Plans," of the Standard Specifications is amended to read:

5-1.02A Excavation Safety Plans

- The Construction Safety Orders of the Division of Occupational Safety and Health shall apply to all excavations. For all excavations 1.5 m or more in depth, the Contractor shall submit to the Engineer a detailed plan showing the design and details of the protective systems to be provided for worker protection from the hazard of caving ground during excavation. The detailed plan shall include any tabulated data and any design calculations used in the preparation of the plan. Excavation shall not begin until the detailed plan has been reviewed and approved by the Engineer.
- Detailed plans of protective systems for which the Construction Safety Orders require design by a registered professional engineer shall be prepared and signed by an engineer who is registered as a Civil Engineer in the State of California, and shall include the soil classification, soil properties, soil design calculations that demonstrate adequate stability of the protective system, and any other design calculations used in the preparation of the plan.
- No plan shall allow the use of a protective system less effective than that required by the Construction Safety Orders.

- If the detailed plan includes designs of protective systems developed only from the allowable configurations and slopes, or Appendices, contained in the Construction Safety Orders, the plan shall be submitted at least 5 days before the Contractor intends to begin excavation. If the detailed plan includes designs of protective systems developed from tabulated data, or designs for which design by a registered professional engineer is required, the plan shall be submitted at least 3 weeks before the Contractor intends to begin excavation.
- Attention is directed to Section 7-1.01E, "Trench Safety."

The third paragraph of Section 19-1.02, "Preservation of Property," of the Standard Specifications is amended to read:

- In addition to the provisions in Sections 5-1.02, "Plans and Working Drawings," and 5-1.02A, "Excavation Safety Plans," detailed plans of the protective systems for excavations on or affecting railroad property will be reviewed for adequacy of protection provided for railroad facilities, property, and traffic. These plans shall be submitted at least 9 weeks before the Contractor intends to begin excavation requiring the protective systems. Approval by the Engineer of the detailed plans for the protective systems will be contingent upon the plans being satisfactory to the railroad company involved.

5-1.019 COST REDUCTION INCENTIVE

Attention is directed to Section 5-1.14, "Cost Reduction Incentive," of the Standard Specifications.

Prior to preparing a cost reduction proposal, the Contractor shall request a meeting with the Engineer to discuss the proposal in concept and to determine the merit of the cost reduction proposal. Items of discussion will also include permit issues, impact on other projects, impact on the project schedule, peer reviews, and review times required by the Department and other agencies.

5-1.02 LABOR NONDISCRIMINATION

Attention is directed to the following Notice that is required by Chapter 5 of Division 4 of Title 2, California Code of Regulations.

NOTICE OF REQUIREMENT FOR NONDISCRIMINATION PROGRAM

(GOV. CODE, SECTION 12990)

Your attention is called to the "Nondiscrimination Clause", set forth in Section 7-1.01A(4), "Labor Nondiscrimination," of the Standard Specifications, which is applicable to all nonexempt State contracts and subcontracts, and to the "Standard California Nondiscrimination Construction Contract Specifications" set forth therein. The specifications are applicable to all nonexempt State construction contracts and subcontracts of \$5000 or more.

5-1.03 INTEREST ON PAYMENTS

Interest shall be payable on progress payments, payments after acceptance, final payments, extra work payments, and claim payments as follows:

- A. Unpaid progress payments, payment after acceptance, and final payments shall begin to accrue interest 30 days after the Engineer prepares the payment estimate.
- B. Unpaid extra work bills shall begin to accrue interest 30 days after preparation of the first pay estimate following receipt of a properly submitted and undisputed extra work bill. To be properly submitted, the bill must be submitted within 7 days of the performance of the extra work and in conformance with the provisions in Section 9-1.03C, "Records," and Section 9-1.06, "Partial Payments," of the Standard Specifications. An undisputed extra work bill not submitted within 7 days of performance of the extra work will begin to accrue interest 30 days after the preparation of the second pay estimate following submittal of the bill.
- C. The rate of interest payable for unpaid progress payments, payments after acceptance, final payments, and extra work payments shall be 10 percent per annum.
- D. The rate of interest payable on a claim, protest or dispute ultimately allowed under this contract shall be 6 percent per annum. Interest shall begin to accrue 61 days after the Contractor submits to the Engineer information in sufficient detail to enable the Engineer to ascertain the basis and amount of said claim, protest or dispute.

The rate of interest payable on any award in arbitration shall be 6 percent per annum if allowed under the provisions of Civil Code Section 3289.

5-1.031 FINAL PAYMENT AND CLAIMS

Attention is directed to Section 9-1.07B, "Final Payment and Claims," of the Standard Specifications.

If the Contractor files a timely written statement of claims in response to the proposed final estimate, the District that administers the contract will submit a claim position letter to the Contractor by hand delivery or deposit in the U.S. mail within 135 days of acceptance of the contract. The claim position letter will delineate the District's position on the Contractor's claims. If the Contractor disagrees with the claim position letter, the Contractor shall submit a written notification of its disagreement to be received by the District not later than 15 days after the Contractor's receipt of the claim position letter. The written notification of disagreement shall set forth the basis for the Contractor's disagreement and be submitted to the office designated in the claim position letter. The Contractor's failure to provide a timely, written notification of disagreement shall constitute the Contractor's acceptance and agreement with the determinations provided in the claim position letter and with final payment pursuant to the claim position letter.

If the Contractor files a timely notification of disagreement with the District claim position letter, the board of review designated by the District Director to review claims that remain in dispute will meet with the Contractor within 45 days after receipt by the District of the notification of disagreement. Attendance by the Contractor at the board of review meeting shall be mandatory.

If the District fails to submit a claim position letter to the Contractor within 135 days after the acceptance of the contract and the Contractor has claims that remain in dispute, the Contractor may request a meeting with the board of review designated by the District Director to review claims that remain in dispute. The Contractor's request for a meeting shall identify the claims that remain in dispute. If the Contractor files a request for a meeting, the board of review will meet with the Contractor within 45 days after the District receives the request for the meeting. Attendance by the Contractor at the District Director's board of review meeting shall be mandatory.

Failure of the Contractor to file a timely written statement of claims in response to the proposed final estimate, or to file a timely notification of disagreement with the District claim position letter, or to attend the District Director's board of review meeting shall constitute a failure to pursue diligently and exhaust the administrative procedures in the contract and shall be a bar to arbitration in conformance with the requirements in Section 10240.2 of the California Public Contract Code.

5-1.04 PUBLIC SAFETY

The Contractor shall provide for the safety of traffic and the public in conformance with the provisions in Section 7-1.09, "Public Safety," of the Standard Specifications and these special provisions.

The Contractor shall install temporary railing (Type K) between a lane open to public traffic and an excavation, obstacle or storage area when the following conditions exist:

- A. Excavations.—The near edge of the excavation is 3.6 m or less from the edge of the lane, except:
 - 1. Excavations covered with sheet steel or concrete covers of adequate thickness to prevent accidental entry by traffic or the public.
 - 2. Excavations less than 0.3-m deep.
 - 3. Trenches less than 0.3-m wide for irrigation pipe or electrical conduit, or excavations less than 0.3-m in diameter.
 - 4. Excavations parallel to the lane for the purpose of pavement widening or reconstruction.
 - 5. Excavations in side slopes, where the slope is steeper than 1:4 (vertical:horizontal).
 - 6. Excavations protected by existing barrier or railing.
- B. Temporarily Unprotected Permanent Obstacles.—The work includes the installation of a fixed obstacle together with a protective system, such as a sign structure together with protective railing, and the Contractor elects to install the obstacle prior to installing the protective system; or the Contractor, for the Contractor's convenience and with permission of the Engineer, removes a portion of an existing protective railing at an obstacle and does not replace such railing complete in place during the same day.
- C. Storage Areas.—Material or equipment is stored within 3.6 m of the lane and the storage is not otherwise prohibited by the provisions of the Standard Specifications and these special provisions.

The approach end of temporary railing (Type K), installed in conformance with the provisions in this section "Public Safety" and in Section 7-1.09, "Public Safety," of the Standard Specifications, shall be offset a minimum of 4.6 m from the edge of the traffic lane open to public traffic. The temporary railing shall be installed on a skew toward the edge of the traffic lane of not more than 0.3-m transversely to 3 m longitudinally with respect to the edge of the traffic lane. If the 4.6-m minimum offset cannot be achieved, the temporary railing shall be installed on the 10 to 1 skew to obtain the maximum available offset between the approach end of the railing and the edge of the traffic lane, and an array of temporary crash cushion modules shall be installed at the approach end of the temporary railing.

Temporary railing (Type K) shall conform to the provisions in Section 12-3.08, "Temporary Railing (Type K)," of the Standard Specifications. Temporary railing (Type K), conforming to the details shown on 1999 Standard Plan T3, may be used. Temporary railing (Type K) fabricated prior to January 1, 1993, and conforming to 1988 Standard Plan B11-30 may be used, provided the fabrication date is printed on the required Certificate of Compliance.

Temporary crash cushion modules shall conform to the provisions in "Temporary Crash Cushion Module" of these special provisions.

Except for installing, maintaining and removing traffic control devices, whenever work is performed or equipment is operated in the following work areas, the Contractor shall close the adjacent traffic lane unless otherwise provided in the Standard Specifications and these special provisions:

Approach Speed of Public Traffic (Posted Limit) (Kilometers Per Hour)	Work Areas
Over 72 (45 Miles Per Hour)	Within 1.8 m of a traffic lane but not on a traffic lane
56 to 72 (35 to 45 Miles Per Hour)	Within 0.9-m of a traffic lane but not on a traffic lane

The lane closure provisions of this section shall not apply if the work area is protected by permanent or temporary railing or barrier.

When traffic cones or delineators are used to delineate a temporary edge of a traffic lane, the line of cones or delineators shall be considered to be the edge of the traffic lane, however, the Contractor shall not reduce the width of an existing lane to less than 3 m without written approval from the Engineer.

When work is not in progress on a trench or other excavation that required closure of an adjacent lane, the traffic cones or portable delineators used for the lane closure shall be placed off of and adjacent to the edge of the traveled way. The spacing of the cones or delineators shall be not more than the spacing used for the lane closure.

Suspended loads or equipment shall not be moved nor positioned over public traffic or pedestrians.

Full compensation for conforming to the provisions in this section "Public Safety," including furnishing and installing temporary railing (Type K) and temporary crash cushion modules, shall be considered as included in the contract prices paid for the various items of work involved and no additional compensation will be allowed therefor.

5-1.05 SURFACE MINING AND RECLAMATION ACT

Attention is directed to the Surface Mining and Reclamation Act of 1975, commencing in Public Resources Code, Mining and Geology, Section 2710, which establishes regulations pertinent to surface mining operations, and to California Public Contract Code Section 10295.5.

Material from mining operations furnished for this project shall only come from permitted sites in compliance with California Public Contract Code Section 10295.5.

The requirements of this section shall apply to materials furnished for the project, except for acquisition of materials in conformance with the provisions in Section 4-1.05, "Use of Materials Found on the Work," of the Standard Specifications.

5-1.06 REMOVAL OF ASBESTOS AND HAZARDOUS SUBSTANCES

When the presence of asbestos or hazardous substances are not shown on the plans or indicated in the specifications and the Contractor encounters materials which the Contractor reasonably believes to be asbestos or a hazardous substance as defined in Section 25914.1 of the Health and Safety Code, and the asbestos or hazardous substance has not been rendered harmless, the Contractor may continue work in unaffected areas reasonably believed to be safe. The Contractor shall immediately cease work in the affected area and report the condition to the Engineer in writing.

In conformance with Section 25914.1 of the Health and Safety Code, removal of asbestos or hazardous substances including exploratory work to identify and determine the extent of the asbestos or hazardous substance will be performed by separate contract.

If delay of work in the area delays the current controlling operation, the delay will be considered a right of way delay and the Contractor will be compensated for the delay in conformance with the provisions in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

5-1.07 YEAR 2000 COMPLIANCE

This contract is subject to Year 2000 Compliance for automated devices in the State of California.

Year 2000 compliance for automated devices in the State of California is achieved when embedded functions have or create no logical or mathematical inconsistencies when dealing with dates prior to and beyond 1999. The year 2000 is recognized and processed as a leap year. The product shall operate accurately in the manner in which the product was intended for date operation without requiring manual intervention.

The Contractor shall provide the Engineer a Certificate of Compliance from the manufacturer in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications for all automated devices furnished for the project.

5-1.08 SUBCONTRACTOR AND DVBE RECORDS

The Contractor shall maintain records of all subcontracts entered into with certified DVBE subcontractors and records of materials purchased from certified DVBE suppliers. The records shall show the name and business address of each DVBE subcontractor or vendor and the total dollar amount actually paid each DVBE subcontractor or vendor.

Upon completion of the contract, a summary of these records shall be prepared on Form CEM-2402 (S) and certified correct by the Contractor or the Contractor's authorized representative, and shall be furnished to the Engineer.

5-1.086 PERFORMANCE OF DVBE SUBCONTRACTORS AND SUPPLIERS

The DVBEs listed by the Contractor in response to the provisions in Section 2-1.04, "Submission of DVBE Information," and Section 3, "Award and Execution of Contract," of these special provisions, which are determined by the Department to be certified DVBEs, shall perform the work and supply the materials for which they are listed, unless the Contractor has received prior written authorization to perform the work with other forces or to obtain the materials from other sources.

Authorization to utilize other forces or sources of materials may be requested for the following reasons:

- A. The listed DVBE, after having had a reasonable opportunity to do so, fails or refuses to execute a written contract, when the written contract, based upon the general terms, conditions, plans and specifications for the project, or on the terms of the subcontractor's or supplier's written bid, is presented by the Contractor.
- B. The listed DVBE becomes bankrupt or insolvent.
- C. The listed DVBE fails or refuses to perform the subcontract or furnish the listed materials.
- D. The Contractor stipulated that a bond was a condition of executing a subcontract and the listed DVBE subcontractor fails or refuses to meet the bond requirements of the Contractor.
- E. The work performed by the listed subcontractor is substantially unsatisfactory and is not in substantial conformance with the plans and specifications or the subcontractor is substantially delaying or disrupting the progress of the work.
- F. The listed DVBE subcontractor is not licensed pursuant to the Contractor's License Law.
- G. It would be in the best interest of the State.

The Contractor shall not be entitled to payment for the work or material unless it is performed or supplied by the listed DVBE or by other forces (including those of the Contractor) pursuant to prior written authorization of the Engineer.

5-1.09 SUBCONTRACTING

Attention is directed to the provisions in Section 8-1.01, "Subcontracting," of the Standard Specifications, Section 2, "Proposal Requirements and Conditions," Section 2-1.04, "Submission of DVBE Information," and Section 3, "Award and Execution of Contract," of these special provisions and these special provisions.

Pursuant to the provisions in Section 1777.1 of the Labor Code, the Labor Commissioner publishes and distributes a list of contractors ineligible to perform work as a subcontractor on a public works project. This list of debarred contractors is available from the Department of Industrial Relations web site at:

<http://www.dir.ca.gov/DLSE/Debar.html>.

The DVBE information furnished under Section 3-1.01A, "DVBE Information," of these special provisions is in addition to the subcontractor information required to be furnished in Section 8-1.01, "Subcontracting," and Section 2-1.054, "Required Listing of Proposed Subcontractors," of the Standard Specifications.

The third paragraph of Section 8-1.01 of the Standard Specifications shall not apply to this contract.

Section 10115 of the Public Contract Code requires the Department to implement provisions to establish a goal for Disabled Veteran Business Enterprise (DVBE) participation in highway contracts that are State funded. As a part of this requirement:

- A. No substitution of a DVBE subcontractor shall be made at any time without the written consent of the Department, and
- B. If a DVBE subcontractor is unable to perform successfully and is to be replaced, the Contractor shall make good faith efforts to replace the original DVBE subcontractor with another DVBE subcontractor.

The provisions in Section 2-1.02, "Disabled Veteran Business Enterprise (DVBE)," of these special provisions that DVBEs shall be certified on the date bids are opened does not apply to DVBE substitutions after award of the contract.

5-1.10 PROMPT PROGRESS PAYMENT TO SUBCONTRACTORS

Attention is directed to the provisions in Sections 10262 and 10262.5 of the Public Contract Code and Section 7108.5 of the Business and Professions Code concerning prompt payment to subcontractors.

5-1.11 AREAS FOR CONTRACTOR'S USE

Attention is directed to the provisions in Section 7-1.19, "Rights in Land and Improvements," of the Standard Specifications and these special provisions.

The highway right of way shall be used only for purposes that are necessary to the required work. The Contractor shall not occupy the right of way, or allow others to occupy the right of way, for purposes, which are not necessary to perform the required work.

No State-owned parcels adjacent to the right of way are available for the exclusive use of the Contractor within the contract limits. The Contractor shall secure, at the Contractor's own expense, areas required for plant sites, storage of equipment or materials, or for other purposes.

No area is available within the contract limits for the exclusive use of the Contractor. However, temporary storage of equipment and materials on State property may be arranged with the Engineer, subject to the prior demands of State maintenance forces and to other contract requirements. Use of the Contractor's work areas and other State-owned property shall be at the Contractor's own risk, and the State shall not be held liable for damage to or loss of materials or equipment located within such areas.

The Contractor shall remove equipment, materials, and rubbish from the work areas and other State-owned property, which the Contractor occupies. The Contractor shall leave the areas in a presentable condition in conformance with the provisions in Section 4-1.02, "Final cleaning up," of the Standard Specifications.

5-1.12 PAYMENTS

Attention is directed to Sections 9-1.06, "Partial Payments," and 9-1.07, "Payment After Acceptance," of the Standard Specifications and these special provisions.

After acceptance of the contract pursuant to the provisions in Section 7-1.17, "Acceptance of Contract," of the Standard Specifications, the amount, if any, payable for a contract item of work in excess of the maximum value for progress payment purposes hereinabove listed for the item, will be included for payment in the first estimate made after acceptance of the contract.

In determining the partial payments to be made to the Contractor, only the following listed materials will be considered for inclusion in the payment as materials furnished but not incorporated in the work:

- A. Valves and Valve Boxes
- B. Sprinklers
- C. Pipe (Irrigation Systems)

SECTION 6. (BLANK)
SECTION 7. (BLANK)
SECTION 8. MATERIALS
SECTION 8-1. MISCELLANEOUS

8-1.01 SUBSTITUTION OF NON-METRIC MATERIALS AND PRODUCTS

Only materials and products conforming to the requirements of the specifications shall be incorporated in the work. When metric materials and products are not available, and when approved by the Engineer, and at no cost to the State, materials and products in the United States Standard Measures which are of equal quality and of the required properties and characteristics for the purpose intended, may be substituted for the equivalent metric materials and products, subject to the following provisions:

- A. Materials and products shown on the plans or in the special provisions as being equivalent may be substituted for the metric materials and products specified or detailed on the plans.
- B. Before other non-metric materials and products will be considered for use, the Contractor shall furnish, at the Contractor's expense, evidence satisfactory to the Engineer that the materials and products proposed for use are equal to or better than the materials and products specified or detailed on the plans. The burden of proof as to the quality and suitability of substitutions shall be upon the Contractor and the Contractor shall furnish necessary information as required by the Engineer. The Engineer will be the sole judge as to the quality and suitability of the substituted materials and products and the Engineer's decision will be final.
- C. When the Contractor elects to substitute non-metric materials and products, including materials and products shown on the plans or in the special provisions as being equivalent, the list of sources of material specified in Section 6-1.01, "Source of Supply and Quality of Materials," of the Standard Specification shall include a list of substitutions to be made and contract items involved. In addition, for a change in design or details, the Contractor shall submit plans and working drawings in conformance with the provisions in Section 5-1.02, "Plans and Working Drawings," of the Standard Specifications. The plans and working drawings shall be submitted at least 7 days before the Contractor intends to begin the work involved.

Unless otherwise specified, the following substitutions of materials and products will be allowed:

SUBSTITUTION TABLE FOR SIZES OF HIGH STRENGTH STEEL FASTENERS
 ASTM Designation: A 325M

METRIC SIZE SHOWN ON THE PLANS mm x thread pitch	SIZE TO BE SUBSTITUTED inch
M16 x 2	5/8
M20 x 2.5	3/4
M22 x 2.5	7/8
M24 x 3	1
M27 x 3	1-1/8
M30 x 3.5	1-1/4
M36 x 4	1-1/2

SUBSTITUTION TABLE FOR PLAIN WIRE REINFORCEMENT

ASTM Designation: A 82

METRIC SIZE SHOWN ON THE PLANS mm ²	SIZE TO BE SUBSTITUTED inch ² x 100
MW9	W1.4
MW10	W1.6
MW13	W2.0
MW15	W2.3
MW19	W2.9
MW20	W3.1
MW22	W3.5
MW25	W3.9, except W3.5 in piles only
MW26	W4.0
MW30	W4.7
MW32	W5.0
MW35	W5.4
MW40	W6.2
MW45	W6.5
MW50	W7.8
MW55	W8.5, except W8.0 in piles only
MW60	W9.3
MW70	W10.9, except W11.0 in piles only
MW80	W12.4
MW90	W14.0
MW100	W15.5

SUBSTITUTION TABLE FOR BAR REINFORCEMENT

METRIC BAR DESIGNATION NUMBER ¹ SHOWN ON THE PLANS	BAR DESIGNATION NUMBER ² TO BE SUBSTITUTED
10	3
13	4
16	5
19	6
22	7
25	8
29	9
32	10
36	11
43	14
57	18

¹Bar designation numbers approximate the number of millimeters of the nominal diameter of the bars.

²Bar numbers are based on the number of eighths of an inch included in the nominal diameter of the bars.

No adjustment will be required in spacing or total number of reinforcing bars due to a difference in minimum yield strength between metric and non-metric bars.

SUBSTITUTION TABLE FOR SIZES OF:

(1) STEEL FASTENERS FOR GENERAL APPLICATIONS (ASTM Designation: A 307 or AASHTO Designation: M 314, Grade 36 or 55), and

(2) HIGH STRENGTH STEEL FASTENERS (ASTM Designation: A 325 or A 449)

METRIC SIZE SHOWN ON THE PLANS mm	SIZE TO BE SUBSTITUTED inch
6 or 6.35	1/4
8 or 7.94	5/16
10 or 9.52	3/8
11 or 11.11	7/16
13 or 12.70	1/2
14 or 14.29	9/16
16 or 15.88	5/8
19 or 19.05	3/4
22 or 22.22	7/8
24, 25, or 25.40	1
29 or 28.58	1-1/8
32 or 31.75	1-1/4
35 or 34.93	1-3/8
38 or 38.10	1-1/2
44 or 44.45	1-3/4
51 or 50.80	2
57 or 57.15	2-1/4
64 or 63.50	2-1/2
70 or 69.85	2-3/4
76 or 76.20	3
83 or 82.55	3-1/4
89 or 88.90	3-1/2
95 or 95.25	3-3/4
102 or 101.60	4

SUBSTITUTION TABLE FOR NOMINAL THICKNESS OF SHEET METAL

UNCOATED HOT AND COLD ROLLED SHEETS		HOT-DIPPED ZINC COATED SHEETS (GALVANIZED)	
METRIC THICKNESS SHOWN ON THE PLANS mm	GAGE TO BE SUBSTITUTED inch	METRIC THICKNESS SHOWN ON THE PLANS mm	GAGE TO BE SUBSTITUTED inch
7.94	0.3125	4.270	0.1681
6.07	0.2391	3.891	0.1532
5.69	0.2242	3.510	0.1382
5.31	0.2092	3.132	0.1233
4.94	0.1943	2.753	0.1084
4.55	0.1793	2.372	0.0934
4.18	0.1644	1.994	0.0785
3.80	0.1495	1.803	0.0710
3.42	0.1345	1.613	0.0635
3.04	0.1196	1.461	0.0575
2.66	0.1046	1.311	0.0516
2.28	0.0897	1.158	0.0456
1.90	0.0747	1.006 or 1.016	0.0396
1.71	0.0673	0.930	0.0366
1.52	0.0598	0.853	0.0336
1.37	0.0538	0.777	0.0306
1.21	0.0478	0.701	0.0276
1.06	0.0418	0.627	0.0247
0.91	0.0359	0.551	0.0217
0.84	0.0329	0.513	0.0202
0.76	0.0299	0.475	0.0187
0.68	0.0269	-----	-----
0.61	0.0239	-----	-----
0.53	0.0209	-----	-----
0.45	0.0179	-----	-----
0.42	0.0164	-----	-----
0.38	0.0149	-----	-----

SUBSTITUTION TABLE FOR WIRE

METRIC THICKNESS SHOWN ON THE PLANS mm	WIRE THICKNESS TO BE SUBSTITUTED inch	GAGE NO.
6.20	0.244	3
5.72	0.225	4
5.26	0.207	5
4.88	0.192	6
4.50	0.177	7
4.11	0.162	8
3.76	0.148	9
3.43	0.135	10
3.05	0.120	11
2.69	0.106	12
2.34	0.092	13
2.03	0.080	14
1.83	0.072	15
1.57	0.062	16
1.37	0.054	17
1.22	0.048	18
1.04	0.041	19
0.89	0.035	20

SUBSTITUTION TABLE FOR PIPE PILES

METRIC SIZE SHOWN ON THE PLANS mm x mm	SIZE TO BE SUBSTITUTED inch x inch
PP 360 x 4.55	NPS 14 x 0.179
PP 360 x 6.35	NPS 14 x 0.250
PP 360 x 9.53	NPS 14 x 0.375
PP 360 x 11.12	NPS 14 x 0.438
PP 406 x 12.70	NPS 16 x 0.500
PP 460 x T	NPS 18 x T"
PP 508 x T	NPS 20 x T"
PP 559 x T	NPS 22 x T"
PP 610 x T	NPS 24 x T"
PP 660 x T	NPS 26 x T"
PP 711 x T	NPS 28 x T"
PP 762 x T	NPS 30 x T"
PP 813 x T	NPS 32 x T"
PP 864 x T	NPS 34 x T"
PP 914 x T	NPS 36 x T"
PP 965 x T	NPS 38 x T"
PP 1016 x T	NPS 40 x T"
PP 1067 x T	NPS 42 x T"
PP 1118 x T	NPS 44 x T"
PP 1219 x T	NPS 48 x T"
PP 1524 x T	NPS 60 x T"

The thickness in millimeters (T) represents an exact conversion of the thickness in inches (T").

SUBSTITUTION TABLE FOR STRUCTURAL TIMBER AND LUMBER

METRIC MINIMUM DRESSED DRY, SHOWN ON THE PLANS mm x mm	METRIC MINIMUM DRESSED GREEN, SHOWN ON THE PLANS mm x mm	NOMINAL SIZE TO BE SUBSTITUTED inch x inch
19x89	20x90	1x4
38x89	40x90	2x4
64x89	65x90	3x4
89x89	90x90	4x4
140x140	143x143	6x6
140x184	143x190	6x8
184x184	190x190	8x8
235x235	241x241	10x10
286x286	292x292	12x12

SUBSTITUTION TABLE FOR NAILS AND SPIKES

METRIC COMMON NAIL, SHOWN ON THE PLANS Length, mm Diameter, mm	METRIC BOX NAIL, SHOWN ON THE PLANS Length, mm Diameter, mm	METRIC SPIKE, SHOWN ON THE PLANS Length, mm Diameter, mm	SIZE TO BE SUBSTITUTED Penny-weight
50.80 2.87	50.80 2.51	————	6d
63.50 3.33	63.50 2.87	————	8d
76.20 3.76	76.20 3.25	76.20 4.88	10d
82.55 3.76	82.55 3.25	82.55 4.88	12d
88.90 4.11	88.90 3.43	88.90 5.26	16d
101.60 4.88	101.60 3.76	101.60 5.72	20d
114.30 5.26	114.30 3.76	114.30 6.20	30d
127.00 5.72	127.00 4.11	127.00 6.68	40d
————	————	139.70 7.19	50d
————	————	152.40 7.19	60d

SUBSTITUTION TABLE FOR IRRIGATION
COMPONENTS

METRIC WATER METERS, TRUCK LOADING STANDPIPES, VALVES, BACKFLOW PREVENTERS, FLOW SENSORS, WYE STRAINERS, FILTER ASSEMBLY UNITS, PIPE SUPPLY LINES, AND PIPE IRRIGATION SUPPLY LINES SHOWN ON THE PLANS DIAMETER NOMINAL (DN) mm	NOMINAL SIZE TO BE SUBSTITUTED inch
15	1/2
20	3/4
25	1
32	1-1/4
40	1-1/2
50	2
65	2-1/2
75	3
100	4
150	6
200	8
250	10
300	12
350	14
400	16

Unless otherwise specified, substitutions of United States Standard Measures standard structural shapes corresponding to the metric designations shown on the plans and in conformance with the requirements in ASTM Designation: A 6/A 6M, Annex 2, will be allowed.

8-1.02 PREQUALIFIED AND TESTED SIGNING AND DELINEATION MATERIALS

The Department maintains the following list of Prequalified and Tested Signing and Delineation Materials. The Engineer shall not be precluded from sampling and testing products on the list of Prequalified and Tested Signing and Delineation Materials.

The manufacturer of products on the list of Prequalified and Tested Signing and Delineation Materials shall furnish the Engineer a Certificate of Compliance in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications for each type of traffic product supplied.

For those categories of materials included in the list of Prequalified and Tested Signing and Delineation Materials, only those products shown within the listing may be used in the work. Other categories of products, not included in the list of Prequalified and Tested Signing and Delineation Materials, may be used in the work provided they conform to the requirements of the Standard Specifications.

Materials and products may be added to the list of Prequalified and Tested Signing and Delineation Materials if the manufacturer submits a New Product Information Form to the New Product Coordinator at the Transportation Laboratory. Upon a Departmental request for samples, sufficient samples shall be submitted to permit performance of required tests. Approval of materials or products will depend upon compliance with the specifications and tests the Department may elect to perform.

PAVEMENT MARKERS, PERMANENT TYPE

Retroreflective

- A. Apex, Model 921 (100 mm x 100 mm)
- B. Ray-O-Lite, Models SS (100 mm x 100 mm), RS (100 mm x 100 mm) and AA (100 mm x 100 mm)
- C. Stimsonite, Models 88 (100 mm x 100 mm), 911 (100 mm x 100 mm), 953 (70 mm x 114 mm)
- D. 3M Series 290 (89 mm x 100 mm)

Retroreflective With Abrasion Resistant Surface (ARS)

- A. Apex, Model 921AR (100 mm x 100 mm)
- B. Ray-O-Lite "AA" ARS (100 mm x 100 mm)
- C. Stimsonite, Models 911 (100 mm x 100 mm), 953 (70 mm x 114 mm)
- D. 3M Series 290 (89 mm x 100 mm)

Retroreflective With Abrasion Resistant Surface (ARS)

(Used for recessed applications)

- A. Stimsonite, Model 948 (58 mm x 119 mm)
- B. Ray-O-Lite, Model 2002 (58 mm x 117 mm)
- C. Stimsonite, Model 944SB (51 mm x 100 mm)*
- D. Ray-O-Lite, Model 2004 ARS (51 mm x 100 mm)*

*For use only in 114 mm wide (older) recessed slots

Non-Reflective For Use With Epoxy Adhesive, 100 mm Round

- A. Apex Universal (Ceramic)
- B. Highway Ceramics, Inc. (Ceramic)

Non-Reflective For Use With Bitumen Adhesive, 100 mm Round

- A. Alpine Products, "D-Dot" and "ANR" (ABS)
- B. Apex Universal (Ceramic)
- C. Apex Universal, Model 929 (ABS)
- D. Elgin Molded Plastics, "Empco-Lite" Model 900 (ABS)
- E. Highway Ceramics, Inc. (Ceramic)
- F. Hi-Way Safety, Inc., Models P20-2000W and 2001Y (ABS)
- G. Interstate Sales, "Diamond Back" (ABS) and (Polypropylene)
- H. Novabrite Models Adot-w (White) Adot-y (Yellow), (ABS)
- I. Road Creations, Model RCB4NR (Acrylic)
- J. Zumar Industries, "Titan TM40A" (ABS)

PAVEMENT MARKERS, TEMPORARY TYPE

Temporary Markers For Long Term Day/Night Use (6 months or less)

- A. Apex Universal, Model 924 (100 mm x 100 mm)
- B. Elgin Molded Plastics, "Empco-Lite" Model 901 (100 mm x 100 mm)
- C. Road Creations, Model R41C (100 mm x 100 mm)
- D. Vega Molded Products "Temporary Road Marker" (75 mm x 100 mm)

Temporary Markers For Short Term Day/Night Use (14 days or less)

(For seal coat or chip seal applications, clear protective covers are required)

- A. Apex Universal, Model 932
- B. Davidson Plastics, Models T.O.M., T.R.P.M., and "HH" (High Heat)
- C. Hi-Way Safety, Inc., Model 1280/1281

STRIPING AND PAVEMENT MARKING MATERIAL

Permanent Traffic Striping and Pavement Marking Tape

- A. Advanced Traffic Marking, Series 300 and 400
- B. Brite-Line, Series 1000
- C. Brite-Line "DeltaLine XRP"
- D. Swarco Industries, "Director 35" (For transverse application only)

- E. Swarco Industries, "Director 60"
- F. 3M, "Stamark" Series 380 and 5730
- G. 3M, "Stamark" Series 420 (For transverse application only)

Temporary (Removable) Striping and Pavement Marking Tape (6 months or less)

- A. Advanced Traffic Marking, Series 200
- B. Brite-Line, Series 100
- C. P.B. Laminations, Aztec, Grade 102
- D. Swarco Industries, "Director-2"
- E. 3M, "Stamark," Series 620
- F. 3M Series A145 Removable Black Line Mask
(Black Tape: For use only on Asphalt Concrete Surfaces)
- G. Advanced Traffic Marking Black "Hide-A-Line"
(Black Tape: For use only on Asphalt Concrete Surfaces)
- H. Brite-Line "BTR" Black Removable Tape
(Black Tape: For use only on Asphalt Concrete Surfaces)

Preformed Thermoplastic (Heated in place)

- A. Flint Trading, "Premark" and "Premark 20/20 Flex"
- B. Pavemark, "Hotape"

Removable Traffic Paint

- A. Belpro, Series 250/252 and No. 93 Remover

Ceramic Surfacing Laminate, 150 mm x 150 mm

- A. Safeline Industries/Highway Ceramics, Inc.

CLASS 1 DELINEATORS

One Piece Driveable Flexible Type, 1700 mm

- A. Carsonite, Curve-Flex CFRM-400
- B. Carsonite, Roadmarker CRM-375
- C. Davidson Plastics, "Flexi-Guide Models 400 and 566"
- D. FlexStake, Model 654 TM
- E. GreenLine Models HWD1-66 and CGD1-66
- F. J. Miller Industries, Model JMI-375 (with soil anchor)

Special Use Flexible Type, 1700 mm

- A. Carsonite, "Survivor" (with 450 mm U-Channel base)
- B. FlexStake, Model 604
- C. GreenLine Models HWD and CGD (with 450 mm U-Channel base)
- D. Safe-Hit with 200 mm pavement anchor (SH248-GP1)
- E. Safe-Hit with 380 mm soil anchor (SH248-GP2) and with 450 mm soil anchor (SH248-GP3)

Surface Mount Flexible Type, 1200 mm

- A. Bent Manufacturing Company, Masterflex Model MF-180EX-48
- B. Carsonite, "Super Duck II"
- C. FlexStake, Surface Mount, Models 704 and 754 TM

CHANNELIZERS

Surface Mount Type, 900 mm

- A. Bent Manufacturing Company, Masterflex Models MF-360-36 (Round) and MF-180-36 (Flat)
- B. Carsonite, "Super Duck" (Flat SDF-436, Round SDR-336)
- C. Carsonite, "Super Duck II" Model SDCF203601MB "The Channelizer"
- D. Davidson Plastics, Flex-Guide Models FG300LD and FG300UR
- E. FlexStake, Surface Mount, Models 703 and 753 TM
- F. GreenLine, Model SMD-36

- G. Hi-Way Safety, Inc. "Channel Guide Channelizer" Model CGC36
- H. The Line Connection, "Dura-Post" Model DP36-3 (Permanent)
- I. The Line Connection, "Dura-Post" Model DP36-3C (Temporary)
- J. Repo, Models 300 and 400
- K. Safe-Hit, Guide Post, Model SH236SMA

CONICAL DELINEATORS, 1070 mm

(For 700 mm Traffic Cones, see Standard Specifications)

- A. Bent Manufacturing Company "T-Top"
- B. Plastic Safety Systems "Navigator-42"
- C. Roadmaker Company "Stacker"
- D. Traffix Devices "Grabber"

OBJECT MARKERS

Type "K", 450 mm

- A. Carsonite, Model SMD-615
- B. FlexStake, Model 701 KM
- C. Repo, Models 300 and 400
- D. Safe-Hit, Model SH718SMA
- E. The Line Connection, Model DP21-4K

Type "K-4" / "Q" Object Markers, 600 mm

- A. Bent Manufacturing "Masterflex" Model MF-360-24
- B. Carsonite, Super Duck II
- C. FlexStake, Model 701KM
- D. Repo, Models 300 and 400
- E. Safe-Hit, Models SH8 24SMA_WA and SH8 24GP3_WA
- F. The Line Connection, Model DP21-4Q

TEMPORARY RAILING (TYPE K) REFLECTORS AND CONCRETE BARRIER MARKERS

Impactable Type

- A. ARTUK, "FB"
- B. Davidson Plastics, Model PCBM-12
- C. Duraflex Corp., "Flexx 2020" and "Electriflexx"
- D. Hi-Way Safety, Inc., Model GMKRM100

Non-Impactable Type

- A. ARTUK, JD Series
- B. Stimsonite, Model 967 (with 83 mm Acrylic cube corner reflector)
- C. Stimsonite, Model 967LS
- D. Vega Molded Products, Models GBM and JD

THREE BEAM BARRIER MARKERS

(For use to the left of traffic)

- A. Duraflex Corp., "Railrider"
- B. Davidson Plastics, "Mini" (75 mm x 254 mm)

CONCRETE BARRIER DELINEATORS, 400 mm

(For use to the right of traffic. When mounted on top of barrier, places top of reflective element at 1200 mm)

- A. Davidson Plastics, Model PCBM T-16
- B. Safe-Hit, Model SH216RBM
- C. Sun-Lab Technology, "Safety Guide Light, Model TM," 130 mm x 130 mm x 80 mm

CONCRETE BARRIER-MOUNTED MINI-DRUM (260 mm x 360 mm x 570 mm)

- A. Stinson Equipment Company "SaddleMarker"

SOUND WALL DELINEATOR

(Applied vertically. Place top of 75 mm x 300 mm reflective element at 1200 mm above roadway)

- A. Davidson Plastics, PCBM S-36
- B. Sun-Lab Technology, "Safety Guide Light, Model SM12," 130 mm x 130 mm x 80 mm

GUARD RAILING DELINEATOR

(Top of reflective element at 1200 mm above plane of roadway)

Wood Post Type, 686 mm

- A. Carsonite, Model 427
- B. Davidson Plastics FG 427 and FG 527
- C. FlexStake, Model 102 GR
- D. GreenLine GRD 27
- E. J.Miller Model JMI-375G
- F. Safe-Hit, Model SH227GRD

Steel Post Type

- A. Carsonite, Model CFGR-327 with CFGRBK300 Mounting Bracket

RETROREFLECTIVE SHEETING

Channelizers, Barrier Markers, and Delineators

- A. 3M, High Intensity
- B. Reflexite, PC-1000 Metalized Polycarbonate
- C. Reflexite, AC-1000 Acrylic
- D. Reflexite, AP-1000 Metalized Polyester
- E. Reflexite, AR-1000 Abrasion Resistant Coating
- F. Avery Dennison T-6500 Series (Formerly Stimsonite, Series 6200) (For rigid substrate devices only)

Traffic Cones, 330 mm Sleeves

- A. Reflexite SB (Polyester), Vinyl or "TR" (Semi-transparent)

Traffic Cones, 100 mm and 150 mm Sleeves

- A. 3M Series 3840
- B. Reflexite Vinyl, "TR" (Semi-transparent) or "Conformalite"

Barrels and Drums

- A. Reflexite, "Super High Intensity" or "High Impact Drum Sheeting"
- B. 3M Series 3810

Barricades: Type I, Engineer Grade

- A. American Decal, Adcolite
- B. Avery Dennison, T-1500 and T-1600
- C. 3M, Scotchlite, Series CW

Barricades: Type II, Super Engineer Grade

- A. Avery Dennison, T-2500 Series
- B. Kiwalite Type II
- C. Nikkalite 1800 Series

Signs: Type II, Super Engineer Grade

- A. Avery Dennison, T-2500 Series
- B. Kiwalite, Type II
- C. Nikkalite 1800 Series

Signs: Type III, High-Intensity Grade

- A. 3M Series 3800
- B. Nippon Carbide, Nikkalite Brand Ultralite Grade II

Signs: Type IV, High-Intensity Prismatic Grade

- A. Avery Dennison T-6500 (Formerly Stimsonite Series 6200)

Signs: Type VII, High-Intensity Prismatic Grade

- A. 3M Series 3900

Signs: Type VI, Roll-Up Signs

- A. Reflexite, Vinyl (Orange)
- B. Reflexite "SuperBright" (Fluorescent orange)
- C. Reflexite "Marathon" (Fluorescent orange)
- D. 3M Series RS34 (Orange) and RS20 (Fluorescent orange)

SPECIALTY SIGN (All Plastic)

- A. All Sign Products, STOP Sign, 750 mm

SIGN SUBSTRATE FOR CONSTRUCTION AREA SIGNS

Aluminum

Fiberglass Reinforced Plastic (FRP)

- A. Sequentia, "Polyplate"
- B. Fiber-Brite

8-1.03 SLAG AGGREGATE

Aggregate produced from slag resulting from any steel-making process or from air-cooled iron blast furnace slag shall not be used on this project.

SECTION 8-2. CONCRETE

8-2.01 PORTLAND CEMENT CONCRETE

Portland cement concrete shall conform to the provisions in Section 90, "Portland Cement Concrete" of the Standard Specifications and these special provisions.

References to Section 90-2.01, "Portland Cement," of the Standard Specifications shall mean Section 90-2.01, "Cement," of the Standard Specifications.

Mineral admixture shall be combined with cement in conformance with the provisions in Section 90-4.08, "Required Use of Mineral Admixtures," of the Standard Specifications for the concrete materials specified in Section 56-2, "Roadside Signs," of the Standard Specifications.

The requirements of Section 90-4.08, "Required Use of Mineral Admixture," of the Standard Specifications shall not apply to Section 19-3.025C, "Soil Cement Bedding," of the Standard Specifications.

SECTION 8-3. (BLANK)

SECTION 9. (BLANK)

SECTION 10. CONSTRUCTION DETAILS

SECTION 10-1. GENERAL

10-1.01 ORDER OF WORK

Order of work shall conform to the provisions in Section 5-1.05, "Order of Work," of the Standard Specifications and these special provisions.

Conduit shall be installed prior to the installation of concrete sidewalk.

Not less than 60 days prior to planting the plants, the Contractor shall furnish the Engineer a statement from the vendor that the order for the plants required for this contract, including inspection plants, has been received and accepted by the vendor. The statement from the vendor shall include the names, sizes, and quantities of plants ordered and the anticipated date of delivery.

The Contractor shall place orders for replacement plants with the vendor at the appropriate time so that the roots of the replacement plants are not in a root-bound condition.

Attention is directed to "Maintain Existing Plants" of these special provisions regarding checking for deficiencies of existing plants that are to remain in place, prior to the start of irrigation work.

Attention is directed to "Irrigation Systems Functional Test" of these special provisions, regarding restrictions for planting operations.

Attention is directed to "Locate Existing Crossovers and Conduits" of these special provisions regarding locating existing irrigation water line crossovers and conduits shown on the plans to be incorporated in the new work. Existing irrigation water line crossovers and conduits shall be located prior to performing work on the irrigation system.

Unless otherwise shown on the plans or specified in these special provisions, conduits to be installed by the open trench method for water line crossovers and sprinkler control crossovers shall be installed prior to the installation of other pipe supply lines.

Attention is directed to "Existing Highway Irrigation Facilities" of these special provisions regarding the checking of existing irrigation facilities that are to remain in place, prior to the start of any irrigation work.

Clearing, grubbing, and earthwork operations shall not be performed in areas where existing irrigation facilities are to remain in place until existing irrigation facilities have been checked for proper operation in conformance with the provisions in "Highway Planting and Irrigation Systems" of these special provisions.

Attention is directed to Section 20-5.027B, "Wiring Plans and Diagrams," of the Standard Specifications regarding submittal of working drawings.

10-1.02 WATER POLLUTION CONTROL

Water pollution control work shall conform to the provisions in Section 7-1.01G, "Water Pollution," of the Standard Specifications and these special provisions.

Water pollution control work shall conform to the requirements in the Construction Contractor's Guide and Specifications of the Caltrans Storm Water Quality Handbooks, dated April 1997, and addenda thereto issued up to and including the date of advertisement of the project, hereafter referred to as the "Handbook." Copies of the Handbook may be obtained from the Department of Transportation, Material Operations Branch, Publication Distribution Unit, 1900 Royal Oaks Drive, Sacramento, California 95815, Telephone: (916) 445-3520.

Copies of the Handbook are also available for review at Department of Transportation, District 8 Environmental Technical Branch, 464 West Fourth Street, San Bernardino, CA 92401.

The Contractor shall know and fully comply with the applicable provisions of the Handbook and Federal, State, and local regulations that govern the Contractor's operations and storm water discharges from both the project site and areas of disturbance outside the project limits during construction.

Unless arrangements for disturbance of areas outside the project limits are made by the Department and made part of the contract, it is expressly agreed that the Department assumes no responsibility whatsoever to the Contractor or property owner with respect to any arrangements made between the Contractor and property owner to allow disturbance of areas outside the project limits.

The Contractor shall be responsible for the costs and for liabilities imposed by law as a result of the Contractor's failure to comply with the requirements set forth in this section "Water Pollution Control" including, but not limited to, compliance with the applicable provisions of the Handbook and Federal, State, and local regulations. For the purposes of this paragraph, costs and liabilities include, but are not limited to, fines, penalties, and damages whether assessed against the State or the Contractor, including those levied under the Federal Clean Water Act and the State Porter Cologne Water Quality Act.

In addition to the remedies authorized by law, an amount of the money due the Contractor under the contract, as determined by the Department, may be retained by the State of California until disposition has been made of the costs and liabilities.

The retention of money due the Contractor shall be subject to the following:

- A. The Department will give the Contractor 30 days notice of the Department's intention to retain funds from partial payments which may become due to the Contractor prior to acceptance of the contract. Retention of funds from payments made after acceptance of the contract may be made without prior notice to the Contractor.
- B. No retention of additional amounts out of partial payments will be made if the amount to be retained does not exceed the amount being withheld from partial payments pursuant to Section 9-1.06, "Partial Payments," of the Standard Specifications.
- C. If the Department has retained funds and it is subsequently determined that the State is not subject to the costs and liabilities in connection with the matter for which the retention was made, the Department shall be liable for interest on the amount retained at the legal rate of interest for the period of the retention.

Conformance with the provisions in this section "Water Pollution Control" shall not relieve the Contractor from the Contractor's responsibilities as provided in Section 7, "Legal Relations and Responsibilities," of the Standard Specifications.

WATER POLLUTION CONTROL PROGRAM PREPARATION, APPROVAL AND UPDATES

As part of the water pollution control work, a Water Pollution Control Program, hereafter referred to as the "WPCP," is required for this contract. The WPCP shall conform to the provisions in Section 7-1.01G, "Water Pollution," of the Standard Specifications, the requirements in the Handbook, and these special provisions.

No work having potential to cause water pollution, as determined by the Engineer, shall be performed until the WPCP has been approved by the Engineer.

Within 30 days after the approval of the contract, the Contractor shall submit 3 copies of the WPCP to the Engineer. The Engineer will have 7 days to review the WPCP. If revisions are required, as determined by the Engineer, the Contractor shall revise and resubmit the WPCP within 7 days of receipt of the Engineer's comments. The Engineer will have 7 days to review the revisions. Upon the Engineer's approval of the WPCP, 3 additional copies of the WPCP incorporating the required changes shall be submitted to the Engineer. Minor changes or clarifications to the initial submittal may be made and attached as amendments to the WPCP. In order to allow construction activities to proceed, the Engineer may conditionally approve the WPCP while minor revisions or amendments are being completed.

The WPCP shall identify pollution sources that may adversely affect the quality of storm water discharges associated with the project and shall identify water pollution control measures, hereafter referred to as control measures, to be constructed, implemented, and maintained in order to reduce to the extent feasible pollutants in storm water discharges from the construction site during construction under this contract.

The WPCP shall incorporate control measures in the following categories:

- A. Soil stabilization practices;
- B. Sediment control practices;
- C. Sediment tracking control practices;
- D. Wind erosion control practices; and
- E. Nonstorm water management and waste management and disposal control practices.

Specific objectives and minimum requirements for each category of control measures are contained in the Handbook.

The Contractor shall consider the objectives and minimum requirements presented in the Handbook for each of the above categories. When minimum requirements are listed for any category, the Contractor shall incorporate into the WPCP and implement on the project, one or more of the listed minimum controls required in order to meet the pollution control objectives for the category. In addition, the Contractor shall consider other control measures presented in the Handbook and shall incorporate into the WPCP and implement on the project the control measures necessary to meet the objectives of the WPCP. The Contractor shall document the selection process in conformance with the procedure specified in the Handbook.

The WPCP shall include, but not be limited to, the following items as described in the Handbook:

- A. Project description and Contractor's certification;
- B. Project information;
- C. Pollution sources, control measures, and water pollution control drawings; and
- D. Amendments, if any.

The Contractor shall amend the WPCP, graphically and in narrative form, whenever there is a change in construction activities or operations which may affect the discharge of significant quantities of pollutants to surface waters, ground waters, municipal storm drain systems or when deemed necessary by the Engineer. The WPCP shall be amended if the WPCP has not achieved the objective of reducing pollutants in storm water discharges. Amendments shall show additional control measures or revised operations, including those in areas not shown in the initially approved WPCP, which are required on the project to control water pollution effectively. Amendments to the WPCP shall be submitted for review and approval by the Engineer in the same manner specified for the initially approved WPCP. Amendments shall be dated and attached to the on-site WPCP document.

The Contractor shall keep a copy of the WPCP, together with updates, revisions and amendments at the project site.

WPCP IMPLEMENTATION

Upon approval of the WPCP, the Contractor shall be responsible throughout the duration of the project for installing, constructing, inspecting, and maintaining the control measures included in the WPCP and any amendments thereto and for removing and disposing of temporary control measures. Unless otherwise directed by the Engineer or specified in these special provisions, the Contractor's responsibility for WPCP implementation shall continue throughout any temporary suspension of work ordered in conformance with the provisions in Section 8-1.05, "Temporary Suspension of Work," of the Standard Specifications. Requirements for installation, construction, inspection, maintenance, removal, and disposal of control measures are specified in the Handbook and these special provisions.

Soil stabilization practices and sediment control measures, including minimum requirements, shall be provided throughout the winter season, defined as between November 1 and March 15.

Implementation of soil stabilization practices and sediment control measures for soil-disturbed areas on the project site shall be completed, except as provided for below, not later than 20 days prior to the beginning of the winter season or upon start of applicable construction activities for projects which begin either during or within 20 days of the winter season.

Throughout the winter season, the active, soil-disturbed area of the project site shall be not more than 1.9 hectares. The Engineer may approve, on a case-by-case basis, expansions of the active, soil-disturbed area limit. The Contractor shall demonstrate the ability and preparedness to fully deploy soil stabilization practices and sediment control measures to protect soil-disturbed areas on the project site before the onset of precipitation. A quantity of soil stabilization and sediment control materials shall be maintained on site equal to 100 percent of that sufficient to protect unprotected, soil-disturbed areas on the project site. A detailed plan for the mobilization of sufficient labor and equipment shall be maintained to fully deploy control measures required to protect unprotected, soil-disturbed areas on the project site prior to the onset of precipitation. A current inventory of control measure materials and the detailed mobilization plan shall be included as part of the WPCP.

Throughout the winter season, soil-disturbed areas on the project site shall be considered to be nonactive whenever soil disturbing activities are expected to be discontinued for a period of 20 or more days and the areas are fully protected. Areas that will become nonactive either during the winter season or within 20 days thereof shall be fully protected with soil stabilization practices and sediment control measures within 10 days of the discontinuance of soil disturbing activities or prior to the onset of precipitation, whichever is first to occur.

Throughout the winter season, active soil-disturbed areas of the project site shall be fully protected at the end of each day with soil stabilization practices and sediment control measures unless fair weather is predicted through the following work day. The weather forecast shall be monitored by the Contractor on a daily basis. The National Weather Service forecast shall be used. An alternative weather forecast proposed by the Contractor may be used if approved by the Engineer. If precipitation is predicted prior to the end of the following work day, construction scheduling shall be modified, as required, and functioning control measures shall be deployed prior to the onset of the precipitation.

The Contractor shall implement, year-round and throughout the duration of the project, control measures included in the WPCP for sediment tracking, wind erosion, nonstorm water management, and waste management and disposal.

The Engineer may order the suspension of construction operations which create water pollution if the Contractor fails to conform to the provisions in this section "Water Pollution Control" as determined by the Engineer.

MAINTENANCE

To ensure the proper implementation and functioning of control measures, the Contractor shall regularly inspect and maintain the construction site for the control measures identified in the WPCP. The Contractor shall identify corrective actions and time needed to address any deficient measures or reinstate any measures that have been discontinued.

The construction site inspection checklist provided in the Handbook shall be used to ensure that the necessary measures are being properly implemented, and to ensure that the control measures are functioning adequately. One copy of each site inspection record shall be submitted to the Engineer.

During the winter season, inspections of the construction site shall be conducted by the Contractor to identify deficient measures, as follows:

- A. Prior to a forecast storm;
- B. After all precipitation which causes runoff capable of carrying sediment from the construction site;
- C. At 24-hour intervals during extended precipitation events; and
- D. Routinely, at a minimum of once every 2 weeks.

If the Contractor or the Engineer identifies a deficiency in the deployment or functioning of an identified control measure, the deficiency shall be corrected immediately. The deficiency may be corrected at a later date and time if requested by the Contractor and approved by the Engineer in writing, but not later than the onset of subsequent precipitation events. The correction of deficiencies shall be at no additional cost to the State.

PAYMENT

Full compensation for conforming to the provisions in this section shall be considered as included in the prices paid for the various contract items of work involved and no additional compensation will be allowed therefor.

The Engineer will retain an amount equal to 25 percent of the estimated value of the contract work performed during estimate periods in which the Contractor fails to conform to the provisions in this section "Water Pollution Control" as determined by the Engineer.

Retentions for failure to conform to the provisions in this section "Water Pollution Control" shall be in addition to the other retentions provided for in the contract. The amounts retained for failure of the Contractor to conform to the provisions in this

section will be released for payment on the next monthly estimate for partial payment following the date that a WPCP has been implemented and maintained and water pollution is adequately controlled, as determined by the Engineer.

10-1.03 PRESERVATION OF PROPERTY

Attention is directed to Section 7-1.11, "Preservation of Property," of the Standard Specifications and these special provisions.

Existing trees, and turf that are not to be removed and are injured or damaged by reason of the Contractor's operations, shall be replaced by the Contractor. The minimum size of tree replacement shall be No. 15 container. Replacement turf shall be of sod. Replacement planting shall conform to the requirements in Section 20-4.07, "Replacement," of the Standard Specifications. The Contractor shall water replacement plants in conformance with the provisions in Section 20-4.06, "Watering," of the Standard Specifications.

Damaged or injured plants shall be removed and disposed of outside the highway right of way in conformance with the provisions in Section 7-1.13 of the Standard Specifications. At the option of the Contractor, removed trees and shrubs may be reduced to chips. The chipped material shall be spread within the highway right of way at locations designated by the Engineer.

Replacement planting of injured or damaged trees, and other plants shall be completed prior to the start of the plant establishment period. Replacement planting shall conform to the provisions in Section 20-4.05, "Planting," of the Standard Specifications.

10-1.04 RELIEF FROM MAINTENANCE AND RESPONSIBILITY

The Contractor may be relieved of the duty of maintenance and protection for those items not directly connected with plant establishment work, except highway planting and irrigation systems in conformance with the provisions in Section 7-1.15, "Relief From Maintenance and Responsibility," of the Standard Specifications.

10-1.05 PROGRESS SCHEDULE

Progress schedules are required for this contract and shall be submitted in conformance with the provisions in Section 8-1.04, "Progress Schedule," of the Standard Specifications and these special provisions, unless otherwise authorized in writing by the Engineer.

The second paragraph of Section 8-1.04, "Progress Schedule," of the Standard Specifications shall not apply.

10-1.06 OBSTRUCTIONS

Attention is directed to Section 8-1.10, "Utility and Non-Highway Facilities," and Section 15, "Existing Highway Facilities," of the Standard Specifications and these special provisions.

The Contractor shall notify the Engineer and the appropriate regional notification center for operators of subsurface installations at least 2 working days, but not more than 14 calendar days, prior to performing any excavation or other work close to any underground pipeline, conduit, duct, wire or other structure. Regional notification centers include, but are not limited to, the following:

Notification Center	Telephone Number
Underground Service Alert-Northern California (USA)	1-800-642-2444
	1-800-227-2600
Underground Service Alert-Southern California (USA)	1-800-422-4133
	1-800-227-2600

10-1.07 CONSTRUCTION AREA TRAFFIC CONTROL DEVICES

Flagging, signs, and all other traffic control devices furnished, installed, maintained, and removed when no longer required shall conform to the provisions in Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications and these special provisions.

Category 1 traffic control devices are defined as those devices that are small and lightweight (less than 45 kg), and have been in common use for many years. The devices shall be known to be crashworthy by crash testing, crash testing of similar devices, or years of demonstrable safe performance. Category 1 traffic control devices include traffic cones, plastic drums, portable delineators, and channelizers.

If requested by the Engineer, the Contractor shall provide written self-certification for crashworthiness of Category 1 traffic control devices. Self-certification shall be provided by the manufacturer or Contractor and shall include the following: date, Federal Aid number (if applicable), expenditure authorization, district, county, route and kilometer post of project limits; company name of certifying vendor, street address, city, state and zip code; printed name, signature and title of certifying

person; and an indication of which Category 1 traffic control devices will be used on the project. The Contractor may obtain a standard form for self-certification from the Engineer.

Category 2 traffic control devices are defined as those items that are small and lightweight (less than 45 kg), that are not expected to produce significant vehicular velocity change, but may otherwise be potentially hazardous. Category 2 traffic control devices include: barricades and portable sign supports.

Category 2 devices purchased on or after October 1, 2000 shall be on the Federal Highway Administration (FHWA) Acceptable Crashworthy Category 2 Hardware for Work Zones list. This list is maintained by FHWA and can be located at the following internet address: <http://safety.fhwa.dot.gov/fourthlevel/hardware/listing.cfm?code=workzone>. The Department maintains a secondary list at the following internet address: <http://www.dot.ca.gov/hq/traffops/signtech/signdel/pdf/htm>.

Category 2 devices that have not received FHWA acceptance, and were purchased before October 1, 2000, may continue to be used until they complete their useful service life or until January 1, 2003, whichever comes first. Category 2 devices in use that have received FHWA acceptance shall be labeled with the FHWA acceptance letter number and the name of the manufacturer by the start of the project. The label shall be readable. After January 1, 2003, all Category 2 devices without a label shall not be used on the project.

Full compensation for providing self-certification for crashworthiness of Category 1 traffic control devices and labeling Category 2 devices as specified shall be considered as included in the prices paid for the various contract items of work requiring the use of the Category 1 or Category 2 traffic control devices and no additional compensation will be allowed therefor.

10-1.08 CONSTRUCTION AREA SIGNS

Construction area signs shall be furnished, installed, maintained, and removed when no longer required in conformance with the provisions in Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications and these special provisions.

Attention is directed to the provisions in "Prequalified and Tested Signing and Delineation Materials" of these special provisions. Type II retroreflective sheeting shall not be used on construction area sign panels.

The Contractor shall notify the appropriate regional notification center for operators of subsurface installations at least 2 working days, but not more than 14 calendar days, prior to commencing excavation for construction area sign posts. The regional notification centers include, but are not limited to, the following:

Notification Center	Telephone Number
Underground Service Alert-Northern California (USA)	1-800-642-2444 1-800-227-2600
Underground Service Alert-Southern California (USA)	1-800-422-4133 1-800-227-2600

Excavations required to install construction area signs shall be performed by hand methods without the use of power equipment, except that power equipment may be used if it is determined there are no utility facilities in the area of the proposed post holes.

Sign substrates for stationary mounted construction area signs may be fabricated from fiberglass reinforced plastic as specified under "Prequalified and Tested Signing and Delineation Materials" of these special provisions.

10-1.09 MAINTAINING TRAFFIC

Attention is directed to Sections 7-1.08, "Public Convenience," 7-1.09, "Public Safety," and 12, "Construction Area Traffic Control Devices," of the Standard Specifications and to the provisions in "Public Safety" of these special provisions and these special provisions. Nothing in these special provisions shall be construed as relieving the Contractor from the responsibilities specified in Section 7-1.09.

No work that would require a lane closure shall be performed.

Personal vehicles of the Contractor's employees shall not be parked within the right of way except within the rest areas. Whenever vehicles or equipment are parked on the shoulder within 1.8 m of a traffic lane, the shoulder area shall be closed as shown on the plans. Lanes shall be closed only during the hours shown on the charts included in this section "Maintaining Traffic." Except work required under Sections 7-1.08 and 7-1.09, work that interferes with public traffic shall be performed only during the hours shown for lane closures.

Designated legal holidays are: January 1st, the third Monday in February, the last Monday in May, July 4th, the first Monday in September, November 11th, Thanksgiving Day, and December 25th. When a designated legal holiday falls on a Sunday, the following Monday shall be a designated legal holiday. When November 11th falls on a Saturday, the preceding Friday shall be a designated legal holiday.

Minor deviations from the requirements of this section concerning hours of work which do not significantly change the cost of the work may be permitted upon the written request of the Contractor, if in the opinion of the Engineer, public traffic will be better served and the work expedited. These deviations shall not be adopted by the Contractor until the Engineer has approved the deviations in writing. All other modifications will be made by contract change order.

10-1.10 TRAFFIC CONTROL SYSTEM FOR LANE CLOSURE

A traffic control system shall consist of closing traffic lanes and ramps in conformance with the details shown on the plans, the provisions in Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications, the provisions under "Maintaining Traffic" and "Construction Area Signs" of these special provisions, and these special provisions.

The provisions in this section will not relieve the Contractor from the responsibility to provide additional devices or take measures as may be necessary to comply with the provisions in Section 7-1.09, "Public Safety," of the Standard Specifications.

Each vehicle used to place, maintain and remove components of a traffic control system on multilane highways shall be equipped with a Type II flashing arrow sign which shall be in operation when the vehicle is being used for placing, maintaining or removing components. Vehicles equipped with Type II flashing arrow sign not involved in placing, maintaining or removing components when operated within a stationary lane closure shall only display the caution display mode. The sign shall be controllable by the operator of the vehicle while the vehicle is in motion. The flashing arrow sign shown on the plans shall not be used on vehicles which are being used to place, maintain and remove components of a traffic control system and shall be in place before a lane closure requiring its use is completed.

If components in the traffic control system are displaced or cease to operate or function as specified, from any cause, during the progress of the work, the Contractor shall immediately repair the components to the original condition or replace the components and shall restore the components to the original location.

When lane and ramp closures are made for work periods only, at the end of each work period, components of the traffic control system, except portable delineators placed along open trenches or excavation adjacent to the traveled way, shall be removed from the traveled way and shoulder. If the Contractor so elects, the components may be stored at selected central locations designated by the Engineer within the limits of the highway right of way.

The contract lump sum price paid for traffic control system shall include full compensation for furnishing all labor (except for flagging costs), materials (including signs), tools, equipment, and incidentals, and for doing all the work involved in placing, removing, storing, maintaining, moving to new locations, replacing and disposing of the components of the traffic control system shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer. Flagging costs will be paid for as provided in Section 12-2.02, "Flagging Costs," of the Standard Specifications.

10-1.11 TRAFFIC CONTROL SYSTEM FOR RAMP CLOSURES

At the times and locations specified under "Maintaining Traffic" of these special provisions, ramps shall be closed in conformance with the details shown on the plans, the provisions in Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications, according to Standard Plan T14, and these special provisions.

The provisions in this section will not relieve the Contractor of the responsibility to provide additional devices or take measures as may be necessary to comply with the provisions in Section 7-1.09, "Public Safety," of the Standard Specifications.

If components used for closing a ramp are displaced or cease to operate or function as specified, from any cause, during the progress of the work, the Contractor shall immediately repair the components to the original condition or replace the components and shall restore the components to the original location.

When ramp closures are made for work periods only, at the end of each work period, components used for the ramp closure, except portable delineators placed along open trenches or excavation adjacent to the traveled way, shall be removed from the traveled way and shoulder. If the Contractor so elects, the components may be stored at selected central locations designated by the Engineer within the limits of the highway right of way.

Full compensation for providing the ramp closures shown on the plans (including signs) shall be considered as included in the contract prices paid for the various items of work and no separate payment will be made therefor.

Chart No. 1 Ramp Lane Requirements																									
Location: 08-Riv.-10-KP 42.2																									
FROM HOUR TO HOUR	a.m.											p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9		10	11
Mondays through Thursdays	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
Fridays																									
Saturdays																									
Sundays																									
Day before designated legal holiday																									
Designated legal holidays																									
Legend:																									
<input type="checkbox"/> 1 Ramp may be closed																									
<input type="checkbox"/> No work that interferes with public traffic will be allowed																									
REMARKS: The ramp shall remain closed only during hours when the comfort station is closed.																									

10-1.12 TEMPORARY CRASH CUSHION MODULE

This work shall consist of furnishing, installing, and maintaining sand filled temporary crash cushion modules in groupings or arrays at each location shown on the plans, as specified in these special provisions or where designated by the Engineer. The grouping or array of sand filled modules shall form a complete sand filled temporary crash cushion in conformance with the details shown on the plans and these special provisions.

Attention is directed to "Public Safety" of these special provisions.

Whenever the work or the Contractor's operations establishes a fixed obstacle, the exposed fixed obstacle shall be protected with a sand filled temporary crash cushion. The sand filled temporary crash cushion shall be in place prior to opening the lanes adjacent to the fixed obstacle to public traffic.

Sand filled temporary crash cushions shall be maintained in place at each location, including times when work is not actively in progress. Sand filled temporary crash cushions may be removed during a work period for access to the work provided that the exposed fixed obstacle is 4.6 m or more from a lane carrying public traffic and the temporary crash cushion is reset to protect the obstacle prior to the end of the work period in which the fixed obstacle was exposed. When no longer required, as determined by the Engineer, sand filled temporary crash cushions shall be removed from the site of the work.

At the Contractor's option, the modules for use in sand filled temporary crash cushions shall be either Energite III Inertial Modules, Fitch Inertial Modules or Traffix Sand Barrels manufactured after March 31, 1997, or equal:

- A. Energite III and Fitch Inertial Modules, manufactured by Energy Absorption Systems, Inc., One East Wacker Drive, Chicago, IL 60601-2076. Telephone 1-312-467-6750, FAX 1-800-770-6755
 - 1. Distributor (North): Traffic Control Service, Inc., 8585 Thys Court, Sacramento, CA 95828. Telephone 1-800-884-8274, FAX 1-916-387-9734
 - 2. Distributor (South): Traffic Control Service, Inc., 1881 Betmor Lane, Anaheim, CA 92805. Telephone 1-800-222-8274, FAX 1-714-937-1070
- B. Traffix Sand Barrels, manufactured by Traffix Devices, Inc., 220 Calle Pinteroesco, San Clemente, CA 92672. Telephone 1-949 361-5663, FAX 1-949 361-9205
 - 1. Distributor (North): United Rentals, Inc., 1533 Berger Drive, San Jose, CA 95112. Telephone 1-408 287-4303, FAX 1-408 287-1929
 - 2. Distributor (South): Statewide Safety & Sign, Inc., P.O. Box 1440, Pismo Beach, CA 93448. Telephone 1-800-559-7080, FAX 1-805 929-5786

Modules contained in each temporary crash cushion shall be of the same type at each location. The color of the modules shall be the standard yellow color, as furnished by the vendor, with black lids. The modules shall exhibit good workmanship free from structural flaws and objectionable surface defects. The modules need not be new. Good used undamaged modules conforming to color and quality of the types specified herein may be utilized. If used Fitch modules requiring a seal are furnished, the top edge of the seal shall be securely fastened to the wall of the module by a continuous strip of heavy duty tape.

Modules shall be filled with sand in conformance with the manufacturer's directions, and to the sand capacity in kilograms for each module shown on the plans. Sand for filling the modules shall be clean washed concrete sand of commercial quality. At the time of placing in the modules, the sand shall contain not more than 7 percent water as determined by California Test 226.

Modules damaged due to the Contractor's operations shall be repaired immediately by the Contractor at the Contractor's expense. Modules damaged beyond repair, as determined by the Engineer, due to the Contractor's operations shall be removed and replaced by the Contractor at the Contractor's expense.

Temporary crash cushion modules shall be placed on movable pallets or frames conforming to the dimensions shown on the plans. The pallets or frames shall provide a full bearing base beneath the modules. The modules and supporting pallets or frames shall not be moved by sliding or skidding along the pavement or bridge deck.

A Type R or P marker panel shall be attached to the front of the crash cushion as shown on the plans, when the closest point of the crash cushion array is within 3.6 m of the traveled way. The marker panel, when required, shall be firmly fastened to the crash cushion with commercial quality hardware or by other methods determined by the Engineer.

At the completion of the project, temporary crash cushion modules, sand filling, pallets or frames, and marker panels shall become the property of the Contractor and shall be removed from the site of the work. Temporary crash cushion modules shall not be installed in the permanent work.

Temporary crash cushion modules placed in conformance with the provisions in "Public Safety" of these special provisions will not be measured nor paid for.

10-1.13 EXISTING HIGHWAY FACILITIES

The work performed in connection with various existing highway facilities shall conform to the provisions in Section 15, "Existing Highway Facilities," of the Standard Specifications and these special provisions.

EXISTING HIGHWAY IRRIGATION FACILITIES

Existing irrigation facilities within the limits of work shall remain in place. Irrigation facilities that are damaged by the Contractor's operation shall be reported immediately to the Engineer.

Existing below ground irrigation facilities will be marked by the Engineer. Marked Irrigation facilities injured or damaged by the Contractor's operations shall be repaired or replaced at the Contractor's expense. The replacement and repair of injured or damaged unmarked below ground irrigation facilities will be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications.

Water shall be maintained in conformance with the provisions in Section 20-5.025, "Maintain Existing Water Supply," of the Standard Specifications.

REMOVE PAVEMENT MARKING

Pavement markings to be removed shall be removed at the locations shown on the plans and at the locations designated by the Engineer.

REMOVE ROADSIDE SIGN

Existing roadside signs, at those locations shown on the plans to be removed, shall be removed and disposed of.

Existing roadside signs shall not be removed until replacement signs have been installed or until the existing signs are no longer required for the direction of public traffic, unless otherwise directed by the Engineer.

REMOVE CONCRETE

Concrete, and concrete raised planters where shown on the plans to be removed, shall be removed.

The pay quantities of concrete to be removed will be measured by the cubic meter, measured before and during removal operations. Removal of concrete raised planters shall be considered as included in the quantities of concrete to be removed.

Concrete and the concrete raised planters removed shall be disposed of outside the highway right of way in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

REMOVE REDWOOD HEADER AND REPAIR SIDEWALK

Existing redwood headers shown on the plans to be removed, shall be removed to a depth of 100 mm below the grade of the existing sidewalk. Resulting depressions shall be backfilled with concrete and expansion joints as shown on the plans.

This work shall be constructed in accordance with Section 73, "Concrete Curbs and Sidewalks", of the Standard Specifications. Expansion joints shall be filled with 6-mm thick premolded joint filler conforming to the provisions in Section 51-1.12C, "Premolded Expansion Joint Fillers," of the Standard Specifications.

Full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in removal of redwood headers and repairing sidewalk, complete in place, including earthwork and premolded joint filler, shall be considered as included in the contract price paid for Minor Concrete (Sidewalk) and no additional compensation will be allowed therefor.

REMOVE PICNIC TABLES

Existing picnic tables and benches to be removed shall be removed and disposed of.

Full compensation for removal and disposal of picnic tables and benches shall be considered as included in the contract unit price paid for prefabricated picnic tables and benches and no additional compensation will be allowed therefor.

REMOVE TREE

Trees designated on the plans to be removed, shall be removed and disposed of, including trunk and roots, to a minimum of 0.5 meters below the surface of existing grade.

Remove tree will be measured in the field by the actual count of removed trees.

The contract unit price paid for remove tree shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in removing existing trees, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.14 ROADSIDE SIGNS

Roadside signs shall be installed at the locations shown on the plans or where designated by the Engineer and in conformance with the provisions in Section 56-2, "Roadside Signs," of the Standard Specifications and these special provisions.

Wood posts shall be pressure treated after fabrication in conformance with the provisions in Section 58, "Preservative Treatment of Lumber, Timber and Piling," of the Standard Specifications with creosote, creosote coal tar solution, creosote petroleum solution (50-50), pentachlorophenol in hydrocarbon solvent, copper naphthenate, ammoniacal copper arsenate, or ammoniacal copper zinc arsenate. In addition to the preservatives listed above, Southern yellow pine may also be pressure treated with chromated copper arsenate. When other than one of the creosote processes is used, blocks shall have a minimum retention of 6.4 kg/m³, and need not be incised.

10-1.15 INSTALL ROADSIDE SIGN PANEL ON EXISTING POST

Roadside sign panels shall be installed on existing posts at the locations shown on the plans or where designated by the Engineer and in conformance with the provisions in Section 56-2.04, "Sign Panel Installation," of the Standard Specifications and these special provisions.

Cutting the ends of wood posts in the field and field application of wood preservatives shall conform to the provisions in the sixth paragraph in Section 56-2.02B, "Wood Posts," of the Standard Specifications.

Two holes shall be drilled in each existing post as required to provide a breakaway feature as shown on the plans.

Existing sign panels, as shown on the plans, shall be removed and disposed of as provided in Section 15, "Existing Highway Facilities," of the Standard Specifications.

Installing roadside sign panels on existing posts will be paid for by the unit as determined from actual count in place.

The contract unit price paid for install roadside sign panel on existing post shall include full compensation for furnishing all labor, materials (except State-furnished sign panels), tools, equipment, and incidentals, and for doing all the work involved in installing roadside sign panels on existing posts (including removing and disposing of existing sign panels and drilling holes in existing posts), complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.16 THERMOPLASTIC PAVEMENT MARKING

Thermoplastic pavement markings shall be applied in conformance with the provisions in Section 84, "Traffic Stripes and Pavement Markings," of the Standard Specifications and these special provisions.

Thermoplastic material shall conform to the requirements in State Specification 8010-19A.

10-1.17 EARTHWORK

Earthwork shall conform to the provisions in Section 19, "Earthwork," of the Standard Specifications and these special provisions.

Areas designated on the plans for installation of concrete shall be graded to form uniform, even surfaces that maintain the existing flow lines, slope gradients, and contours of the project site. Excess material shall be spread at adjacent locations as directed by the Engineer.

10-1.18 MISCELLANEOUS CONCRETE CONSTRUCTION

Minor concrete (sidewalk), minor concrete (exposed aggregate sidewalk) and minor concrete (mowstrip) shall conform to the provisions in Section 73, "Concrete Curbs and Sidewalks," of the Standard Specifications and these special provisions.

Curb ramp detectable warning surface shall conform to the details shown on the plans and shall not be constructed or installed on curb ramps with a slope that exceeds 6.67 percent. The finished surfaces of the detectable warning surface shall be free from blemishes.

Curb ramp detectable warning surface shall consist of raised truncated domes constructed or installed on curb ramps. Detectable warning surface, at the option of the Contractor, shall be either cast-in-place or stamped into the surface of the curb ramp, or shall be a prefabricated surface installed on the curb ramp. The color of the detectable warning surface shall be yellow conforming to Federal Standard No. 595B, Color No. 33538. Detectable warning surface, either cast-in-place or stamped into the surface of the curb ramp, shall be painted yellow in conformance with the provisions in Section 59-6, "Painting Concrete," of the Standard Specifications.

Prior to constructing curb ramps with a cast-in-place or stamped detectable warning surface, a test panel shall be constructed on the project site and shall be of a size not less than 600 mm by 600 mm. The test panel shall be constructed, finished and cured with the same materials, tools, equipment, and methods to be used in constructing the proposed permanent work. Additional test panels shall be constructed as necessary until a panel is produced which demonstrates, to the satisfaction of the Engineer, the ability of the selected procedure to produce a detectable warning surface that meets all of the specified requirements.

Full compensation for constructing or installing a curb ramp detectable warning surface shall be considered as included in the contract price paid per cubic meter for minor concrete (curb ramp) and no separate payment will be made therefor.

Aggregate for minor concrete (exposed aggregate sidewalk), minor concrete (sidewalk) and minor concrete (mowstrip) shall conform to the grading specified for fine aggregate in Section 90-3.03, "Fine Aggregate Grading," of the Standard Specifications. Aggregate for exposed aggregate surfacing shall conform to the following grading:

Sieve Sizes	Percentage Passing
12.7-mm	100
6.4-mm	40-60
3.2-mm	10-20

A sample 600 mm by 600 mm minor concrete (exposed aggregate sidewalk test panel) shall be submitted to the Engineer for written approval.

Welded wire fabric, and or steel dowels of the size and type shown on the plans shall conform to the provisions in Section 52, "Reinforcement," of the Standard Specifications, and shall be placed in the sidewalks and mowstrips as shown on the plans.

Aggregate base for sidewalks shall be Class 2 and shall conform to the provisions in Section 26, "Aggregate Bases," of the Standard Specifications.

Joint fillers shall conform to the provisions in section 51-1.12 B "filled joints" of the Standard Specifications. Sidewalks shown on the plans to receive exposed aggregate surfacing shall have a dense layer of aggregate, approximately 12.7-mm thick, broadcast uniformly over the wood floated surface. The layer shall be tamped into the surface to embed the top particles between 40 percent and 75 percent of their depth.

After the concrete matrix has set sufficiently to prevent dislodging or loosening of the exposed aggregate stones, all cement film and other loose material shall be cleaned from the exposed aggregate surfacing using stiff brooms and water.

An equivalent exposed aggregate finish produced by a concrete set retard method, when approved by the Engineer, may be used as an alternative to the procedure specified herein.

The contract prices paid per cubic meter (M3) for minor concrete (sidewalk) and minor concrete (exposed aggregate sidewalk) shall include full compensation for furnishing all labor, materials (including welded wire fabric, steel dowels, dowel sleeves, joint fillers, and aggregate for exposed aggregate sidewalk), tools, equipment, and incidentals, and for doing all the work involved in constructing side walks, and exposed aggregate sidewalks, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

The contract prices paid per meter (M) for minor concrete (mowstrip) shall include full compensation for furnishing all labor, materials (including welded wire fabric, steel dowels, dowel sleeves, joint fillers, tools, equipment, and incidentals,

and for doing all the work involved in constructing mowstrips complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.19 PREFABRICATED PICNIC TABLES AND BENCHES

Prefabricated picnic tables and benches shall be Natural Concrete Grey—color with an acid-etched textured finish. Prefabricated picnic tables with benches shall be of one piece construction and shall be reinforced with rebar, welded wire mesh and nylon fibers. The tables and benches shall meet state wheelchair accessibility requirements.

Prefabricated picnic tables and benches shall be measured by the count in place in the field.

The contract unit price paid for prefabricated picnic tables and benches shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in providing and installing prefabricated picnic table and benches, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.20 ROCK BLANKET (TYPE 2)

Rock blanket (type 2) shall be placed as shown on the plans and in conformance with these special provisions.

MATERIALS

Rock for the rock blanket shall be clean, smooth rock obtained from a single source. Rock shall be multi-colored, similar in appearance to the rock veneer facing of the existing comfort station.

Rock for the rock blanket shall conform to the following grading:

Screen Size (Millimeters)	Percentage Passing (By Mass)
300x 300	100
200 x 200	0

A sample of the rock shall be submitted to the Engineer for approval prior to delivery of the rock to the project site.

MEASUREMENT AND PAYMENT

Rock blanket (type 2) will be measured by the square meter as determined from actual measurements made parallel to the ground slope.

The contract price paid per square meter for rock blanket (type 2) shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in placing rock blanket, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.21 ROCK OUTCROPPINGS

Rock outcroppings shall be placed and sized as shown on the plans in accordance with these special provisions. Rock to be used for rock outcroppings shall be multi-colored rock similar in appearance to the existing rock veneer wall facing of the existing comfort station. All rock tentatively selected for use as rock outcroppings by the Contractor shall be approved by the Engineer prior to use. Approval or rejection of rock submitted for the Engineer’s inspection will be provided within 3 working days following inspection. The exposed surface of the rock outcroppings shall be free of debris. Any debris adhering to the exposed surfaces of the rock shall be removed.

Boulders shall be placed so that approximately 1/3 to 1/2 of the boulder is below finish grade.

Rock outcroppings will be measured by the unit. Each grouping of rock outcroppings will be considered a single unit, as determined from actual count of the groupings constructed.

The contract unit price paid for rock outcroppings shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in constructing rock outcroppings, complete in place, as shown on the plans, as specified in these provisions, and as directed by the Engineer.

10-1.22 IRRIGATION CROSSOVERS

Irrigation crossovers shall conform to the provisions in Section 20-5, "Irrigation Systems," of the Standard Specifications and these special provisions.

Conduits shall be placed in open trenches in conformance with the provisions in Section 20-5.03B, "Conduit for Irrigation Crossovers," of the Standard Specifications.

Conduits shall be corrugated high density polyethylene (CHDPE) pipe. Corrugated high density polyethylene pipe shall conform to the requirements in ASTM Designation: F 405 or F 667, or AASHTO Designation: M 252 or M 294 and shall be Type S. Couplings and fittings shall be as recommended by the pipe manufacturer.

Water line crossovers shall conform to the provisions in Section 20-5.03C, "Water Line Crossovers," of the Standard Specifications.

Sprinkler control crossovers shall conform to the provisions in Section 20-5.027D, "Sprinkler Control Crossovers," of the Standard Specifications.

Installation of pull boxes shall conform to the provisions in Section 20-5.027I, "Conductors, Electrical Conduit and Pull Boxes," of the Standard Specifications. When no conductors are installed in electrical conduits, pull boxes for irrigation crossovers shall be installed on a foundation of compacted soil.

SECTION 10-2 HIGHWAY PLANTING AND IRRIGATION SYSTEMS

10-2.01 GENERAL

The work performed in connection with highway planting and irrigation systems shall conform to the provisions in Section 20, "Erosion Control and Highway Planting," of the Standard Specifications and these special provisions.

The Contractor shall notify the Engineer not less than 72 hours prior to requiring initial access to the existing irrigation controllers. When the Engineer determines that access to the controllers is required at other times, arrangements will be made to provide this access.

PROGRESS INSPECTIONS

Progress inspections will be performed by the Engineer for completed highway planting and irrigation system work at designated stages during the life of the contract.

Progress inspections will not relieve the Contractor of responsibility for installation in conformance with the special provisions, plans and Standard Specifications. Work within an area shall not progress beyond each stage until the inspection has been completed, corrective work has been performed, and the work is approved, unless otherwise permitted by the Engineer.

The requirements for progress inspections will not preclude additional inspections of work by the Engineer at other times during the life of the contract.

The Contractor shall notify the Engineer, in writing, at least 4 working days prior to completion of the work for each stage of an area and shall allow a minimum of 3 working days for the inspection.

Progress inspections will be performed at the following stages of work:

- A. During pressure testing of the pipelines on the supply side of control valves.
- B. During testing of low voltage conductors.
- C. Before planting begins and after completion of the work specified for planting in Section 20-4.03, "Preparing Planting Areas," of the Standard Specifications.
- D. Before plant establishment work begins and after completion of the work specified for planting in Section 20-4.05, "Planting," of the Standard Specifications.
- E. At intervals of one month during the plant establishment period.

COST BREAK-DOWN

The Contractor shall furnish the Engineer a cost break-down for the contract lump sum items of highway planting and irrigation system.

Cost break-downs shall be completed and furnished in the format shown in the samples of the cost break-downs included in this section. Unit descriptions of work shown in the samples are the minimum to be submitted. Additional unit descriptions of work may be designated by the Contractor. If the Contractor elects to designate additional unit descriptions of work, the quantity, value and amount for those units shall be completed in the same manner as for the unit descriptions shown in the samples. The units and quantities given in the samples are to show the manner of preparing the cost break-downs to be furnished by the Contractor.

The Contractor shall determine the quantities required to complete the work shown on the plans. The quantities and their values shall be included in the cost break-downs submitted to the Engineer for approval. The Contractor shall be responsible for the accuracy of the quantities and values used in the cost break-downs submitted for approval.

No adjustment in compensation will be made in the contract lump sum prices paid for highway planting and irrigation system due to differences between the quantities shown in the cost break-downs furnished by the Contractor and the quantities required to complete the work as shown on the plans and as specified in these special provisions.

The sum of the amounts for the units of work listed in each cost break-down for highway planting and irrigation system work shall be equal to the contract lump sum price bid for the work. Overhead and profit shall be included in each individual unit listed in each cost break-down. Cost break-downs shall be submitted to the Engineer for approval within 15 working

days after the contract has been approved. Cost break-downs shall be approved, in writing, by the Engineer before a partial payment for the items of highway planting and irrigation system will be made.

Approved cost break-downs will be used to determine partial payments during the progress of the work and as the basis of calculating the adjustment in compensation for the items of highway planting and irrigation system due to changes ordered by the Engineer. When an ordered change increases or decreases the quantities of an approved cost break-down, the adjustment in compensation will be determined in the same manner specified for increases and decreases in the quantity of a contract item of work in conformance with the provisions in Section 4-1.03B, "Increased or Decreased Quantities," of the Standard Specifications.

HIGHWAY PLANTING COST BREAK-DOWN

Contract No. 08-456201

UNIT DESCRIPTION	UNIT	APPROXIMATE QUANTITY	VALUE	AMOUNT
Roadside Clearing	LS	Lump Sump		
Cultivate (Soil Amendment)	M2	1,972		
Turf (Group T)	M2	1,972		
Plant (Group F)	EA	878		
Remove Existing Lawn (Sod) for Trenching	LS	Lump Sum		

TOTAL _____

IRRIGATION SYSTEM COST BREAK-DOWN

Contract No. 08-456201

UNIT DESCRIPTION	UNIT	APPROXIMATE QUANTITY	VALUE	AMOUNT
Check and Test Existing Irrigation System	LS	Lump Sum		
Remove Existing Irrigation System	LS	Lump Sum		
Maintain Existing Irrigation System	LS	Lump Sum		
Control and Neutral Conductors	LS	Lump Sum		
20 mm Electric Remote Control Valve	EA	8		
25 mm Electric Remote Control Valve	EA	8		
32 mm Electric Remote Control Valve	EA	2		
75 mm Electric Remote Control Valve(Master)	EA	1		
20 mm Plastic Pipe (PR200) (Supply Line)	M	425		
25 mm Plastic Pipe (PR200)(Supply Line)	M	20		
32 mm Plastic Pipe (PR200) (Supply Line)	M	45		
40 mm Plastic Pipe (PR200) (Supply Line)	M	127		
50 mm Plastic Pipe (SCH40)(Supply Line)	M	100		
75 mm Plastic Pipe (PR315) (Supply Line)	M	50		
Sprinkler (Type A-6)	EA	35		
Sprinkler (Type B-2)	EA	53		
50 mm Gate Valve	EA	4		
75 mm Gate Valve	EA	3		

TOTAL _____

10-2.02 EXISTING HIGHWAY PLANTING

In addition to the provisions in Section 20 of the Standard Specifications, work performed in connection with existing highway planting shall be in conformance with the provisions in Section 15, "Existing Highway Facilities," of the Standard Specifications and these special provisions.

Replacement planting shall conform to the requirements specified under "Preservation of Property" of these special provisions.

MAINTAIN EXISTING PLANTS

Existing plants shall be maintained throughout the life of the contract in conformance with these special provisions.

Existing turf shall be watered in conformance with the provisions in Section 20-4.06, "Watering," of the Standard Specifications.

Existing turf to be maintained shall be inspected for deficiencies by the Contractor in the presence of the Engineer. Deficiencies requiring corrective action shall include, but are not necessarily limited to, dead, diseased, or unhealthy turf. The inspection shall be completed within 10 working days after the start of work.

Existing turf shall be fertilized two times during the life of the contract when directed by the Engineer at the rates shown on plans for proposed turf and the type specified under "commercial fertilizer" for plant establishment in these special provisions.

When the existing turf has reached a height of 38 mm the turf shall be mowed to a height of 25 mm. Turf edges, including edges adjacent to sidewalks, concrete mow strips and other paved borders and surfaced areas, shall be trimmed to a uniform edge not extending beyond the edge of turf or the facilities. Mowed and trimmed growth shall be removed and disposed of outside the highway right of way in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications. Trimming shall be repeated whenever the edge of turf exceeds 25 mm.

When directed by the Engineer, deficiencies found during the inspection shall be corrected within 10 working days after the inspection. Correction of deficiencies, as directed by the Engineer, will be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications.

After initial deficiencies have been corrected as directed by the Engineer, the Contractor shall continue to maintain existing plants as often as necessary to maintain the area in a neat appearance. The work shall include but not limited to the following:

- A. Weed growth shall be killed before the weeds reach the seed stage of growth or exceed 38 mm in length.
- B. Trash, debris and weeds shall be removed from existing areas.
- C. When a portion of a new automatic irrigation system is completed, the existing plants to be watered by that portion of the irrigation system shall be watered automatically.
- D. Pesticides for maintaining existing plants shall conform to the provisions in "Pesticides" of these special provisions.

If after completion of the initial inspection and correction of deficiencies, the Engineer determines that existing plants show signs of failure to grow, or are so injured or damaged as to render the plants unsuitable for the purpose intended, the existing plants shall be replaced. Removal, disposal and replacement of the existing plants, shall be in conformance with the provisions in "Preservation of Property" of these special provisions.

REMOVE EXISTING LAWN (SOD) FOR TRENCHING

Existing lawn (sod) shall be removed for trenching and replaced in conformance with the provisions in Section 20-4, "Highway Planting," of the Standard Specifications and these special provisions.

When pipe supply lines are to be installed by trenching in lawn areas, existing sod shall be removed prior to the start of trenching operations. Trench widths across existing lawn areas shall not exceed 300 mm.

Removed sod shall be disposed of outside the highway right of way in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications. New sod of a variety similar to the existing lawn shall be furnished and placed over the backfilled trenches. The work for replaced sod shall conform to the following:

- A. Trenches shall be backfilled, compacted and graded so that the finished grade of the replacement sod matches the elevation of the adjacent existing sod. Trench settlement occurring during the life of the contract shall be corrected at the Contractor's expense.
- B. Sodded trench areas shall be watered as often and in sufficient amounts as conditions may require to keep the soil and plant roots moist during the life of the contract.

C. Lawn damaged by the Contractor's operations outside the 300 mm removal limit shall be replaced with new sod at the Contractor's expense.

Full compensation for disposing of existing sod and furnishing and placing new sod shall be considered as included in the contract lump sum price paid for irrigation system and no separate payment will be made therefor.

10-2.03 EXISTING HIGHWAY IRRIGATION FACILITIES

In addition to the provisions in Section 20, "Erosion Control and Highway Planting," of the Standard Specifications, the work performed in connection with the various existing highway irrigation system facilities shall conform to the provisions in Section 15, "Existing Highway Facilities," of the Standard Specifications and these special provisions.

Existing irrigation facilities shown on the plans to be removed shall remain in place to irrigate existing planting until their use, as determined by the Engineer, is no longer required. Water shall be maintained in conformance with the provisions in Section 20-5.025, "Maintain Existing Water Supply," of the Standard Specifications.

CHECK AND TEST EXISTING IRRIGATION FACILITIES

Existing irrigation facilities that are to remain, and that are within those areas where clearing and grubbing or earthwork operations are to be performed, shall be checked for missing or damaged components and proper operation prior to performing clearing and grubbing or earthwork operations. Existing irrigation facilities outside of work areas that are affected by the construction work shall also be checked for proper operation.

A written list of existing irrigation system deficiencies shall be submitted to the Engineer within 5 working days after checking the existing facilities.

Deficiencies found during checking of the existing facilities shall be corrected as directed by the Engineer. Corrective work ordered by the Engineer will be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications.

When existing irrigation facilities are checked, existing backflow preventers to remain shall be tested for proper operation in conformance with the provisions in Section 20-5.03J, "Check and Test Backflow Preventers," of the Standard Specifications.

Repairs to the existing irrigation facilities ordered by the Engineer after checking and testing the facilities, and further repairs required thereafter as ordered by the Engineer, except as otherwise provided for under "Maintain Existing Irrigation Facilities" of these special provisions, will be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications.

Full compensation for checking and testing existing irrigation facilities, including testing existing backflow preventers, shall be considered as included in the contract lump sum price paid for irrigation system and no additional compensation will be allowed therefor.

MAINTAIN EXISTING IRRIGATION FACILITIES

Existing irrigation facilities shall be maintained throughout the life of the contract. Prior to the start of maintaining existing irrigation facilities work, the facilities shall be checked for proper operation, and repaired in conformance with the provisions in "Check and Test Existing Irrigation Facilities" of these special provisions.

After the existing facilities have been checked and repaired, the Contractor shall be responsible for the routine maintenance of existing irrigation systems. The work shall include, but not limited to, checking irrigation systems for proper operation and adjusting, repairing or replacing valves, valve boxes, sprinklers, risers, swing joints, wye strainers, valve assembly units, and filter assembly units.

The Contractor will not be responsible for maintaining existing water meters, underground pipe supply lines, control and neutral conductors, and electrical conduits. Except as otherwise specified in section "Existing Highway Irrigation Facilities" of these special provisions, repair work to these facilities ordered by the Engineer will be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications.

Existing automatic irrigation systems shall be operated automatically during the life of the contract, except manual operation will be allowed for the work during plant replacement, fertilization, weed germination, and the repair of irrigation facilities.

Irrigation controllers shall be programmed by the Contractor for seasonal water requirements. During winter seasons irrigation systems shall be operated automatically a minimum of 2 minutes every 2 weeks.

Irrigation systems and facilities shall be checked for proper operation at least once every 30 days. When required, as determined by the Engineer, adjusting, repairing or replacing irrigation facilities shall be completed within 5 working days after checking the irrigation systems. Except as provided in these special provisions, repair and replacement of irrigation facilities shall conform to the provisions in "Existing Highway Irrigation Facilities" of these special provisions.

Except as provided in these special provisions, the contract lump sum price paid for maintain existing irrigation facilities shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in maintaining existing irrigation facilities, complete in place, including checking irrigation facilities, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

REMOVE EXISTING IRRIGATION FACILITIES

Existing irrigation facilities to be removed, shall be removed and disposed of. Facilities that are more than 150 mm below finished grade may be abandoned in place. Removed facilities shall be disposed of outside the highway right of way in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

Immediately after disconnecting an existing irrigation facility to be removed or abandoned from an existing facility to remain, the remaining facility shall be capped or plugged, or shall be connected to a new or existing irrigation facility.

10-2.04 HIGHWAY PLANTING

The work performed in connection with highway planting shall conform to the provisions in Section 20-4, "Highway Planting," of the Standard Specifications and these special provisions.

Commercial Fertilizer

Commercial fertilizer (granular), used during planting, shall be a pelleted or granular form and shall the following guaranteed chemical analysis :

Ingredient	Percentage
Nitrogen	6
Phosphoric Acid	20
Water Soluble Potash	20

Commercial fertilizer (granular), used during plant establishment, shall be a pelleted or granular form, and shall the following guaranteed chemical analysis :

Ingredient	Percentage
Nitrogen	9
Phosphoric Acid	9
Water Soluble Potash	9
Iron	11

ROADSIDE CLEARING

Prior to preparing planting areas, or commencing irrigation trenching operations for planting areas, trash and debris shall be removed from the entire highway right of way within the location of construction, excluding, the highway roadbed, parking lots, leech fields, medians and existing planted areas where existing plants are to remain.

In addition to removing trash and debris, the project area shall be cleared as specified herein:

A. Weeds and tumble weeds outside of proposed turf and groundcover areas shall conform to the following:

Weeds, excluding tumbleweeds, shall be mowed.

Tumbleweeds shall be controlled by hand pulling. Tumbleweeds and mowed materials shall be removed and disposed of in accordance with the provisions of Section 7-1.13, " Disposal of Material Outside the Highway Right of Way", of the Standard Specifications.

- B. Weeds shall be killed and removed within proposed ground cover and turf areas and within the area extending beyond the outer limits of the proposed ground cover and turf areas to the adjacent edges of shoulders, dikes, curbs, sidewalks, walls, existing planting and fences. At those locations where proposed ground cover areas are 3.6 m or more from the adjacent edges of shoulders, dikes, curbs, sidewalks, walls, and fences, the clearing limit shall be 2 m beyond the outer limits of the proposed ground cover and turf areas.

After the initial roadside clearing is complete, additional roadside clearing work shall be performed as necessary to maintain the areas, as specified above, in a neat appearance until the start of the plant establishment period. This work shall include the following:

- A. Trash and debris shall be removed.
- B. Weed growth including tumble weeds within turf and groundcover areas shall be killed before the weeds reach the seed stage of growth or exceed 38mm in length, .
- C. Areas outside the areas specified to be cleared of weeds shall be mowed except that tumble weeds shall be killed and removed.

Weed Control

Weed control shall also conform to the following:

- A. Stolon type weeds shall be killed with glyphosate.
- B. Tumbleweeds outside of turf and groundcover areas shall be killed and removed before the tumbleweeds reach a height of 150 mm.
- C. At the option of the Contractor, weed growth in mowed areas outside turf and ground cover areas may be controlled by growth regulators. Growth regulators shall be applied before weeds exceed 150 mm in height.
- D. Areas outside of turf and groundcover locations to be mowed shall be mowed when weed height exceeds 150 mm. Weeds shall be mowed to a height of 25 mm to 50 mm.
- E. Disposal of mowed material and killed weeds excluding tumble weeds outside of turf and groundcover areas after initial roadside clearing will not be required, unless otherwise directed by the Engineer. When directed by the Engineer, mowed material and killed weeds outside of turf and groundcover areas shall be disposed of and the disposal will be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications.

PESTICIDES

Pesticides used to control weeds shall conform to the provisions in Section 20-4.026, "Pesticides," of the Standard Specifications. Except as otherwise provided in these special provisions, pesticide use shall be limited to the following materials:

- Cacodylic Acid
- Dichlobenil (Preemergent)
- Diquat
- Fluazifop-butyl
- Glyphosate
- Isoxaben (Preemergent)
- Sethoxydim
- Oxadiazon - 50 percent WP (Preemergent)
- Oryzalin (Preemergent)
- Pendimethalin (Preemergent)
- Prodiamine (Preemergent)
- Trifluralin (Preemergent)
- Melfluidide (Growth regulator)
- Napropamide (Preemergent)

Glyphosate shall be used to kill stolon type weeds.

Oxadiazon shall be of the emulsifiable concentration or wettable powder type, in conformance with these special provisions.

Prior to the application of preemergents, ground cover plants shall have been planted a minimum of 3 days and shall have been thoroughly watered.

A minimum of 100 days shall elapse between applications of preemergents.

Growth regulators shall not be applied within 2 m of trees, turf or groundcover.

If the Contractor elects to request the use of other pesticides on this project, the request shall be submitted, in writing, to the Engineer not less than 10 working days prior to the intended use of the other pesticides. Except for the pesticides listed in these special provisions, no pesticides shall be used or applied without prior written approval of the Engineer.

CULTIVATE

Areas to be planted with turf and groundcover shall be cultivated. Immediately prior to cultivation, soil amendment shall be added to the areas to be cultivated. Soil amendment shall be added at the rate shown on the plans. Soil amendment shall be thoroughly mixed with the soil.

After cultivation is complete no further planting work shall be done in the cultivated areas for a period of 15 days, except the soil shall be kept sufficiently moist to germinate weeds. Weeds that germinate shall be killed.

PLANTING

Commercial fertilizer shall be applied at the time of planting and at the rates shown on the plans.

Attention is directed to "Irrigation Systems Functional Test" of these special provisions regarding functional tests of the irrigation systems. Planting shall not be performed in an area until the functional test has been completed for the irrigation system serving that area.

TURF (SOD)

Turf (sod) shall be placed on the areas shown on the plans as "Turf."

Sod shall be healthy field grown sod containing not more than 12 mm thick thatch. The age of the sod shall be not less than 8 months or more than 16 months.

Sod shall be grown in conformance with California agricultural codes. The sod shall be free from disease, weeds, insects, and nondesirable types of grasses and clovers. Soil upon which the sod has been grown shall contain less than 50 percent silt and clay.

Sod shall be machine cut at a uniform soil thickness of $16 \text{ mm} \pm 6 \text{ mm}$, not including top growth and thatch.

A Certificate of Compliance for the sod shall be furnished to the Engineer in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications.

Sod shall be protected with tarps or other protective covers during delivery and shall not be allowed to dry out during delivery or prior to placement.

Areas to be planted to sod shall be cultivated in conformance with the provisions in "Cultivate" of these special provisions.

Weeds and debris shall be removed before cultivation and shall be disposed of outside the highway right of way in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

Soil amendment and commercial fertilizer shall be applied at the rates shown on the plans and in conformance with the provisions in "Cultivate" and "Planting" of these special provisions.

After cultivation, and installation of irrigation systems are completed, areas to be planted to sod shall be fine graded and rolled. Areas to be planted to sod shall be graded to drain and shall be smooth and uniform prior to placing sod. Areas to be planted to sod adjacent to sidewalks, concrete mow strips, , and other paved borders and surfaced areas shall be $40 \text{ mm} \pm 6 \text{ mm}$ below the top grade of the facilities, after fine grading, rolling, and settlement of the soil.

Sod shall be placed so that the ends of adjacent strips of sod are staggered a minimum of 0.6-m. Edges and ends of sod shall be placed firmly against adjacent sod and against sidewalks, concrete mow strips, header boards, and other paved borders and surfaced areas.

After placement of the sod, the entire sodded area shall be lightly rolled to eliminate air pockets and to ensure close contact with the soil. After rolling, the sodded areas shall be watered so that the soil is moistened to a minimum depth of 100 mm. Sod shall not be allowed to dry out.

If irregular or uneven areas appear before or during the plant establishment period, these areas shall be restored to a smooth and even appearance.

When the turf (sod) has reached a height of 38 mm the turf shall be mowed to a height of 25 mm. Turf (sod) edges, including edges adjacent to sidewalks, concrete mow strips, , and other paved borders and surfaced areas, shall be trimmed to a uniform edge not extending beyond the edge of turf or the facilities. Mowed and trimmed growth shall be removed and disposed of outside the highway right of way in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications. Trimming shall be repeated whenever the edge of turf exceeds 25 mm.

PLANT ESTABLISHMENT WORK

The plant establishment period shall be Type 2 and shall be not less than 60 working days.

Attention is directed to "Relief From Maintenance and Responsibility" in these special provisions regarding relief from maintenance and protection.

One application of commercial fertilizer (granular) shall be applied to turf and ground cover when directed by the Engineer. Commercial fertilizer shall be applied at the rates shown on the plans and shall be spread with a mechanical spreader wherever possible.

The center to center spacing of replacement plants for unsuitable ground cover plants shall be-the following:

ORIGINAL SPACING (Millimeters)	SPACING OF REPLACEMENT GROUND COVER PLANTS (Millimeters)		
	Number of Completed Plant Establishment Working Days		
	1-End of Plant Establishment		
300	300		

Weeds outside of new and existing turf and groundcover areas, the highway, and the median, shall be controlled by mowing.

Weeds within curbs, sidewalk, and parking surfaced areas shall be controlled by killing.

Except as specified in these special provisions, disposal of mowed material will not be required unless ordered by the Engineer. Disposal of mowed material, as directed by the Engineer, will be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications.

At the option of the Contractor, a growth regulator may be applied to mowed areas (except turf) provided the growth regulator is approved in advance by the Engineer and the growth regulator is applied in conformance with these special provisions. If a growth regulator is approved and applied, the growth regulator shall be at the Contractor's expense.

At the option of the Contractor, plants of a larger container size than those originally specified may be used for replacement plants . The use of plants of a larger container size than those originally specified for replacement plants shall be at the Contractor's expense.

The final inspection shall be performed in conformance with the provisions in Section 5-1.13, "Final Inspection," of the Standard Specifications and shall be completed a minimum of 20 working days before the estimated completion of the contract.

Turf areas shall be mowed in conformance with the provisions in "Turf (Sod)" of these special provisions.

Full compensation for mowing and trimming turf (sod) and disposing of mowed and trimmed material during the plant establishment period shall be considered as included in the contract lump sum price paid for plant establishment work and no additional compensation will be allowed therefor.

10-2.05 IRRIGATION SYSTEMS

Irrigation systems shall be furnished and installed in conformance with the provisions in Section 20-5, "Irrigation Systems," of the Standard Specifications, except materials containing asbestos fibers shall not be used.

Attention is directed to the provisions in "Obstructions" of these special provisions, regarding work over or adjacent to existing underground facilities. Excavation for proposed irrigation facilities shall not be started until the existing underground facilities have been located.

VALVE BOXES

Valve boxes shall conform to the provisions in Section 20-2.24, "Valve Boxes," of the Standard Specifications, except as otherwise provided herein.

Valve boxes shall be precast portland cement concrete.

Covers for concrete valve boxes shall be cast iron or steel. Cast iron and steel covers shall be hinged with brass hinge pins for valve boxes containing valves smaller than 50 mm.

Valve boxes shall be identified on the top surface of the covers by labels containing the appropriate abbreviation for the irrigation facility contained in the valve box as shown on the plans. Valve boxes that contain remote control valves shall be identified by the appropriate letters and numbers (controller and station numbers). Labels for valve boxes shall conform to the provisions in Section 20-5.03F, "Valves and Valve Boxes," of the Standard Specifications.

Label material shall be plate plastic .

ELECTRIC AUTOMATIC IRRIGATION COMPONENTS

Electric Remote Control Valves

Electric remote control valves shall conform to the provisions in Section 20-2.23, "Control Valves," of the Standard Specifications and the following:

- A. Valves shall be , brass, bronze, or cast iron body and bonnet construction.
- B. Valves shall be straight pattern (side inlet) as shown on the plans.
- C. Valves shall be equipped with self cleaning and stainless steel screens.
- D. Valves shall be equipped with an internal manual bleed.

Pull Boxes

Pull box installations shall conform to the provisions in Section 20-5.027I, "Conductors, Electrical Conduits and Pull Boxes," of the Standard Specifications.

Conductors

Low voltage, as used in this section "Conductors," shall mean 36 V or less. Conductors shall be minimum number 14-size wire.

Low voltage control and neutral conductors in pull boxes and valve boxes, at irrigation controller terminals, and at splices shall be marked as follows:

Conductor terminations and splices shall be marked with adhesive backed paper markers or adhesive cloth wrap-around markers, with clear, heat-shrinkable sleeves sealed over the markers.

Markers for the control conductors shall be identified with the appropriate number or letter designations of irrigation controllers and station numbers. Markers for neutral conductors shall be identified with the appropriate number or letter designations of the irrigation controllers.

The color of low voltage neutral and control conductor insulation, shall be homogeneous throughout the entire thickness of the insulation.

Insulation for conductors may be UL listed polyethylene conforming to UL44 test standards with a minimum insulation thickness of 1.05 mm for wire sizes 10AWG and smaller.

Type "C", Type "S" or Type "T" splices shall be used. Splices for low voltage control and neutral conductors shall conform to provisions in Section 86-2.09C, "Connectors and Terminals," 86-2.09D, "Splicing", and 86-2.09E, "Splice Insulation", of the Standard Specifications, except Type "S" splices shall be soldered.

IRRIGATION SYSTEMS FUNCTIONAL TEST

Functional tests for the irrigation controllers and associated automatic irrigation systems shall conform to the provisions in Section 20-5.027J, "Testing," of the Standard Specifications and these special provisions.

Tests shall demonstrate to the Engineer, through one complete cycle of the irrigation controllers in the automatic mode, that the associated automatic components of the irrigation systems operate properly. If automatic components of the irrigation systems fail a functional test, these components shall be repaired at the Contractor's expense and the testing repeated until satisfactory operation is obtained.

Associated automatic components shall include, but not be limited to, remote control valves.

Upon completion of work on an irrigation system, including correction of deficiencies and satisfactory functional tests for the systems involved, the plants to be planted in the area watered by the irrigation system may be planted provided the planting areas have been prepared as specified in these special provisions.

PIPE

Plastic Pipe

Plastic pipe supply lines shall be polyvinyl chloride (PVC) 1120 or 1220 pressure rated pipe with the minimum pressure rating (PR200) unless otherwise specified below.

Plastic pipe supply lines that are 50-mm in diameter shall be schedule 40 pipe and shall conform to the requirements of ASTM Designation: D1785.

Plastic pipe supply lines that are 75 mm in diameter shall be (PR) 315 pressure rated pipe.

Plastic pipe supply lines shall have solvent cemented type joints. Primers shall be used on the solvent cemented type joints.

Fittings for plastic pipe supply lines with a pressure rating (PR) of 315 shall be Schedule 80.

SPRINKLERS

Sprinklers shall conform to the type, pattern, material, and operating characteristics listed in the "Sprinkler Schedule" shown on the plans.

FINAL IRRIGATION SYSTEM CHECK

A final check of existing and new irrigation facilities shall be performed not more than 20 working days prior to acceptance of the contract.

The length of watering cycles using potable water measured by water meters for the final check of irrigation facilities will be determined by the Engineer.

Remote control valves and remote control valves (master) connected to existing irrigation controllers shall be checked for automatic performance when the controllers are in automatic mode.

Unsatisfactory performance of irrigation facilities installed or modified by the Contractor shall be repaired and rechecked at the Contractor's expense until satisfactory performance is obtained, as determined by the Engineer.

Repair or replacement of existing irrigation facilities due to unsatisfactory performance shall conform to the provisions in "Existing Highway Irrigation Facilities" of these special provisions.

Nothing in this section "Final Irrigation System Check" shall relieve the Contractor of full responsibility for making good or repairing defective work or materials found before the formal written acceptance of the entire contract by the Director.

Full compensation for checking the irrigation systems prior to the acceptance of the contract shall be considered as included in the contract lump sum price paid for plant establishment work and no additional compensation will be allowed therefor.

SECTION 11. MODIFIED STANDARD SPECIFICATION SECTIONS

SECTION 11-1. (BLANK)

SECTION 11-2. PORTLAND CEMENT CONCRETE

11-2.01 GENERAL

Portland cement concrete shall conform to the provisions in this Section 11-2, "Portland Cement Concrete," and the section entitled "Portland Cement Concrete" in Section 8, "Materials," of these special provisions. Section 90, "Portland Cement Concrete," of the Standard Specifications is deleted. Section 90, "Portland Cement Concrete," of the Standard Specifications is amended to read as follows.

SECTION 90: PORTLAND CEMENT CONCRETE

90-1 GENERAL

90-1.01 DESCRIPTION

- Portland cement concrete shall be composed of cementitious material, fine aggregate, coarse aggregate, admixtures if used, and water, proportioned and mixed as specified in these specifications.

- The Contractor shall determine the mix proportions for all concrete except pavement concrete. The Engineer will determine the mix proportions for pavement concrete. Concrete for which the mix proportions are determined either by the Contractor or the Engineer shall conform to the requirements of this Section 90.

- Unless otherwise specified, cementitious material shall be a combination of cement and mineral admixture. Cementitious material shall be either:

1. "Type IP (MS) Modified" cement; or
2. A combination of "Type II Modified" portland cement and mineral admixture; or
3. A combination of Type V portland cement and mineral admixture.

- Type III portland cement shall be used only as allowed in the special provisions or with the approval of the Engineer.

- Class 1 concrete shall contain not less than 400 kg of cementitious material per cubic meter.
- Class 2 concrete shall contain not less than 350 kg of cementitious material per cubic meter.
- Class 3 concrete shall contain not less than 300 kg of cementitious material per cubic meter.
- Class 4 concrete shall contain not less than 250 kg of cementitious material per cubic meter.

- Minor concrete shall contain not less than 325 kg of cementitious material per cubic meter unless otherwise specified in these specifications or the special provisions.
- Unless otherwise designated on the plans or specified in these specifications or the special provisions, the amount of cementitious material used per cubic meter of concrete in structures or portions of structures shall conform to the following:

Use	Cementitious Material Content (kg/m ³)
Concrete designated by compressive strength:	
Deck slabs and slab spans of bridges	400 min., 475 max.
Roof sections of exposed top box culverts	400 min., 475 max.
Other portions of structures	350 min., 475 max.
Concrete not designated by compressive strength:	
Deck slabs and slab spans of bridges	400 min.
Roof sections of exposed top box culverts	400 min.
Prestressed members	400 min.
Seal courses	400 min.
Other portions of structures	350 min.
Concrete for precast members	350 min., 550 max.

- Whenever the 28-day compressive strength shown on the plans is greater than 25 MPa, the concrete shall be designated by compressive strength. If the plans show a 28-day compressive strength that is 28 MPa or greater, an additional 14 days will be allowed to obtain the specified strength. The 28-day compressive strengths shown on the plans that are 25 MPa or less are shown for design information only and are not a requirement for acceptance of the concrete.
- Concrete designated by compressive strength shall be proportioned such that the concrete will attain the strength shown on the plans or specified in the special provisions.
- Before using concrete for which the mix proportions have been determined by the Contractor, or in advance of revising those mix proportions, the Contractor shall submit in writing to the Engineer a copy of the mix design.
- Compliance with cementitious material content requirements will be verified in conformance with procedures described in California Test 518 for cement content. For testing purposes, mineral admixture shall be considered to be cement. Batch proportions shall be adjusted as necessary to produce concrete having the specified cementitious material content.
- If any concrete has a cementitious material, portland cement, or mineral admixture content that is less than the minimum required, the concrete shall be removed. However, if the Engineer determines that the concrete is structurally adequate, the concrete may remain in place and the Contractor shall pay to the State \$0.55 for each kilogram of cementitious material, portland cement, or mineral admixture that is less than the minimum required. The Department may deduct the amount from any moneys due, or that may become due, the Contractor under the contract. The deductions will not be made unless the difference between the contents required and those actually provided exceeds the batching tolerances permitted by Section 90-5, "Proportioning." No deductions will be made based on the results of California Test 518.
- The requirements of the preceding paragraph shall not apply to minor concrete or commercial quality concrete.

90-2 MATERIALS

90-2.01 CEMENT

- Unless otherwise specified, cement shall be either "Type IP (MS) Modified" cement, "Type II Modified" portland cement or Type V portland cement.
- "Type IP (MS) Modified" cement shall conform to the requirements for Type IP (MS) cement in ASTM Designation: C 595, and shall be comprised of an intimate and uniform blend of Type II cement and not more than 35 percent by mass of mineral admixture. The type and minimum amount of mineral admixture used in the manufacture of "Type IP (MS) Modified" cement shall be in conformance with the provisions in Section 90-4.08, "Required Use of Mineral Admixtures."
- "Type II Modified" portland cement shall conform to the requirements for Type II portland cement in ASTM Designation: C 150.
- In addition, "Type IP (MS) Modified" cement and "Type II Modified" portland cement shall conform to the following requirements:
 - A. The cement shall not contain more than 0.60 percent by mass of alkalis, calculated as the percentage of Na₂O plus 0.658 times the percentage of K₂O, when determined by either direct intensity flame photometry or by the atomic

absorption method. The instrument and procedure used shall be qualified as to precision and accuracy in conformance with the requirements in ASTM Designation: C 114;

- B. The autoclave expansion shall not exceed 0.50 percent; and
- C. Mortar, containing the cement to be used and Ottawa sand, when tested in conformance with California Test 527, shall not expand in water more than 0.010 percent and shall not contract in air more than 0.048 percent, except that when cement is to be used for precast prestressed concrete piling, precast prestressed concrete members, or steam cured concrete products, the mortar shall not contract in air more than 0.053 percent.

- Type III and Type V portland cements shall conform to the requirements in ASTM Designation: C 150 and the additional requirements listed above for "Type II Modified" portland cement, except that when tested in conformance with California Test 527, mortar containing Type III portland cement shall not contract in air more than 0.075 percent.

- Cement used in the manufacture of cast-in-place concrete for exposed surfaces of like elements of a structure shall be from the same cement mill.

- Cement shall be protected from exposure to moisture until used. Sacked cement shall be piled to permit access for tally, inspection, and identification of each shipment.

- Adequate facilities shall be provided to assure that cement meeting the provisions specified in this Section 90-2.01 shall be kept separate from other cement in order to prevent any but the specified cement from entering the work. Safe and suitable facilities for sampling cement shall be provided at the weigh hopper or in the feed line immediately in advance of the hopper, in conformance with California Test 125.

- If cement is used prior to sampling and testing as provided in Section 6-1.07, "Certificates of Compliance," and the cement is delivered directly to the site of the work, the Certificate of Compliance shall be signed by the cement manufacturer or supplier of the cement. If the cement is used in ready-mixed concrete or in precast concrete products purchased as such by the Contractor, the Certificate of Compliance shall be signed by the manufacturer of the concrete or product.

- Cement furnished without a Certificate of Compliance shall not be used in the work until the Engineer has had sufficient time to make appropriate tests and has approved the cement for use.

90-2.02 AGGREGATES

- Aggregates shall be free from deleterious coatings, clay balls, roots, bark, sticks, rags, and other extraneous material.

- Natural aggregates shall be thoroughly and uniformly washed before use.

- The Contractor, at the Contractor's expense, shall provide safe and suitable facilities, including necessary splitting devices for obtaining samples of aggregates, in conformance with California Test 125.

- Aggregates shall be of such character that it will be possible to produce workable concrete within the limits of water content provided in Section 90-6.06, "Amount of Water and Penetration."

- Aggregates shall have not more than 10 percent loss when tested for soundness in conformance with the requirements in California Test 214. The soundness requirement for fine aggregate will be waived, provided that the durability index, D_f , of the fine aggregate is 60, or greater, when tested for durability in conformance with California Test 229.

- If the results of any one or more of the Cleanness Value, Sand Equivalent, or aggregate grading tests do not meet the requirements specified for "Operating Range" but all meet the "Contract Compliance" requirements, the placement of concrete shall be suspended at the completion of the current pour until tests or other information indicate that the next material to be used in the work will comply with the requirements specified for "Operating Range."

- If the results of either or both the Cleanness Value and coarse aggregate grading tests do not meet the requirements specified for "Contract Compliance," the concrete that is represented by the tests shall be removed. However, if the Engineer determines that the concrete is structurally adequate, the concrete may remain in place, and the Contractor shall pay to the State \$4.60 per cubic meter for paving concrete and \$7.20 per cubic meter for all other concrete for the concrete represented by these tests and left in place. The Department may deduct the amount from any moneys due, or that may become due, the Contractor under the contract.

- If the results of either or both the Sand Equivalent and fine aggregate grading tests do not meet the requirements specified for "Contract Compliance," the concrete which is represented by the tests shall be removed. However, if the Engineer determines that the concrete is structurally adequate, the concrete may remain in place, and the Contractor shall pay to the State \$4.60 per cubic meter for paving concrete and \$7.20 per cubic meter for all other concrete for the concrete represented by these tests and left in place. The Department may deduct the amount from any moneys due, or that may become due, the Contractor under the contract.

- The 2 preceding paragraphs apply individually to the "Contract Compliance" requirements for coarse aggregate and fine aggregate. When both coarse aggregate and fine aggregate do not conform to the "Contract Compliance" requirements, both paragraphs shall apply. The payments specified in those paragraphs shall be in addition to any payments made in conformance with the provisions in Section 90-1.01, "Description."

- No single Cleanness Value, Sand Equivalent or aggregate grading test shall represent more than 250 m³ of concrete or one day's pour, whichever is smaller.
- Aggregates specified for freeze-thaw resistance shall pass the freezing and thawing test, California Test 528.
- The Contractor shall notify the Engineer of the proposed source of freeze-thaw resistant concrete aggregates at least 4 months before intended use. Should the Contractor later propose a different source of concrete aggregates, the Contractor shall again notify the Engineer at least 4 months before intended use. Blending of fine or coarse aggregates from untested sources with acceptable aggregates will not be permitted. Provisions for the time of submission of samples as provided in Section 40-1.015, "Cement Content," are superseded by the foregoing.
- Concurrently with notification of proposed sources of freeze-thaw resistant concrete aggregates, the Contractor shall furnish samples in the quantity ordered by the Engineer. The samples shall be secured under the direct supervision of the Engineer. Samples from existing stockpiles of processed aggregate shall be taken from washed materials and shall be visibly damp. Samples from materials in place in a material source shall be taken at depths from the existing surface that will ensure the presence of the full quantity of ground water. Excavations for the purpose of securing samples shall be made to the full depth of intended source operations. Samples shall be protected against loss of contained water until they are delivered to the Engineer.
- The Engineer will waive the above freeze-thaw test and the 4-month advance notice, required in this Section, provided aggregates are to be obtained from sources that have previously passed this test and test results are currently applicable.
- No extension of contract time will be allowed for the time required to perform the freezing and thawing test.
- When the source of an aggregate is changed, except for pavement concrete, the Contractor shall adjust the mix proportions and submit in writing to the Engineer a copy of the mix design before using the aggregates. When the source of an aggregate is changed for pavement concrete, the Engineer shall be allowed sufficient time to adjust the mix, and the aggregates shall not be used until necessary adjustments are made.

90-2.02A Coarse Aggregate

- Coarse aggregate shall consist of gravel, crushed gravel, crushed rock, crushed air-cooled iron blast furnace slag or combinations thereof. Crushed air-cooled blast furnace slag shall not be used in reinforced or prestressed concrete.
- Coarse aggregate shall conform to the following quality requirements:

Tests	California Test	Requirements
Loss in Los Angeles Rattler (after 500 revolutions)	211	45% max.
Cleanness Value		
Operating Range	227	75 min.
Contract Compliance	227	71 min.

- In lieu of the above Cleanness Value requirements, a Cleanness Value "Operating Range" limit of 71, minimum, and a Cleanness Value "Contract Compliance" limit of 68, minimum, will be used to determine the acceptability of the coarse aggregate if the Contractor furnishes a Certificate of Compliance, as provided in Section 6-1.07, "Certificates of Compliance," certifying that:

1. coarse aggregate sampled at the completion of processing at the aggregate production plant had a Cleanness Value of not less than 82 when tested by California Test 227; and
2. prequalification tests performed in conformance with the requirements in California Test 549 indicated that the aggregate would develop a relative strength of not less than 95 percent and would have a relative shrinkage not greater than 105 percent, based on concrete.

90-2.02B Fine Aggregate

- Fine aggregate shall consist of natural sand, manufactured sand produced from larger aggregate or a combination thereof. Manufactured sand shall be well graded.
- Fine aggregate shall conform to the following quality requirements:

Test	California Test	Requirements
Organic Impurities	213	Satisfactory ^a
Mortar Strengths Relative to Ottawa Sand	515	95%, min.
Sand Equivalent:		
Operating Range	217	75, min.
Contract Compliance	217	71, min.

a Fine aggregate developing a color darker than the reference standard color solution may be accepted if it is determined by the Engineer, from mortar strength tests, that a darker color is acceptable.

- In lieu of the above Sand Equivalent requirements, a Sand Equivalent "Operating Range" limit of 71 minimum and a Sand Equivalent "Contract Compliance" limit of 68 minimum will be used to determine the acceptability of the fine aggregate if the Contractor furnishes a Certificate of Compliance, as provided in Section 6-1.07, "Certificates of Compliance," certifying that:

- fine aggregate sampled at the completion of processing at the aggregate production plant had a Sand Equivalent value of not less than 82 when tested by California Test 217; and
- prequalification tests performed in conformance with California Test 549 indicated that the aggregate would develop a relative strength of not less than 95 percent and would have a relative shrinkage not greater than 105 percent, based on concrete.

90-2.03 WATER

- In conventionally reinforced concrete work, the water for curing, for washing aggregates, and for mixing shall be free from oil and shall not contain more than 1000 parts per million of chlorides as Cl, when tested in conformance with California Test 422, nor more than 1300 parts per million of sulfates as SO₄, when tested in conformance with California Test 417. In prestressed concrete work, the water for curing, for washing aggregates, and for mixing shall be free from oil and shall not contain more than 650 parts per million of chlorides as Cl, when tested in conformance with California Test 422, nor more than 1300 parts per million of sulfates as SO₄, when tested in conformance with California Test 417. In no case shall the water contain an amount of impurities that will cause either: 1) a change in the setting time of cement of more than 25 percent when tested in conformance with the requirements in ASTM Designation: C 191 or ASTM Designation: C 266 or 2) a reduction in the compressive strength of mortar at 14 days of more than 5 percent, when tested in conformance with the requirements in ASTM Designation: C 109, when compared to the results obtained with distilled water or deionized water, tested in conformance with the requirements in ASTM Designation: C 109.

- In non-reinforced concrete work, the water for curing, for washing aggregates and for mixing shall be free from oil and shall not contain more than 2000 parts per million of chlorides as Cl, when tested in conformance with California Test 422, or more than 1500 parts per million of sulfates as SO₄, when tested in conformance with California Test 417.

- In addition to the above provisions, water for curing concrete shall not contain impurities in a sufficient amount to cause discoloration of the concrete or produce etching of the surface.

- Water reclaimed from mixer wash-out operations may be used in mixing concrete. The water shall not contain coloring agents or more than 300 parts per million of alkalis (Na₂O + 0.658 K₂O) as determined on the filtrate. The specific gravity of the water shall not exceed 1.03 and shall not vary more than ±0.010 during a day's operations.

90-2.04 ADMIXTURE MATERIALS

- Admixture materials shall conform to the requirements in the following ASTM Designations:

- Chemical Admixtures—ASTM Designation: C 494.
- Air-entraining Admixtures—ASTM Designation: C 260.
- Calcium Chloride—ASTM Designation: D 98.
- Mineral Admixtures—Coal fly ash; raw or calcined natural pozzolan as specified in ASTM Designation: C618; silica fume conforming to the requirements in ASTM Designation: C1240, with reduction of mortar expansion of 80 percent, minimum, using the cement from the proposed mix design.

- Unless otherwise specified in the special provisions, mineral admixtures shall be used in conformance with the provisions in Section 90-4.08, "Required Use of Mineral Admixtures."

90-3 AGGREGATE GRADINGS

90-3.01 GENERAL

- Before beginning concrete work, the Contractor shall submit in writing to the Engineer the gradation of the primary aggregate nominal sizes that the Contractor proposes to furnish. If a primary coarse aggregate or the fine aggregate is separated into 2 or more sizes, the proposed gradation shall consist of the gradation for each individual size, and the proposed proportions of each individual size, combined mathematically to indicate one proposed gradation. The proposed gradation shall meet the grading requirements shown in the table in this section, and shall show the percentage passing each of the sieve sizes used in determining the end result.

- The Engineer may waive, in writing, the gradation requirements in this Section 90-3.01 and in Sections 90-3.02, "Coarse Aggregate Grading," 90-3.03, "Fine Aggregate Grading," and 90-3.04, "Combined Aggregate Gradings," if, in the Engineer's opinion, furnishing the gradation is not necessary for the type or amount of concrete work to be constructed.

- Gradations proposed by the Contractor shall be within the following percentage passing limits:

Primary Aggregate Nominal Size	Sieve Size	Limits of Proposed Gradation
37.5-mm x 19-mm	25-mm	19 - 41
25-mm x 4.75-mm	19-mm	52 - 85
25-mm x 4.75-mm	9.5-mm	15 - 38
12.5-mm x 4.75-mm	9.5-mm	40 - 78
9.5-mm x 2.36-mm	9.5-mm	50 - 85
Fine Aggregate	1.18-mm	55 - 75
Fine Aggregate	600- μ m	34 - 46
Fine Aggregate	300- μ m	16 - 29

- Should the Contractor change the source of supply, the Contractor shall submit in writing to the Engineer the new gradations before their intended use.

90-3.02 COARSE AGGREGATE GRADING

- The grading requirements for coarse aggregates are shown in the following table for each size of coarse aggregate:

Sieve Sizes	Percentage Passing Primary Aggregate Nominal Sizes							
	37.5-mm x 19-mm		25-mm x 4.75-mm		12.5-mm x 4.75-mm		9.5-mm x 2.36-mm	
	Operating Range	Contract Compliance	Operating Range	Contract Compliance	Operating Range	Contract Compliance	Operating Range	Contract Compliance
50-mm	100	100	—	—	—	—	—	—
37.5-mm	88-100	85-100	100	100	—	—	—	—
25-mm	x \pm 18	X \pm 25	88-100	86-100	—	—	—	—
19-mm	0-17	0-20	X \pm 15	X \pm 22	100	100	—	—
12.5-mm	—	—	—	—	82-100	80-100	100	100
9.5-mm	0-7	0-9	X \pm 15	X \pm 22	X \pm 15	X \pm 22	X \pm 15	X \pm 20
4.75-mm	—	—	0-16	0-18	0-15	0-18	0-25	0-28
2.36-mm	—	—	0-6	0-7	0-6	0-7	0-6	0-7

- In the above table, the symbol X is the gradation that the Contractor proposes to furnish for the specific sieve size as provided in Section 90-3.01, "General."

- Coarse aggregate for the 37.5-mm, maximum, combined aggregate grading as provided in Section 90-3.04, "Combined Aggregate Gradings," shall be furnished in 2 or more primary aggregate nominal sizes. Each primary aggregate nominal size may be separated into 2 sizes and stored separately, provided that the combined material conforms to the grading requirements for that particular primary aggregate nominal size.

- When the 25-mm, maximum, combined aggregate grading as provided in Section 90-3.04, "Combined Aggregate Gradings," is to be used, the coarse aggregate may be separated into 2 sizes and stored separately, provided that the combined material shall conform to the grading requirements for the 25-mm x 4.75-mm primary aggregate nominal size.

90-3.03 FINE AGGREGATE GRADING

- Fine aggregate shall be graded within the following limits:

Sieve Sizes	Percentage Passing	
	Operating Range	Contract Compliance
9.5-mm	100	100
4.75-mm	95-100	93-100
2.36-mm	65-95	61-99
1.18-mm	X ± 10	X ± 13
600-µm	X ± 9	X ± 12
300-µm	X ± 6	X ± 9
150-µm	2-12	1-15
75-µm	0-8	0-10

- In the above table, the symbol X is the gradation that the Contractor proposes to furnish for the specific sieve size as provided in Section 90-3.01, "General."
- In addition to the above required grading analysis, the distribution of the fine aggregate sizes shall be such that the difference between the total percentage passing the 1.18-mm sieve and the total percentage passing the 600-µm sieve shall be between 10 and 40, and the difference between the percentage passing the 600-µm and 300-µm sieves shall be between 10 and 40.
- Fine aggregate may be separated into 2 or more sizes and stored separately, provided that the combined material conforms to the grading requirements specified in this Section 90-3.03.

90-3.04 COMBINED AGGREGATE GRADINGS

- Combined aggregate grading limits shall be used only for the design of concrete mixes. Concrete mixes shall be designed so that aggregates are combined in proportions that shall produce a mixture within the grading limits for combined aggregates as specified herein. Within these limitations, the relative proportions shall be as ordered by the Engineer, except as otherwise provided in Section 90-1.01, "Description."
- The combined aggregate grading used in portland cement concrete pavement shall be the 37.5-mm, maximum grading.
- The combined aggregate grading used in concrete for structures and other concrete items, except when specified otherwise in these specifications or the special provisions, shall be either the 37.5-mm, maximum grading, or the 25-mm, maximum grading, at the option of the Contractor.

Grading Limits of Combined Aggregates

Sieve Sizes	Percentage Passing			
	37.5-mm Max.	25-mm Max.	12.5-mm Max.	9.5-mm Max.
50-mm	100	—	—	—
37.5-mm	90-100	100	—	—
25-mm	50-86	90-100	—	—
19-mm	45-75	55-100	100	—
12.5-mm	—	—	90-100	100
9.5-mm	38-55	45-75	55-86	50 - 100
4.75-mm	30-45	35-60	45-63	45 - 63
2.36-mm	23-38	27-45	35-49	35 - 49
1.18-mm	17-33	20-35	25-37	25 - 37
600-µm	10-22	12-25	15-25	15 - 25
300-µm	4-10	5-15	5-15	5 - 15
150-µm	1-6	1-8	1-8	1 - 8
75-µm	0-3	0-4	0-4	0 - 4

- Changes from one grading to another shall not be made during the progress of the work unless permitted by the Engineer.

90-4 ADMIXTURES

90-4.01 GENERAL

- Admixtures used in portland cement concrete shall conform to and be used in conformance with the provisions in this Section 90-4 and the special provisions. Admixtures shall be used when specified or ordered by the Engineer and may be used at the Contractor's option as provided herein.
- Chemical admixtures and air-entraining admixtures containing chlorides as Cl in excess of one percent by mass of admixture, as determined by California Test 415, shall not be used in prestressed or reinforced concrete.
- Calcium chloride shall not be used in concrete containing steel reinforcement or other embedded metals.
- Mineral admixture used in concrete for exposed surfaces of like elements of a structure shall be from the same source and of the same percentage.
- Admixtures shall be uniform in properties throughout their use in the work. Should it be found that an admixture as furnished is not uniform in properties, its use shall be discontinued.
- If more than one admixture is used, the admixtures shall be compatible with each other so that the desirable effects of all admixtures used will be realized.

90-4.02 MATERIALS

- Admixture materials shall conform to the provisions in Section 90-2.04, "Admixture Materials."

90-4.03 ADMIXTURE APPROVAL

- No admixture brand shall be used in the work unless it is on the Department's current list of approved brands for the type of admixture involved.
- Admixture brands will be considered for addition to the approved list if the manufacturer of the admixture submits to the Transportation Laboratory a sample of the admixture accompanied by certified test results demonstrating that the admixture complies with the requirements in the appropriate ASTM Designation and these specifications. The sample shall be sufficient to permit performance of all required tests. Approval of admixture brands will be dependent upon a determination as to compliance with the requirements, based on the certified test results submitted, together with tests the Department may elect to perform.
- When the Contractor proposes to use an admixture of a brand and type on the current list of approved admixture brands, the Contractor shall furnish a Certificate of Compliance from the manufacturer, as provided in Section 6-1.07, "Certificates of Compliance," certifying that the admixture furnished is the same as that previously approved. If a previously approved admixture is not accompanied by a Certificate of Compliance, the admixture shall not be used in the work until the Engineer has had sufficient time to make the appropriate tests and has approved the admixture for use. The Engineer may take samples for testing at any time, whether or not the admixture has been accompanied by a Certificate of Compliance.
- If a mineral admixture is delivered directly to the site of the work, the Certificate of Compliance shall be signed by the manufacturer or supplier of the mineral admixture. If the mineral admixture is used in ready-mix concrete or in precast concrete products purchased as such by the Contractor, the Certificate of Compliance shall be signed by the manufacturer of the concrete or product.

90-4.04 REQUIRED USE OF CHEMICAL ADMIXTURES AND CALCIUM CHLORIDE

- When the use of a chemical admixture or calcium chloride is specified or ordered by the Engineer, the admixture shall be used at the dosage specified or ordered, except that if no dosage is specified or ordered, the admixture shall be used at the dosage normally recommended by the manufacturer of the admixture.
- Calcium chloride shall be dispensed in liquid, flake, or pellet form. Calcium chloride dispensed in liquid form shall conform to the provisions for dispensing liquid admixtures in Section 90-4.10, "Proportioning and Dispensing Liquid Admixtures."

90-4.05 OPTIONAL USE OF CHEMICAL ADMIXTURES

- The Contractor will be permitted to use Type A or F, water-reducing; Type B, retarding; or Type D or G, water-reducing and retarding admixtures as described in ASTM Designation: C 494 to conserve cementitious material or to facilitate any concrete construction application subject to the following conditions:
 - A. When a water-reducing admixture or a water-reducing and retarding admixture is used, the cementitious material content specified or ordered may be reduced by a maximum of 5 percent by mass, except that the resultant cementitious material content shall be not less than 300 kilograms per cubic meter; and
 - B. When a reduction in cementitious material content is made, the dosage of admixture used shall be the dosage used in determining approval of the admixture.

- Unless otherwise specified, a Type C accelerating chemical admixture conforming to the requirements in ASTM Designation: C 494, may be used in portland cement concrete. Inclusion in the mix design submitted for approval will not be required provided that the admixture is added to counteract changing conditions that contribute to delayed setting of the portland cement concrete, and the use or change in dosage of the admixture is approved in writing by the Engineer.

90-4.06 REQUIRED USE OF AIR-ENTRAINING ADMIXTURES

- When air-entrainment is specified or ordered by the Engineer, the air-entraining admixture shall be used in amounts to produce a concrete having the specified air content as determined by California Test 504.

90-4.07 OPTIONAL USE OF AIR-ENTRAINING ADMIXTURES

- When air-entrainment has not been specified or ordered by the Engineer, the Contractor will be permitted to use an air-entraining admixture to facilitate the use of any construction procedure or equipment provided that the average air content, as determined by California Test 504, of 3 successive tests does not exceed 4 percent, and no single test value exceeds 5.5 percent. If the Contractor elects to use an air-entraining admixture in concrete for pavement, the Contractor shall so indicate at the time the Contractor designates the source of aggregate as provided in Section 40-1.015, "Cement Content."

90-4.08 REQUIRED USE OF MINERAL ADMIXTURES

- Unless otherwise specified, mineral admixture shall be combined with cement to make cementitious material.
- The calcium oxide content of mineral admixtures shall not exceed 10 percent and the available alkali, as sodium oxide equivalent, shall not exceed 1.5 percent when determined in conformance with the requirements in ASTM Designation: C 618.

- The amounts of cement and mineral admixture used in cementitious material shall be sufficient to satisfy the minimum cementitious material content requirements specified in Section 90-1.01, "Description," or Section 90-4.05, "Optional Use of Chemical Admixtures," and shall conform to the following:

- A. The minimum amount of cement shall not be less than 75 percent by mass of the specified minimum cementitious material content;
- B. The minimum amount of mineral admixture to be combined with cement shall be determined using one of the following criteria:
 1. When the calcium oxide content of a mineral admixture is equal to or less than 2 percent by mass, the amount of mineral admixture shall not be less than 15 percent by mass of the total amount of cementitious material to be used in the mix;
 2. When the calcium oxide content of a mineral admixture is greater than 2 percent, the amount of mineral admixture shall not be less than 25 percent by mass of the total amount of cementitious material to be used in the mix;
 3. When a mineral admixture that conforms to the provisions for silica fume in Section 90-2.04, "Admixture Materials," is used, the amount of mineral admixture shall not be less than 10 percent by mass of the total amount of cementitious material to be used in the mix
- C. The total amount of mineral admixture shall not exceed 35 percent by mass of the total amount of cementitious material to be used in the mix. Where Section 90-1.01, "Description," specifies a maximum cementitious content in kilograms per cubic meter, the total mass of cement and mineral admixture per cubic meter shall not exceed the specified maximum cementitious material content.

90-4.09 BLANK

90-4.10 PROPORTIONING AND DISPENSING LIQUID ADMIXTURES

- Chemical admixtures and air-entraining admixtures shall be dispensed in liquid form. Dispensers for liquid admixtures shall have sufficient capacity to measure at one time the prescribed quantity required for each batch of concrete. Each dispenser shall include a graduated measuring unit into which liquid admixtures are measured to within ± 5 percent of the prescribed quantity for each batch. Dispensers shall be located and maintained so that the graduations can be accurately read from the point at which proportioning operations are controlled to permit a visual check of batching accuracy prior to discharge. Each measuring unit shall be clearly marked for the type and quantity of admixture.

- Each liquid admixture dispensing system shall be equipped with a sampling device consisting of a valve located in a safe and readily accessible position such that a sample of the admixture may be withdrawn slowly by the Engineer.
- If more than one liquid admixture is used in the concrete mix, each liquid admixture shall have a separate measuring unit and shall be dispensed by injecting equipment located in such a manner that the admixtures are not mixed at high concentrations and do not interfere with the effectiveness of each other. When air-entraining admixtures are used in conjunction with other liquid admixtures, the air-entraining admixture shall be the first to be incorporated into the mix.
- When automatic proportioning devices are required for concrete pavement, dispensers for liquid admixtures shall operate automatically with the batching control equipment. The dispensers shall be equipped with an automatic warning system in good operating condition that will provide a visible or audible signal at the point at which proportioning operations are controlled when the quantity of admixture measured for each batch of concrete varies from the preselected dosage by more than 5 percent, or when the entire contents of the measuring unit are not emptied from the dispenser into each batch of concrete.
- Unless liquid admixtures are added to premeasured water for the batch, their discharge into the batch shall be arranged to flow into the stream of water so that the admixtures are well dispersed throughout the batch, except that air-entraining admixtures may be dispensed directly into moist sand in the batching bins provided that adequate control of the air content of the concrete can be maintained.
- Liquid admixtures requiring dosages greater than 2.5 L/m³ shall be considered to be water when determining the total amount of free water as specified in Section 90-6.06, "Amount of Water and Penetration."
- Special admixtures, such as "high range" water reducers that may contribute to a high rate of slump loss, shall be measured and dispensed as recommended by the admixture manufacturer and as approved by the Engineer.

90-4.11 STORAGE, PROPORTIONING, AND DISPENSING OF MINERAL ADMIXTURES

- Mineral admixtures shall be protected from exposure to moisture until used. Sacked material shall be piled to permit access for tally, inspection and identification for each shipment.
- Adequate facilities shall be provided to assure that mineral admixtures meeting the specified requirements are kept separate from other mineral admixtures in order to prevent any but the specified mineral admixtures from entering the work. Safe and suitable facilities for sampling mineral admixtures shall be provided at the weigh hopper or in the feed line immediately in advance of the hopper.
- Mineral admixtures shall be incorporated into concrete using equipment conforming to the requirements for cement weigh hoppers, and charging and discharging mechanisms in ASTM Designation: C 94, in Section 90-5.03, "Proportioning," and in this Section 90-4.11.
- When concrete is completely mixed in stationary paving mixers, the mineral admixture shall be weighed in a separate weigh hopper conforming to the provisions for cement weigh hoppers and charging and discharging mechanisms in Section 90-5.03A, "Proportioning for Pavement," and the mineral admixture and cement shall be introduced simultaneously into the mixer proportionately with the aggregate. If the mineral admixture is not weighed in a separate weigh hopper, the Contractor shall provide certification that the stationary mixer is capable of mixing the cement, admixture, aggregates and water uniformly prior to discharge. Certification shall contain the following:
 - A. Test results for 2 compressive strength test cylinders of concrete taken within the first one-third and 2 compressive strength test cylinders of concrete taken within the last one-third of the concrete discharged from a single batch from the stationary paving mixer. Strength tests and cylinder preparation will be in conformance with the provisions of Section 90-9, "Compressive Strength;"
 - B. Calculations demonstrating that the difference in the averages of 2 compressive strengths taken in the first one-third is no greater than 7.5 percent different than the averages of 2 compressive strengths taken in the last one-third of the concrete discharged from a single batch from the stationary paving mixer. Strength tests and cylinder preparation will be in conformance with the provisions of Section 90-9, "Compressive Strength;" and
 - C. The mixer rotation speed and time of mixing prior to discharge that are required to produce a mix that meets the requirements above.

90-5 PROPORTIONING

90-5.01 STORAGE OF AGGREGATES

- Aggregates shall be stored or stockpiled in such a manner that separation of coarse and fine particles of each size shall be avoided and also that the various sizes shall not become intermixed before proportioning.
- Aggregates shall be stored or stockpiled and handled in a manner that shall prevent contamination by foreign materials. In addition, storage of aggregates at batching or mixing facilities that are erected subsequent to the award of the contract and that furnish concrete to the project shall conform to the following:

- A. Intermingling of the different sizes of aggregates shall be positively prevented. The Contractor shall take the necessary measures to prevent intermingling. The preventive measures may include, but are not necessarily limited to, physical separation of stockpiles or construction of bulkheads of adequate length and height; and
- B. Contamination of aggregates by contact with the ground shall be positively prevented. The Contractor shall take the necessary measures to prevent contamination. The preventive measures shall include, but are not necessarily limited to, placing aggregates on wooden platforms or on hardened surfaces consisting of portland cement concrete, asphalt concrete, or cement treated material.

- In placing aggregates in storage or in moving the aggregates from storage to the weigh hopper of the batching plant, any method that may cause segregation, degradation, or the combining of materials of different gradings that will result in any size of aggregate at the weigh hopper failing to meet the grading requirements, shall be discontinued. Any method of handling aggregates that results in excessive breakage of particles shall be discontinued. The use of suitable devices to reduce impact of falling aggregates may be required by the Engineer.

90-5.02 PROPORTIONING DEVICES

- Weighing, measuring, or metering devices used for proportioning materials shall conform to the requirements in Section 9-1.01, "Measurement of Quantities," and this Section 90-5.02. In addition, automatic weighing systems shall comply with the requirements for automatic proportioning devices in Section 90-5.03A, "Proportioning for Pavement." Automatic devices shall be automatic to the extent that the only manual operation required for proportioning the aggregates, cement, and mineral admixture for one batch of concrete is a single operation of a switch or starter.

- Proportioning devices shall be tested at the expense of the Contractor as frequently as the Engineer may deem necessary to ensure their accuracy.

- Weighing equipment shall be insulated against vibration or movement of other operating equipment in the plant. When the plant is in operation, the mass of each batch of material shall not vary from the mass designated by the Engineer by more than the tolerances specified herein.

- Equipment for cumulative weighing of aggregate shall have a zero tolerance of ± 0.5 percent of the designated total batch mass of the aggregate. For systems with individual weigh hoppers for the various sizes of aggregate, the zero tolerance shall be ± 0.5 percent of the individual batch mass designated for each size of aggregate. Equipment for cumulative weighing of cement and mineral admixtures shall have a zero tolerance of ± 0.5 percent of the designated total batch mass of the cement and mineral admixture. Equipment for weighing cement or mineral admixture separately shall have a zero tolerance of ± 0.5 percent of their designated individual batch masses. Equipment for measuring water shall have a zero tolerance of ± 0.5 percent of its designated mass or volume.

- The mass indicated for any batch of material shall not vary from the preselected scale setting by more than the following:

- A. Aggregate weighed cumulatively shall be within 1.0 percent of the designated total batch mass of the aggregate. Aggregates weighed individually shall be within 1.5 percent of their respective designated batch masses; and
- B. Cement shall be within 1.0 percent of its designated batch mass. When weighed individually, mineral admixture shall be within 1.0 percent of its designated batch mass. When mineral admixture and cement are permitted to be weighed cumulatively, cement shall be weighed first to within 1.0 percent of its designated batch mass, and the total for cement and mineral admixture shall be within 1.0 percent of the sum of their designated batch masses; and
- C. Water shall be within 1.5 percent of its designated mass or volume.

- Each scale graduation shall be approximately 0.001 of the total capacity of the scale. The capacity of scales for weighing cement, mineral admixture, or cement plus mineral admixture and aggregates shall not exceed that of commercially available scales having single graduations indicating a mass not exceeding the maximum permissible mass variation above, except that no scale shall be required having a capacity of less than 500 kg, with 0.5-kg graduations.

90-5.03 PROPORTIONING

- Proportioning shall consist of dividing the aggregates into the specified sizes, each stored in a separate bin, and combining them with cement, mineral admixture, and water as provided in these specifications. Aggregates shall be proportioned by mass.

- At the time of batching, aggregates shall have been dried or drained sufficiently to result in a stable moisture content such that no visible separation of water from aggregate will take place during transportation from the proportioning plant to the point of mixing. In no event shall the free moisture content of the fine aggregate at the time of batching exceed 8 percent of its saturated, surface-dry mass.

- Should separate supplies of aggregate material of the same size group, but of different moisture content or specific gravity or surface characteristics affecting workability, be available at the proportioning plant, withdrawals shall be made from one supply exclusively and the materials therein completely exhausted before starting upon another.
- Bulk "Type IP (MS) Modified" cement shall be weighed in an individual hopper and shall be kept separate from the aggregates until the ingredients are released for discharge into the mixer.
- Bulk cement and mineral admixture may be weighed in separate, individual weigh hoppers or may be weighed in the same weigh hopper and shall be kept separate from the aggregates until the ingredients are released for discharge into the mixer. If the cement and mineral admixture are weighed cumulatively, the cement shall be weighed first.
- When cement and mineral admixtures are weighed in separate weigh hoppers, the weigh systems for the proportioning of the aggregate, the cement, and the mineral admixture shall be individual and distinct from all other weigh systems. Each weigh system shall be equipped with a hopper, a lever system, and an indicator to constitute an individual and independent material weighing device. The cement and the mineral admixture shall be discharged into the mixer simultaneously with the aggregate.
- The scales and weigh hoppers for bulk weighing cement, mineral admixture, or cement plus mineral admixture shall be separate and distinct from the aggregate weighing equipment.
- For batches with a volume of one cubic meter or more, the batching equipment shall conform to one of the following combinations:
 - A. Separate boxes and separate scale and indicator for weighing each size of aggregate.
 - B. Single box and scale indicator for all aggregates.
 - C. Single box or separate boxes and automatic weighing mechanism for all aggregates.
- In order to check the accuracy of batch masses, the gross mass and tare mass of batch trucks, truck mixers, truck agitators, and non-agitating hauling equipment shall be determined when ordered by the Engineer. The equipment shall be weighed at the Contractor's expense on scales designated by the Engineer.

90-5.03A Proportioning for Pavement

- Aggregates and bulk cement, mineral admixture, and cement plus mineral admixture for use in pavement shall be proportioned by mass by means of automatic proportioning devices of approved type conforming to these specifications.
- The Contractor shall install and maintain in operating condition an electronically actuated moisture meter that will indicate, on a readily visible scale, changes in the moisture content of the fine aggregate as it is batched within a sensitivity of 0.5 percent by mass of the fine aggregate.
- The batching of cement, mineral admixture, or cement plus mineral admixture and aggregate shall be interlocked so that a new batch cannot be started until all weigh hoppers are empty, the proportioning devices are within zero tolerance, and the discharge gates are closed. The interlock shall permit no part of the batch to be discharged until all aggregate hoppers and the cement and mineral admixture hoppers or the cement plus mineral admixture hopper are charged with masses that are within the tolerances specified in Section 90-5.02, "Proportioning Devices."
- When interlocks are required for cement and mineral admixture charging mechanisms and cement and mineral admixtures are weighed cumulatively, their charging mechanisms shall be interlocked to prevent the introduction of mineral admixture until the mass of cement in the cement weigh hopper is within the tolerances specified in Section 90-5.02, "Proportioning Devices."
- The discharge gate on the cement and mineral admixture hoppers or the cement plus mineral admixture hopper shall be designed to permit regulating the flow of cement, mineral admixture, or cement plus mineral admixture into the aggregate as directed by the Engineer.
- When separate weigh boxes are used for each size of aggregate, the discharge gates shall permit regulating the flow of each size of aggregate as directed by the Engineer.
- Material discharged from the several bins shall be controlled by gates or by mechanical conveyors. The means of withdrawal from the several bins, and of discharge from the weigh box, shall be interlocked so that not more than one bin can discharge at a time, and so that the weigh box cannot be tripped until the required quantity from each of the several bins has been deposited therein. Should a separate weigh box be used for each size of aggregate, all may be operated and discharged simultaneously.
- When the discharge from the several bins is controlled by gates, each gate shall be actuated automatically so that the required mass is discharged into the weigh box, after which the gate shall automatically close and lock.
- The automatic weighing system shall be designed so that all proportions required may be set on the weighing controller at the same time.

90-6 MIXING AND TRANSPORTING

90-6.01 GENERAL

- Concrete shall be mixed in mechanically operated mixers, except that when permitted by the Engineer, batches not exceeding 0.25 m³ may be mixed by hand methods in conformance with the provisions in Section 90-6.05, "Hand-Mixing."
- Equipment having components made of aluminum or magnesium alloys that would have contact with plastic concrete during mixing, transporting, or pumping of portland cement concrete shall not be used.
- Concrete shall be homogeneous and thoroughly mixed, and there shall be no lumps or evidence of undispersed cement, mineral admixture, or cement plus mineral admixture.
- Uniformity of concrete mixtures will be determined by differences in penetration as determined by California Test 533, or slump as determined by ASTM Designation: C 143, and by variations in the proportion of coarse aggregate as determined by California Test 529.
- When the mix design specifies a penetration value, the difference in penetration, determined by comparing penetration tests on 2 samples of mixed concrete from the same batch or truck mixer load, shall not exceed 10 mm. When the mix design specifies a slump value, the difference in slump, determined by comparing slump tests on 2 samples of mixed concrete from the same batch or truck mixer load, shall not exceed the values given in the table below. Variation in the proportion of coarse aggregate will be determined by comparing the results of tests of 2 samples of mixed concrete from the same batch or truck mixer load and the difference between the 2 results shall not exceed 100 kg per cubic meter of concrete.

Average Slump	Maximum Permissible Difference
Less than 100-mm	25-mm
100-mm to 150-mm	38-mm
Greater than 150-mm to 225-mm	50-mm

- The Contractor, at the Contractor's expense, shall furnish samples of the freshly mixed concrete and provide satisfactory facilities for obtaining the samples.

90-6.02 MACHINE MIXING

- Concrete mixers may be of the revolving drum or the revolving blade type, and the mixing drum or blades shall be operated uniformly at the mixing speed recommended by the manufacturer. Mixers and agitators that have an accumulation of hard concrete or mortar shall not be used.
- The temperature of mixed concrete, immediately before placing, shall be not less than 10°C or more than 32°C. Aggregates and water shall be heated or cooled as necessary to produce concrete within these temperature limits. Neither aggregates nor mixing water shall be heated to exceed 65°C. If ice is used to cool the concrete, discharge of the mixer will not be permitted until all ice is melted.
- The batch shall be so charged into the mixer that some water will enter in advance of cementitious materials and aggregates. All water shall be in the drum by the end of the first one - fourth of the specified mixing time.
- Cementitious materials shall be batched and charged into the mixer by means that will not result either in loss of cementitious materials due to the effect of wind, in accumulation of cementitious materials on surfaces of conveyors or hoppers, or in other conditions that reduce or vary the required quantity of cementitious material in the concrete mixture.
- Paving and stationary mixers shall be operated with an automatic timing device. The timing device and discharge mechanism shall be interlocked so that during normal operation no part of the batch will be discharged until the specified mixing time has elapsed.
- The total elapsed time between the intermingling of damp aggregates and all cementitious materials and the start of mixing shall not exceed 30 minutes.
- The size of batch shall not exceed the manufacturer's guaranteed capacity.
- When producing concrete for pavement or base, suitable batch counters shall be installed and maintained in good operating condition at jobsite batching plants and stationary mixers. The batch counters shall indicate the exact number of batches proportioned and mixed.
- Concrete shall be mixed and delivered to the jobsite by means of one of the following combinations of operations:
 - A. Mixed completely in a stationary mixer and the mixed concrete transported to the point of delivery in truck agitators or in non-agitating hauling equipment (central-mixed concrete).
 - B. Mixed partially in a stationary mixer, and the mixing completed in a truck mixer (shrink-mixed concrete).
 - C. Mixed completely in a truck mixer (transit-mixed concrete).
 - D. Mixed completely in a paving mixer.

- Agitators may be truck mixers operating at agitating speed or truck agitators. Each mixer and agitator shall have attached thereto in a prominent place a metal plate or plates on which is plainly marked the various uses for which the equipment is designed, the manufacturer's guaranteed capacity of the drum or container in terms of the volume of mixed concrete and the speed of rotation of the mixing drum or blades.
- Truck mixers shall be equipped with electrically or mechanically actuated revolution counters by which the number of revolutions of the drum or blades may readily be verified.
- When shrink-mixed concrete is furnished, concrete that has been partially mixed at a central plant shall be transferred to a truck mixer and all requirements for transit-mixed concrete shall apply. No credit in the number of revolutions at mixing speed shall be allowed for partial mixing in a central plant.

90-6.03 TRANSPORTING MIXED CONCRETE

- Mixed concrete may be transported to the delivery point in truck agitators or truck mixers operating at the speed designated by the manufacturer of the equipment as agitating speed, or in non-agitating hauling equipment, provided the consistency and workability of the mixed concrete upon discharge at the delivery point is suitable for adequate placement and consolidation in place, and provided the mixed concrete after hauling to the delivery point conforms to the provisions in Section 90-6.01, "General."
- Truck agitators shall be loaded not to exceed the manufacturer's guaranteed capacity and shall maintain the mixed concrete in a thoroughly mixed and uniform mass during hauling.
- Bodies of non-agitating hauling equipment shall be constructed so that leakage of the concrete mix, or any part thereof, will not occur at any time.
- Concrete hauled in open-top vehicles shall be protected during hauling against rain or against exposure to the sun for more than 20 minutes when the ambient temperature exceeds 24°C.
- No additional mixing water shall be incorporated into the concrete during hauling or after arrival at the delivery point, unless authorized by the Engineer. If the Engineer authorizes additional water to be incorporated into the concrete, the drum shall be revolved not less than 30 revolutions at mixing speed after the water is added and before discharge is commenced.
- The rate of discharge of mixed concrete from truck mixer-agitators shall be controlled by the speed of rotation of the drum in the discharge direction with the discharge gate fully open.
- When a truck mixer or agitator is used for transporting concrete to the delivery point, discharge shall be completed within 1.5 hours or before 250 revolutions of the drum or blades, whichever occurs first, after the introduction of the cement to the aggregates. Under conditions contributing to quick stiffening of the concrete, or when the temperature of the concrete is 30°C or above, the time allowed may be less than 1.5 hours.
- When non-agitating hauling equipment is used for transporting concrete to the delivery point, discharge shall be completed within one hour after the addition of the cement to the aggregates. Under conditions contributing to quick stiffening of the concrete, or when the temperature of the concrete is 30°C or above, the time between the introduction of cement to the aggregates and discharge shall not exceed 45 minutes.
- Each load of concrete delivered at the jobsite shall be accompanied by a weighmaster certificate showing the mix identification number, non-repeating load number, date and time at which the materials were batched, the total amount of water added to the load, and for transit-mixed concrete, the reading of the revolution counter at the time the truck mixer is charged with cement. This weighmaster certificate shall also show the actual scale masses (kilograms) for the ingredients batched. Theoretical or target batch masses shall not be used as a substitute for actual scale masses.
- Weighmaster certificates shall be provided in printed form, or if approved by the Engineer, the data may be submitted in electronic media. Electronic media shall be presented in a tab-delimited format on a 90 mm diskette with a capacity of at least 1.4 megabytes. Captured data, for the ingredients represented by each batch shall be "line feed, carriage return" (LFCR) and "one line, separate record" with allowances for sufficient fields to satisfy the amount of data required by these specifications.
- The Contractor may furnish a weighmaster certificate accompanied by a separate certificate that lists the actual batch masses or measurements for a load of concrete provided that both certificates are imprinted with the same non-repeating load number that is unique to the contract and delivered to the jobsite with the load.
- Weighmaster certificates furnished by the Contractor shall conform to the provisions in Section 9-1.01, "Measurement of Quantities."

90-6.04 TIME OR AMOUNT OF MIXING

- Mixing of concrete in paving or stationary mixers shall continue for the required mixing time after all ingredients, except water and admixture, if added with the water, are in the mixing compartment of the mixer before any part of the batch is released. Transfer time in multiple drum mixers shall not be counted as part of the required mixing time.

- The required mixing time, in paving or stationary mixers, of concrete used for concrete structures, except minor structures, shall be not less than 90 seconds or more than 5 minutes, except that when directed by the Engineer in writing, the requirements of the following paragraph shall apply.
- The required mixing time, in paving or stationary mixers, except as provided in the preceding paragraph, shall be not less than 50 seconds or more than 5 minutes.
- The minimum required revolutions at the mixing speed for transit-mixed concrete shall not be less than that recommended by the mixer manufacturer, but in no case shall the number of revolutions be less than that required to consistently produce concrete conforming to the provisions for uniformity in Section 90-6.01, "General."

90-6.05 HAND-MIXING

- Hand-mixed concrete shall be made in batches of not more than 0.25 m³ and shall be mixed on a watertight, level platform. The proper amount of coarse aggregate shall be measured in measuring boxes and spread on the platform and the fine aggregate shall be spread on this layer, the 2 layers being not more than 0.3 meters in total depth. On this mixture shall be spread the dry cement and mineral admixture and the whole mass turned no fewer than 2 times dry; then sufficient clean water shall be added, evenly distributed, and the whole mass again turned no fewer than 3 times, not including placing in the carriers or forms.

90-6.06 AMOUNT OF WATER AND PENETRATION

- The amount of water used in concrete mixes shall be regulated so that the penetration of the concrete as determined by California Test 533 or the slump of the concrete as determined by ASTM Designation: C 143 is within the "Nominal" values shown in the following table. When the penetration or slump of the concrete is found to exceed the nominal values listed, the mixture of subsequent batches shall be adjusted to reduce the penetration or slump to a value within the nominal range shown. Batches of concrete with a penetration or slump exceeding the maximum values listed shall not be used in the work. When Type F or Type G chemical admixtures are added to the mix, the penetration requirements shall not apply and the slump shall not exceed 225 mm after the chemical admixtures are added.

Type of Work	Nominal		Maximum	
	Penetration (mm)	Slump (mm)	Penetration (mm)	Slump (mm)
Concrete Pavement	0-25	—	40	—
Non-reinforced concrete facilities	0-35	—	50	—
Reinforced concrete structures				
Sections over 300-mm thick	0-35	—	65	—
Sections 300-mm thick or less	0-50	—	75	—
Concrete placed under water	—	150-200	—	225
Cast-in-place concrete piles	65-90	130-180	100	200

- The amount of free water used in concrete shall not exceed 183 kg/m³, plus 20 kg for each required 100 kg of cementitious material in excess of 325 kg/m³. The term free water is defined as the total water in the mixture minus the water absorbed by the aggregates in reaching a saturated surface-dry condition.
- Where there are adverse or difficult conditions that affect the placing of concrete, the above specified penetration and free water content limitations may be exceeded providing the Contractor is granted permission by the Engineer in writing to increase the cementitious material content per cubic meter of concrete. The increase in water and cementitious material shall be at a ratio not to exceed 30 kg of water per added 100 kg of cementitious material per cubic meter. The cost of additional cementitious material and water added under these conditions shall be at the Contractor's expense and no additional compensation will be allowed therefor.
- The equipment for supplying water to the mixer shall be constructed and arranged so that the amount of water added can be measured accurately. Any method of discharging water into the mixer for a batch shall be accurate within 1.5 percent of the quantity of water required to be added to the mix for any position of the mixer. Tanks used to measure water shall be designed so that water cannot enter while water is being discharged into the mixer and discharge into the mixer shall be made rapidly in one operation without dribbling. All equipment shall be arranged so as to permit checking the amount of water delivered by discharging into measured containers.

90-7 CURING CONCRETE

90-7.01 METHODS OF CURING

- Newly placed concrete shall be cured by the methods specified in this Section 90-7.01 and the special provisions.

90-7.01A Water Method

- The concrete shall be kept continuously wet by the application of water for a minimum curing period of 7 days after the concrete has been placed.
 - When a curing medium consisting of cotton mats, rugs, carpets, or earth or sand blankets is to be used to retain the moisture, the entire surface of the concrete shall be kept damp by applying water with a nozzle that so atomizes the flow that a mist and not a spray is formed, until the surface of the concrete is covered with the curing medium. The moisture from the nozzle shall not be applied under pressure directly upon the concrete and shall not be allowed to accumulate on the concrete in a quantity sufficient to cause a flow or wash the surface. At the expiration of the curing period, the concrete surfaces shall be cleared of all curing mediums.
 - When concrete bridge decks and flat slabs are to be cured without the use of a curing medium, the entire surface of the bridge deck or slab shall be kept damp by the application of water with an atomizing nozzle as specified in the preceding paragraph, until the concrete has set, after which the entire surface of the concrete shall be sprinkled continuously with water for a period of not less than 7 days.

90-7.01B Curing Compound Method

- Surfaces of the concrete that are exposed to the air shall be sprayed uniformly with a curing compound.
- Curing compounds to be used shall be as follows:
 1. Pigmented curing compound conforming to the requirements in ASTM Designation: C 309, Type 2, Class B, except the resin type shall be poly-alpha-methylstyrene.
 2. Pigmented curing compound conforming to the requirements in ASTM Designation: C 309, Type 2, Class B.
 3. Pigmented curing compound conforming to the requirements in ASTM Designation: C 309, Type 2, Class A.
 4. Non-pigmented curing compound conforming to the requirements in ASTM Designation: C 309, Type 1, Class B.
 5. Non-pigmented curing compound conforming to the requirements in ASTM Designation: C 309, Type 1, Class A.
 6. Non-pigmented curing compound with fugitive dye conforming to the requirements in ASTM Designation: C 309, Type 1-D, Class A.
- The infrared scan for the dried vehicle from curing compound (1) shall match the infrared scan on file at the Transportation Laboratory.
 - The loss of water for each type of curing compound, when tested in conformance with the requirements in California Test 534, shall not be more than 0.15-kg/m² in 24 hours or more than 0.45-kg/m² in 72 hours.
 - The curing compound to be used will be specified elsewhere in these specifications or in the special provisions.
 - When the use of curing compound is required or permitted elsewhere in these specifications or in the special provisions and no specific kind is specified, any of the curing compounds listed above may be used.
 - Curing compound shall be applied at a nominal rate of 3.7 m²/L, unless otherwise specified.
 - At any point, the application rate shall be within ± 1.2 m²/L of the nominal rate specified, and the average application rate shall be within ± 0.5 m²/L of the nominal rate specified when tested in conformance with the requirements in California Test 535. Runs, sags, thin areas, skips, or holidays in the applied curing compound shall be evidence that the application is not satisfactory.
 - Curing compounds shall be applied using power operated spray equipment. The power operated spraying equipment shall be equipped with an operational pressure gage and a means of controlling the pressure. Hand spraying of small and irregular areas that are not reasonably accessible to mechanical spraying equipment, in the opinion of the Engineer, may be permitted.
 - The curing compound shall be applied to the concrete following the surface finishing operation, immediately before the moisture sheen disappears from the surface, but before any drying shrinkage or craze cracks begin to appear. In the event of any drying or cracking of the surface, application of water with an atomizing nozzle as specified in Section 90-7.01A, "Water Method," shall be started immediately and shall be continued until application of the compound is resumed or started; however, the compound shall not be applied over any resulting freestanding water. Should the film of compound be damaged from any cause before the expiration of 7 days after the concrete is placed in the case of structures and 72 hours in the case of pavement, the damaged portion shall be repaired immediately with additional compound.

- At the time of use, compounds containing pigments shall be in a thoroughly mixed condition with the pigment uniformly dispersed throughout the vehicle. A paddle shall be used to loosen all settled pigment from the bottom of the container, and a power driven agitator shall be used to disperse the pigment uniformly throughout the vehicle.
- Agitation shall not introduce air or other foreign substance into the curing compound.
- The manufacturer shall include in the curing compound the necessary additives for control of sagging, pigment settling, leveling, de-emulsification, or other requisite qualities of a satisfactory working material. Pigmented curing compounds shall be manufactured so that the pigment does not settle badly, does not cake or thicken in the container, and does not become granular or curdled. Settlement of pigment shall be a thoroughly wetted, soft, mushy mass permitting the complete and easy vertical penetration of a paddle. Settled pigment shall be easily redispersed, with minimum resistance to the sideways manual motion of the paddle across the bottom of the container, to form a smooth uniform product of the proper consistency.
- Curing compounds shall remain sprayable at temperatures above 4°C and shall not be diluted or altered after manufacture.
- The curing compound shall be packaged in clean 210-L barrels or round 19-L containers or shall be supplied from a suitable storage tank located at the jobsite. The containers shall comply with "Title 49, Code of Federal Regulations, Hazardous Materials Regulations." The 210-L barrels shall have removable lids and airtight fasteners. The 19-L containers shall be round and have standard full open head and bail. Lids with bungholes shall not be permitted. On-site storage tanks shall be kept clean and free of contaminants. Each tank shall have a permanent system designed to completely redisperse settled material without introducing air or other foreign substances.
- Steel containers and lids shall be lined with a coating that will prevent destructive action by the compound or chemical agents in the air space above the compound. The coating shall not come off the container or lid as skins. Containers shall be filled in a manner that will prevent skinning. Plastic containers shall not react with the compound.
- Each container shall be labeled with the manufacturer's name, kind of curing compound, batch number, volume, date of manufacture, and volatile organic compound (VOC) content. The label shall also warn that the curing compound containing pigment shall be well stirred before use. Precautions concerning the handling and the application of curing compound shall be shown on the label of the curing compound containers in conformance with the Construction Safety Orders and General Industry Safety Orders of the State of California.
- Containers of curing compound shall be labeled to indicate that the contents fully comply with the rules and regulations concerning air pollution control in the State of California.
- When the curing compound is shipped in tanks or tank trucks, a shipping invoice shall accompany each load. The invoice shall contain the same information as that required herein for container labels.
- Curing compound will be sampled by the Engineer at the source of supply or at the jobsite or at both locations.
- Curing compound shall be formulated so as to maintain the specified properties for a minimum of one year. The Engineer may require additional testing before use to determine compliance with these specifications if the compound has not been used within one year or whenever the Engineer has reason to believe the compound is no longer satisfactory.
- Tests will be conducted in conformance with the latest ASTM test methods and methods in use by the Transportation Laboratory.

90-7.01C Waterproof Membrane Method

- The exposed finished surfaces of concrete shall be sprayed with water, using a nozzle that so atomizes the flow that a mist and not a spray is formed, until the concrete has set, after which the curing membrane shall be placed. The curing membrane shall remain in place for a period of not less than 72 hours.
- Sheeting material for curing concrete shall conform to the requirements in AASHTO Designation: M 171 for white reflective materials.
- The sheeting material shall be fabricated into sheets of such width as to provide a complete cover for the entire concrete surface. Joints in the sheets shall be securely cemented together in such a manner as to provide a waterproof joint. The joint seams shall have a minimum lap of 100 mm.
- The sheets shall be securely weighted down by placing a bank of earth on the edges of the sheets or by other means satisfactory to the Engineer.
- Should any portion of the sheets be broken or damaged before the expiration of 72 hours after being placed, the broken or damaged portions shall be immediately repaired with new sheets properly cemented into place.
- Sections of membrane that have lost their waterproof qualities or have been damaged to such an extent as to render them unfit for curing the concrete shall not be used.

90-7.01D Forms-In-Place Method

- Formed surfaces of concrete may be cured by retaining the forms in place. The forms shall remain in place for a minimum period of 7 days after the concrete has been placed, except that for members over 0.5-m in least dimension the forms shall remain in place for a minimum period of 5 days.
- Joints in the forms and the joints between the end of forms and concrete shall be kept moisture tight during the curing period. Cracks in the forms and cracks between the forms and the concrete shall be resealed by methods subject to the approval of the Engineer.

90-7.02 CURING PAVEMENT

- The entire exposed area of the pavement, including edges, shall be cured by the waterproof membrane method, or curing compound method using curing compound (1) or (2) as the Contractor may elect. Should the side forms be removed before the expiration of 72 hours following the start of curing, the exposed pavement edges shall also be cured. If the pavement is cured by means of the curing compound method, the sawcut and all portions of the curing compound that have been disturbed by sawing operations shall be restored by spraying with additional curing compound.
- Curing shall commence as soon as the finishing process provided in Section 40-1.10, "Final Finishing," has been completed. The method selected shall conform to the provisions in Section 90-7.01, "Methods of Curing."
- When the curing compound method is used, the compound shall be applied to the entire pavement surface by mechanical sprayers. Spraying equipment shall be of the fully atomizing type equipped with a tank agitator that provides for continual agitation of the curing compound during the time of application. The spray shall be adequately protected against wind, and the nozzles shall be so oriented or moved mechanically transversely as to result in the minimum specified rate of coverage being applied uniformly on exposed faces. Hand spraying of small and irregular areas, and areas inaccessible to mechanical spraying equipment, in the opinion of the Engineer, will be permitted. When the ambient air temperature is above 15°C, the Contractor shall fog the surface of the concrete with a fine spray of water as specified in Section 90-7.01A, "Water Method." The surface of the pavement shall be kept moist between the hours of 10:00 a.m. and 4:30 p.m. on the day the concrete is placed. However, the fogging done after the curing compound has been applied shall not begin until the compound has set sufficiently to prevent displacement. Fogging shall be discontinued if ordered in writing by the Engineer.

90-7.03 CURING STRUCTURES

- Newly placed concrete for cast-in-place structures, other than highway bridge decks, shall be cured by the water method, the forms-in-place method, or, as permitted herein, by the curing compound method, in conformance with the provisions in Section 90-7.01, "Methods of Curing."
- The curing compound method using a pigmented curing compound may be used on concrete surfaces of construction joints, surfaces that are to be buried underground, and surfaces where only Ordinary Surface Finish is to be applied and on which a uniform color is not required and that will not be visible from a public traveled way. If the Contractor elects to use the curing compound method on the bottom slab of box girder spans, the curing compound shall be curing compound (1).
- The top surface of highway bridge decks shall be cured by both the curing compound method and the water method. The curing compound shall be curing compound (1). The curing compound shall be applied progressively during the deck finishing operations immediately after finishing operations are completed on each individual portion of the deck. The water cure shall be applied not later than 4 hours after completion of deck finishing or, for portions of the decks on which finishing is completed after normal working hours, the water cure shall be applied not later than the following morning.
- Concrete surfaces of minor structures, as defined in Section 51-1.02, "Minor Structures," shall be cured by the water method, the forms-in-place method or the curing compound method.
- When deemed necessary by the Engineer during periods of hot weather, water shall be applied to concrete surfaces being cured by the curing compound method or by the forms-in-place method, until the Engineer determines that a cooling effect is no longer required. Application of water for this purpose will be paid for as extra work as provided in Section 4-1.03D, "Extra Work."

90-7.04 CURING PRECAST CONCRETE MEMBERS

- Precast concrete members shall be cured in conformance with any of the methods specified in Section 90-7.01, "Methods of Curing." Curing shall be provided for the minimum time specified for each method or until the concrete reaches its design strength, whichever is less. Steam curing may also be used for precast members and shall conform to the following provisions:
 - A. After placement of the concrete, members shall be held for a minimum 4-hour presteaming period. If the ambient air temperature is below 10°C, steam shall be applied during the presteaming period to hold the air surrounding the member at a temperature between 10°C and 32°C.

- B. To prevent moisture loss on exposed surfaces during the presteaming period, members shall be covered as soon as possible after casting or the exposed surfaces shall be kept wet by fog spray or wet blankets.
- C. Enclosures for steam curing shall allow free circulation of steam about the member and shall be constructed to contain the live steam with a minimum moisture loss. The use of tarpaulins or similar flexible covers will be permitted, provided they are kept in good repair and secured in such a manner as to prevent the loss of steam and moisture.
- D. Steam at the jets shall be at low pressure and in a saturated condition. Steam jets shall not impinge directly on the concrete, test cylinders, or forms. During application of the steam, the temperature rise within the enclosure shall not exceed 22°C per hour. The curing temperature throughout the enclosure shall not exceed 65°C and shall be maintained at a constant level for a sufficient time necessary to develop the required transfer strength. Control cylinders shall be covered to prevent moisture loss and shall be placed in a location where temperature is representative of the average temperature of the enclosure.
- E. Temperature recording devices that will provide an accurate, continuous, permanent record of the curing temperature shall be provided. A minimum of one temperature recording device per 60 m of continuous bed length will be required for checking temperature.
- F. Members in pretension beds shall be detensioned immediately after the termination of steam curing while the concrete and forms are still warm, or the temperature under the enclosure shall be maintained above 15°C until the stress is transferred to the concrete.
- G. Curing of precast concrete will be considered completed after termination of the steam curing cycle.

90-7.05 CURING PRECAST PRESTRESSED CONCRETE PILES

- Newly placed concrete for precast prestressed concrete piles shall be cured in conformance with the provisions in Section 90-7.04, "Curing Precast Concrete Members," except that piles with a class designation ending in C (corrosion resistant) shall be cured as follows:

- A. Piles shall be either steam cured or water cured. If water curing is used, the piles shall be kept continuously wet by the application of water in conformance with the provisions in Section 90-7.01A, "Water Method."
- B. If steam curing is used, the steam curing provisions in Section 90-7.04, "Curing Precast Concrete Members," shall apply except that the piles shall be kept continuously wet for their entire length for a period of not less than 3 days, including the holding and steam curing periods.

90-7.06 CURING SLOPE PROTECTION

- Concrete slope protection shall be cured in conformance with any of the methods specified in Section 90-7.01, "Methods of Curing."

- Concreted-rock slope protection shall be cured in conformance with any of the methods specified in Section 90-7.01, "Methods of Curing," or with a blanket of earth kept wet for 72 hours, or by sprinkling with a fine spray of water every 2 hours during the daytime for a period of 3 days.

90-7.07 CURING MISCELLANEOUS CONCRETE WORK

- Exposed surfaces of curbs shall be cured by pigmented curing compounds as specified in Section 90-7.01B, "Curing Compound Method."

- Concrete sidewalks, gutter depressions, island paving, curb ramps, driveways, and other miscellaneous concrete areas shall be cured in conformance with any of the methods specified in Section 90-7.01, "Methods of Curing."

- Shotcrete shall be cured for at least 72 hours by spraying with water, or by a moist earth blanket, or by any of the methods provided in Section 90-7.01, "Methods of Curing."

- Mortar and grout shall be cured by keeping the surface damp for 3 days.

- After placing, the exposed surfaces of sign structure foundations, including pedestal portions, if constructed, shall be cured for at least 72 hours by spraying with water, or by a moist earth blanket, or by any of the methods provided in Section 90-7.01, "Methods of Curing."

90-8 PROTECTING CONCRETE

90-8.01 GENERAL

- In addition to the provisions in Section 7-1.16, "Contractor's Responsibility for the Work and Materials," the Contractor shall protect concrete as provided in this Section 90-8.

- Concrete shall not be placed on frozen or ice-coated ground or subgrade nor on ice-coated forms, reinforcing steel, structural steel, conduits, precast members, or construction joints.
- Under rainy conditions, placing of concrete shall be stopped before the quantity of surface water is sufficient to damage surface mortar or cause a flow or wash of the concrete surface, unless the Contractor provides adequate protection against damage.
- Concrete that has been frozen or damaged by other causes, as determined by the Engineer, shall be removed and replaced by the Contractor at the Contractor's expense.

90-8.02 PROTECTING CONCRETE STRUCTURES

- Structure concrete and shotcrete used as structure concrete shall be maintained at a temperature of not less than 7°C for 72 hours after placing and at not less than 4°C for an additional 4 days. When required by the Engineer, the Contractor shall submit a written outline of the proposed methods for protecting the concrete.

90-8.03 PROTECTING CONCRETE PAVEMENT

- Pavement concrete shall be maintained at a temperature of not less than 4°C for 72 hours. When required by the Engineer, the Contractor shall submit a written outline of the proposed methods for protecting the concrete.

- Except as provided in Section 7-1.08, "Public Convenience," the Contractor shall protect concrete pavement against construction and other activities that abrade, scar, discolor, reduce texture depth, lower coefficient of friction, or otherwise damage the surface. Stockpiling, drifting, or excessive spillage of soil, gravel, petroleum products, and concrete or asphalt mixes on the surface of concrete pavement is prohibited unless otherwise specified in these specifications, the special provisions or permitted by the Engineer.

- When ordered by the Engineer or shown on the plans or specified in the special provisions, pavement crossings shall be constructed for the convenience of public traffic. The material and work necessary for the construction of the crossings, and their subsequent removal and disposal, will be paid for at the contract unit prices for the items of work involved and if there are no contract items for the work involved, payment for pavement crossings will be made by extra work as provided in Section 4-1.03D, "Extra Work.". Where public traffic will be required to cross over the new pavement, Type III portland cement may be used in concrete, if permitted in writing by the Engineer. The pavement may be opened to traffic as soon as the concrete has developed a modulus of rupture of 3.8 MPa. The modulus of rupture will be determined by California Test 523.

- No traffic or Contractor's equipment, except as hereinafter provided, will be permitted on the pavement before a period of 10 days has elapsed after the concrete has been placed, nor before the concrete has developed a modulus of rupture of at least 3.8 MPa. Concrete that fails to attain a modulus of rupture of 3.8 MPa within 10 days shall not be opened to traffic until directed by the Engineer.

- Equipment for sawing weakened plane joints will be permitted on the pavement as specified in Section 40-1.08B, "Weakened Plane Joints."

- When requested in writing by the Contractor, the tracks on one side of paving equipment will be permitted on the pavement after a modulus of rupture of 2.4 MPa has been attained, provided that:

- A. Unit pressure exerted on the pavement by the paver shall not exceed 135 kPa;
- B. Tracks with cleats, grousers, or similar protuberances shall be modified or shall travel on planks or equivalent protective material, so that the pavement is not damaged; and
- C. No part of the track shall be closer than 0.3-m from the edge of pavement.

- In case of visible cracking of, or other damage to the pavement, operation of the paving equipment on the pavement shall be immediately discontinued.

- Damage to the pavement resulting from early use of pavement by the Contractor's equipment as provided above shall be repaired by the Contractor at the Contractor's expense.

- The State will furnish the molds and machines for testing the concrete for modulus of rupture, and the Contractor, at the Contractor's expense, shall furnish the material and whatever labor the Engineer may require.

90-9 COMPRESSIVE STRENGTH

90-9.01 GENERAL

- Concrete compressive strength requirements consist of a minimum strength that shall be attained before various loads or stresses are applied to the concrete and, for concrete designated by strength, a minimum strength at the age of 28 days or at the age otherwise allowed in Section 90-1.01, "Description." The various strengths required are specified in these specifications or the special provisions or are shown on the plans.

- The compressive strength of concrete will be determined from test cylinders that have been fabricated from concrete sampled in conformance with the requirements of ASTM Designation: C 172. Test cylinders will be molded and initially field cured in conformance with California Test 540. Test cylinders will be cured and tested after receipt at the testing laboratory in conformance with the requirements of ASTM Designation: C 39. A strength test shall consist of the average strength of 2 cylinders fabricated from material taken from a single load of concrete, except that, if any cylinder should show evidence of improper sampling, molding, or testing, that cylinder shall be discarded and the strength test shall consist of the strength of the remaining cylinder.

- When concrete compressive strength is specified as a prerequisite to applying loads or stresses to a concrete structure or member, test cylinders for other than steam cured concrete will be cured in conformance with Method 1 of California Test 540. The compressive strength of concrete determined for these purposes will be evaluated on the basis of individual tests.

- When concrete is designated by 28-day compressive strength rather than by cementitious material content, the concrete strength to be used as a basis for acceptance of other than steam cured concrete will be determined from cylinders cured in conformance with Method 1 of California Test 540. If the result of a single compressive strength test at the maximum age specified or allowed is below the specified strength but is 95 percent or more of the specified strength, the Contractor shall, at the Contractor's expense, make corrective changes, subject to approval of the Engineer, in the mix proportions or in the concrete fabrication procedures, before placing additional concrete, and shall pay to the State \$14 for each in-place cubic meter of concrete represented by the deficient test. If the result of a single compressive strength test at the maximum age specified or allowed is below 95 percent of the specified strength, but is 85 percent or more of the specified strength, the Contractor shall make the corrective changes specified above, and shall pay to the State \$20 for each in place cubic meter of concrete represented by the deficient test. In addition, such corrective changes shall be made when the compressive strength of concrete tested at 7 days indicates, in the judgment of the Engineer, that the concrete will not attain the required compressive strength at the maximum age specified or allowed. Concrete represented by a single test that indicates a compressive strength of less than 85 percent of the specified 28-day compressive strength will be rejected in conformance with the provisions in Section 6-1.04, "Defective Materials."

- If the test result indicates that the compressive strength at the maximum curing age specified or allowed is below the specified strength, but is 85 percent or more of the specified strength, payments to the State as required above shall be made, unless the Contractor, at the Contractor's expense, obtains and submits evidence acceptable to the Engineer that the strength of the concrete placed in the work meets or exceeds the specified 28-day compressive strength. If the test result indicates a compressive strength at the maximum curing age specified or allowed below 85 percent, the concrete represented by that test will be rejected, unless the Contractor, at the Contractor's expense, obtains and submits evidence acceptable to the Engineer that the strength and quality of the concrete placed in the work are acceptable. If the evidence consists of tests made on cores taken from the work, the cores shall be obtained and tested in conformance with the requirements in ASTM Designation: C 42.

- No single compressive strength test shall represent more than 250 m³.

- When a precast concrete member is steam cured, the compressive strength of the concrete will be determined from test cylinders that have been handled and stored in conformance with Method 3 of California Test 540. The compressive strength of steam cured concrete will be evaluated on the basis of individual tests representing specific portions of production. When the concrete is designated by 28-day compressive strength rather than by cementitious material content, the concrete shall be considered to be acceptable whenever its compressive strength reaches the specified 28-day compressive strength provided that strength is reached in not more than the maximum number of days specified or allowed after the member is cast.

- When concrete is specified by compressive strength, prequalification of materials, mix proportions, mixing equipment, and procedures proposed for use will be required prior to placement of the concrete. Prequalification shall be accomplished by the submission of acceptable certified test data or trial batch reports by the Contractor. Prequalification data shall be based on the use of materials, mix proportions, mixing equipment, procedures, and size of batch proposed for use in the work.

- Certified test data, in order to be acceptable, shall indicate that not less than 90 percent of at least 20 consecutive tests exceed the specified strength at the maximum number of cure days specified or allowed, and none of those tests are less than 95 percent of specified strength. Strength tests included in the data shall be the most recent tests made on concrete of the proposed mix design and all shall have been made within one year of the proposed use of the concrete.

- Trial batch test reports, in order to be acceptable, shall indicate that the average compressive strength of 5 consecutive concrete cylinders, taken from a single batch, at not more than 28 days (or the maximum age allowed) after molding shall be at least 4 MPa greater than the specified 28-day compressive strength, and no individual cylinder shall have a strength less than the specified strength at the maximum age specified or allowed. Data contained in the report shall be from trial batches that were produced within one year of the proposed use of specified strength concrete in the project. Whenever air-entrainment is required, the air content of trial batches shall be equal to or greater than the air content specified for the concrete without reduction due to tolerances.

- Tests shall be performed in conformance with either the appropriate California Test methods or the comparable ASTM test methods. Equipment employed in testing shall be in good condition and shall be properly calibrated. If the tests are performed during the life of the contract, the Engineer shall be notified sufficiently in advance of performing the tests in order to witness the test procedures.

- The certified test data and trial batch test reports shall include the following information:

- A. Date of mixing.
- B. Mixing equipment and procedures used.
- C. The size of batch in cubic meters and the mass, type, and source of all ingredients used.
- D. Penetration of the concrete.
- E. The air content of the concrete if an air-entraining admixture is used.
- F. The age at time of testing and strength of all concrete cylinders tested.

- Certified test data and trial batch test reports shall be signed by an official of the firm that performed the tests.

- When approved by the Engineer, concrete from trial batches may be used in the work at locations where concrete of a lower quality is required and the concrete will be paid for as the type or class of concrete required at that location.

- After materials, mix proportions, mixing equipment, and procedures for concrete have been prequalified for use, additional prequalification by testing of trial batches will be required prior to making changes that, in the judgment of the Engineer, could result in a strength of concrete below that specified.

- The Contractor's attention is directed to the time required to test trial batches and the Contractor shall be responsible for production of trial batches at a sufficiently early date so that the progress of the work is not delayed.

- When precast concrete members are manufactured at the plant of an established manufacturer of precast concrete members, the mix proportions of the concrete shall be determined by the Contractor, and a trial batch and prequalification of the materials, mix proportions, mixing equipment, and procedures will not be required.

90-10 MINOR CONCRETE

90-10.01 GENERAL

- Concrete for minor structures, slope paving, curbs, sidewalks and other concrete work, when designated as minor concrete on the plans, in the specifications, or in the contract item, shall conform to the provisions specified herein.

- The Engineer, at the Engineer's discretion, will inspect and test the facilities, materials and methods for producing the concrete to ensure that minor concrete of the quality suitable for use in the work is obtained.

90-10.02 MATERIALS

- Minor concrete shall conform to the following requirements:

90-10.02A Cementitious Material

- Cementitious material shall conform to the provisions in Section 90-1.01, "Description."

90-10.02B Aggregate

- Aggregate shall be clean and free from deleterious coatings, clay balls, roots, and other extraneous materials.

- The Contractor shall submit to the Engineer for approval, a grading of the combined aggregate proposed for use in the minor concrete. After acceptance of the grading, aggregate furnished for minor concrete shall conform to that grading, unless a change is authorized in writing by the Engineer.

- The Engineer may require the Contractor to furnish periodic test reports of the aggregate grading furnished. The maximum size of aggregate used shall be at the option of the Contractor, but in no case shall the maximum size be larger than 37.5 mm or smaller than 19 mm.
- The Engineer may waive, in writing, the gradation requirements in this Section 90-10.02B, if, in the Engineer's opinion, the furnishing of the gradation is not necessary for the type or amount of concrete work to be constructed.

90-10.02C Water

- Water used for washing, mixing, and curing shall be free from oil, salts, and other impurities that would discolor or etch the surface or have an adverse affect on the quality of the concrete.

90-10.02D Admixtures

- The use of admixtures shall conform to the provisions in Section 90-4, "Admixtures."

90-10.03 PRODUCTION

• Cementitious material, water, aggregate, and admixtures shall be stored, proportioned, mixed, transported, and discharged in conformance with recognized standards of good practice that will result in concrete that is thoroughly and uniformly mixed, that is suitable for the use intended, and that conforms to requirements specified herein. Recognized standards of good practice are outlined in various industry publications such as are issued by American Concrete Institute, AASHTO, or the Department.

• The cementitious material content of minor concrete shall conform to the provisions in Section 90-1.01, "Description."

• The amount of water used shall result in a consistency of concrete conforming to the provisions in Section 90-6.06, "Amount of Water and Penetration." Additional mixing water shall not be incorporated into the concrete during hauling or after arrival at the delivery point, unless authorized by the Engineer.

• Discharge of ready-mixed concrete from the transporting vehicle shall be made while the concrete is still plastic and before stiffening occurs. An elapsed time of 1.5 hours (one hour in non-agitating hauling equipment), or more than 250 revolutions of the drum or blades, after the introduction of the cementitious material to the aggregates, or a temperature of concrete of more than 32°C will be considered conditions contributing to the quick stiffening of concrete. The Contractor shall take whatever action is necessary to eliminate quick stiffening, except that the addition of water will not be permitted.

• The required mixing time in stationary mixers shall be not less than 50 seconds or more than 5 minutes.

• The minimum required revolutions at mixing speed for transit-mixed concrete shall be not less than that recommended by the mixer manufacturer, and shall be increased, if necessary, to produce thoroughly and uniformly mixed concrete.

• Each load of ready-mixed concrete shall be accompanied by a weighmaster certificate that shall be delivered to the Engineer at the discharge location of the concrete, unless otherwise directed by the Engineer. The weighmaster certificate shall be clearly marked with the date and time of day when the load left the batching plant and, if hauled in truck mixers or agitators, the time the mixing cycle started.

• A Certificate of Compliance conforming to the provisions in Section 6-1.07, "Certificates of Compliance," shall be furnished to the Engineer, prior to placing minor concrete from a source not previously used on the contract, stating that minor concrete to be furnished meets contract requirements, including minimum cementitious material content specified.

90-10.04 CURING MINOR CONCRETE

- Curing minor concrete shall conform to the provisions in Section 90-7, "Curing Concrete."

90-10.05 PROTECTING MINOR CONCRETE

• Protecting minor concrete shall conform to the provisions in Section 90-8, "Protecting Concrete," except the concrete shall be maintained at a temperature of not less than 4°C for 72 hours after placing.

90-10.06 MEASUREMENT AND PAYMENT

• Minor concrete will be measured and paid for in conformance with the provisions specified in the various sections of these specifications covering concrete construction when minor concrete is specified in the specifications, shown on the plans, or indicated by contract item in the Engineer's Estimate.

90-11 MEASUREMENT AND PAYMENT

90-11.01 MEASUREMENT

- Portland cement concrete will be measured in conformance with the provisions specified in the various sections of these specifications covering construction requiring concrete.
- When it is provided that concrete will be measured at the mixer, the volume in cubic meters shall be computed as the total mass of the batch in kilograms divided by the density of the concrete in kilograms per cubic meter. The total mass of the batch shall be calculated as the sum of all materials, including water, entering the batch. The density of the concrete will be determined in conformance with the requirements in California Test 518.

90-11.02 PAYMENT

- Portland cement concrete will be paid for in conformance with the provisions specified in the various sections of these specifications covering construction requiring concrete.
- Full compensation for furnishing and incorporating admixtures required by these specifications or the special provisions will be considered as included in the contract prices paid for the concrete involved and no additional compensation will be allowed therefor.
- Should the Engineer order the Contractor to incorporate any admixtures in the concrete when their use is not required by these specifications or the special provisions, furnishing the admixtures and adding them to the concrete will be paid for as extra work as provided in Section 4-1.03D, "Extra Work."
- Should the Contractor use admixtures in conformance with the provisions in Section 90-4.05, "Optional Use of Chemical Admixtures," or Section 90-4.07, "Optional Use of Air-entraining Admixtures," or should the Contractor request and obtain permission to use other admixtures for the Contractor's benefit, the Contractor shall furnish those admixtures and incorporate them into the concrete at the Contractor's expense and no additional compensation will be allowed therefor.

SECTION 12. BUILDING WORK

SECTION 12-1. GENERAL REQUIREMENTS

12-1.01 SCOPE

Building work described herein and as shown on the plans shall conform to the requirements of these special provisions and Sections 1 through 9 of the Standard Specifications. Sections 10 through 95 of the Standard Specifications shall not apply to the work in this Section 12 except when specific reference is made thereto.

The building work to be done consists, in general, of upgrading 6 existing Comfort Stations including related mechanical, electrical, and sanitary work; and such other items or details, not mentioned above, that are required by the plans, Standard Specifications, or these special provisions shall be performed, placed, constructed or installed at the westbound and eastbound Whitewater Safety Roadside Rest Areas.

12-1.02 ABBREVIATIONS

Section 1-1.02, "Abbreviations," of the Standard Specifications is amended by adding the following:

AAMA	American Architectural Manufacturers' Association
ACI	American Concrete Institute
AGA	American Gas Association
AITC	American Institute of Timber Construction
AMCA	Air Movement and Control Association
APA	American Plywood Association
ARI	American Refrigeration Institute
ASHRAE	American Society of Heating, Refrigeration and Air Conditioning Engineers
CBC	California Building Code
CEC	California Electrical Code
CMC	California Mechanical Code
CS	Commercial Standards (US Department of Commerce)
ESO	Electrical Safety Orders
FGMA	Flat Glass Marketing Association
FM	Factory Mutual
FS	Federal Specification
ICBO	International Conference of Building Officials
NAAMM	National Association of Architectural Metal Manufacturers
NBFU	National Board Fire Underwriters
NEC	National Electrical Code
NFPA	National Fire Protection Association
PEI	Porcelain Enamel Institute
PS	Product Standard (US Department of Commerce)
RIS	Redwood Inspection Service
SCPI	Structural Clay Products Institute
SMACNA	Sheet Metal and Air Conditioning Contractors' National Association
SSPC	Steel Structures Paint Council
TCA	Tile Council of America
TPI	Truss Plate Institute
UBC	Uniform Building Code
UL	Underwriters Laboratories, Inc.
WCLIB	West Coast Lumber Inspection Bureau (stamped WCLB)
WCLB	Grade stamp for WCLIB
WIC	Woodwork Institute of California
WWPA	Western Wood Products' Association

When reference is made to the Uniform Building Code (UBC) on the plans or in the special provisions, it shall be the 1997 Uniform Building Code as amended by the 1998 Title 24 California Building Standards Code.

12-1.03 GUARANTEE

The Contractor hereby unconditionally guarantees that the building work will be done in accordance with the requirements of the contract, and further guarantees the building work of the contract to be and remain free of defects in workmanship and materials for a period of one year from the date of acceptance of the contract, unless a longer guarantee period is required elsewhere in these special provisions. The Contractor hereby agrees to repair or replace any and all building work, together with any other adjacent work which may be displaced in so doing, that may prove to be not in accordance with the requirements of the contract or that may be defective in its workmanship or material within the guarantee period specified, without any expense whatsoever to the Department, ordinary wear and tear and unusual abuse or neglect excepted.

The performance bond for contract price of the building work, shall remain in full force and effect during the guarantee period.

The Contractor further agrees, that within 10 calendar days after being notified in writing by the Department of any building work not in accordance with the requirements of the contract or any defects in the building work, he shall commence and prosecute with due diligence all work necessary to fulfill the terms of this guarantee, and shall complete the work within a reasonable period of time, and, in the event he fails to comply, he does hereby authorize the Department to proceed to have such work done at the Contractor's expense and he shall honor and pay the cost and charges therefor upon demand. The Department shall be entitled to all costs and expenses, including reasonable attorney's fees, necessarily incurred upon the Contractor's refusal to honor and pay the above costs and charges.

12-1.04 AREAS FOR CONTRACTOR'S USE

No area is available within the contract limits for the exclusive use of the Contractor. The Contractor shall arrange with the Engineer for areas to store equipment and materials within the work area.

12-1.05 COOPERATION

Attention is directed to Sections 7-1.14, "Cooperation," and 8-1.10, "Utility and Non-Highway Facilities," of the Standard Specifications and these special provisions.

Work by the telephone company to install telephone enclosures and telephones, will be performed during the contract work.

12-1.06 SUBMITTALS

Working drawings, material lists, descriptive data, samples and other submittals specified in these special provisions shall be submitted for approval in accordance with the provisions in Section 5-1.02, "Plans and Working Drawings," of the Standard Specifications and these special provisions.

Unless otherwise permitted in writing by the Engineer, all submittals required by these special provisions shall be submitted within 35 days after the contract has been approved.

Attention is directed to the provisions in Section 5-1.01, "Authority of Engineer," of the Standard Specifications. The Engineer may request submittals for materials or products where submittals have not been specified in these special provisions, or may request that additional information be included in specified submittals, as necessary to determine the quality or acceptability of such materials or products.

Attention is directed to Section 6-1.05, "Trade Names and Alternatives," of the Standard Specifications. The second indented paragraph of the first paragraph of said Section 6-1.05 is amended to read:

Whenever the specifications permit the substitution of a similar or equivalent material or article, no test or action relating to the approval of such substituted material will be made until the request for substitution is made in writing by the Contractor accompanied by complete data as to the equality of the material or article proposed. Such request shall be made within 35 days after the date the contract has been approved and in ample time to permit approval without delaying the work, but need not be made in less than 35 days after award of the contract.

Work requiring the submittal of working drawings, material lists, descriptive data, samples, or other submittals shall not begin prior to approval of said submittal by the Engineer. Fifteen working days shall be allowed for approval or return for correction of each submittal or resubmittal. Should the Engineer fail to complete his review within the time specified and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of the delay in review, an extension of time commensurate with the delay in completion of the work thus caused will be granted as provided in Section 8-1.07, "Liquidated Damages," of the Standard Specifications.

Submittals shall be delivered to the locations indicated in these special provisions. If a specific location is not indicated, the submittal shall be delivered to the Division of Structure Design, Documents Unit, Fourth Floor, Mail Station 9-4/4I, 1801 30th Street, Sacramento, California 95816, telephone (916) 227-8252, or the submittals shall be mailed to the Division of Structure Design, Documents Unit, Mail Station 9, P. O. Box 942874, Sacramento, California 94274-0001.

Each submission of drawings, material lists and descriptive data shall consist of at least 5 copies. Two copies will be returned to the Contractor either approved for use or returned for correction and resubmittal.

Each separate item submitted shall bear a descriptive title, the name of the project, district, county, and contract number. Plans and detailed drawings shall be not larger than 559 mm x 914 mm.

The material list shall be complete as to name of manufacturer, catalog number, size, capacity, finish, all pertinent ratings, and identification symbols used on the plans and in the special provisions for each unit.

Parts lists and service instructions packaged with or accompanying the equipment installed in the work shall be delivered to the Engineer at the jobsite. Required operating and maintenance instructions shall be submitted in triplicate.

Manufacturer's warranties for products installed in the work shall be delivered to the Engineer at the jobsite.

Unapproved samples and samples not incorporated in the work shall be removed from State property, when directed by the Engineer.

12-1.07 PROGRESS SCHEDULE

A progress schedule shall be submitted in duplicate for the building work in accordance with the requirements in Section 8-1.04, "Progress Schedule," of the Standard Specifications.

12-1.08 SCHEDULE OF VALUES

The sum of the items listed in the Schedule of Values shall equal the contract lump sum price for building work. Overhead, profit, bond premium, temporary construction facilities, and plant shall not be listed.

12-1.09 INSPECTION

All items covered or all stages of work that are not to remain observable must be inspected and approved before progress of work conceals portions to be inspected. The Contractor shall notify the Engineer not less than 72 hours in advance of when such inspection is needed.

12-1.10 OBSTRUCTIONS

Attention is directed to Sections 7-1.11, "Preservation of Property," 7-1.12, "Responsibility for Damage," 7-1.16, "Contractor's Responsibility for the Work and Materials," and 8-1.10, "Utility and Non-Highway Facilities," of the Standard Specifications.

The Contractor shall notify the Engineer and the appropriate regional notification center for operators of subsurface installations at least 5 working days prior to performing any excavation or other work close to any underground pipeline, conduit, duct, wire or other structure. Regional notification centers include but are not limited to the following:

Underground Service Alert
Northern California (USA)
Telephone: 1(800)642-2444

Underground Service Alert
Southern California (USA)
Telephone: 1(800)422-4133

South Shore Utility
Coordinating Council (DIGS)
Telephone: 1(800)541-3447

Western Utilities
Underground Alert, Inc.
Telephone: 1(800)424-3447

12-1.11 PRESERVATION OF PROPERTY

Attention is directed to Sections 7-1.11, "Preservation of Property," 7-1.12, "Responsibility for Damage," 7-1.16, "Contractor's Responsibility for the Work and Materials," and 8-1.10, "Utility and Non-Highway Facilities," of the Standard Specifications.

Operations shall be conducted in such a manner that existing facilities, surfacing, installations, and utilities which are to remain in place will not be damaged. Temporary surfacing, facilities, utilities and installations shall also be protected until they are no longer required. The Contractor, at his expense shall furnish and install piling, sheet piling, cribbing, bulkheads, shores, or whatever means may be necessary to adequately support material carrying such facilities, or to support the facilities themselves and shall maintain such support until they are no longer needed.

12-1.12 UTILITY CONNECTION

The Contractor shall make all arrangements, and obtain all permits and licenses required for the extension of and connection to each utility service applicable to this project, shall furnish all labor and materials necessary for such extensions which are not performed or provided by the utility, and shall furnish and install any intermediate equipment required by the serving utilities.

Upon written request by the Contractor, the State will pay all utility permits, licenses, connection charges, and excess length charges directly to the utility. Such request shall be submitted not less than 45 days before service connections are required.

The costs incurred by the Contractor for the extensions of utilities beyond the limits shown on the plans, and in furnishing and installing any intermediate equipment required by the serving utilities, will be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications.

Full compensation for any costs incurred by the Contractor to obtain the permits and licenses shall be considered as included in the contract lump sum price paid for building work and no additional compensation will be allowed therefor.

12-1.13 TEMPORARY UTILITIES

The Contractor may obtain electrical power and water from existing State electrical power and water outlets within the contract limits free of charge for contract operations where such utilities exist, provided that such utility services are in service and are not required by the State for other purposes and subject to the provisions in the section "Cooperation" of these special provisions.

The Contractor shall make his own arrangements to obtain any additional electrical power and water or other utilities required for his operations and shall make and maintain the necessary service connections at his own expense.

When existing utility systems are being modified, periods of shutdown will be determined by the Engineer.

The Contractor shall provide adequate temporary lighting to perform the work and allow the Engineer to inspect the project as each portion is completed.

The Contractor shall provide and pay for telephone service he may require. State telephone facilities shall not be used.

12-1.14 SANITARY FACILITIES

When operational, State sanitary facilities will be available for use by the Contractor's employees, during normal State working hours. Tools shall not be cleaned nor shall cleaning liquids be disposed of in State sanitary facilities or sewers.

12-1.15 REFERENCES

When reference is made to the Uniform Building Code (UBC) on the plans or in the special provisions, it shall be the 1997 Uniform Building Code as amended by the 1998 Title 24 California Building Standards Code.

12-1.16 MEASUREMENT AND PAYMENT

The contract lump sum price paid for building work shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in constructing the building work, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

Full compensation for any incidental materials and labor, not shown on the plans or specified, which are necessary to complete the buildings and appurtenances shall be considered as included in the contract lump sum price paid for building work and no additional compensation will be allowed therefor.

12-1.17 SUBSTITUTION OF NON-METRIC MATERIALS AND PRODUCTS

Only materials and products conforming to the requirements of the specifications shall be incorporated in the work. When metric materials and products are not available, and when approved by the Engineer, and at no cost to the State, materials and products in the inch-pound (imperial) system which are of equal quality and of the required properties and characteristics for the purpose intended, may be substituted for the equivalent metric materials and products, subject to the following requirements:

Materials and products shown on the plans or in the special provisions as being equivalent may be substituted for the metric materials and products specified or detailed on the plans.

Before other non-metric materials and products will be considered for use the Contractor shall furnish, at the Contractor's expense, evidence satisfactory to the Engineer that the materials and products proposed for use are equal to or better than the materials and products specified or detailed on the plans. The burden of proof as to the quality and suitability of substitutions shall be upon the Contractor and the Contractor shall furnish all information necessary as required to the Engineer. The Engineer will be the sole judge as to the quality and suitability of the substituted materials and products and the Engineer's decision shall be final.

When the Contractor elects to substitute non-metric materials and products, including materials and products shown on the plans or in the special provisions as being equivalent, a list of substitutions to be made shall be submitted for approval.

The following substitutions of materials and products will be allowed:

SUBSTITUTION TABLE FOR SIZES OF HIGH STRENGTH STEEL FASTENERS, ASTM Designation: A 325M	
METRIC SIZE SHOWN ON THE PLANS mm x thread pitch	IMPERIAL SIZE TO BE SUBSTITUTED inch
M16 x 2	5/8
M20 x 2.5	3/4
M22 x 2.5	7/8
M24 x 3	1
M27 x 3	1-1/8
M30 x 3.5	1-1/4
M36 x 4	1-1/2

SUBSTITUTION TABLE FOR REINFORCEMENT	
METRIC BAR DESIGNATION NUMBER AS SHOWN ON THE PLANS	IMPERIAL BAR DESIGNATION NUMBER TO BE SUBSTITUTED
10	3
13	4
16	5
19	6
22	7
25	8
29	9
32	10
36	11
43	14
57	18

SUBSTITUTION TABLE FOR WELDED PLAIN WIRE REINFORCEMENT, ASTM DESIGNATION: A 185	
	US CUSTOMARY UNITS SIZE TO BE SUBSTITUTED inch ² x 100
MW9	W1.4
MW10	W1.6
MW13	W2.0
MW15	W2.3
MW19	W2.9
MW20	W3.1
MW22	W3.5
MW25	W3.9, except W3.5 in piles only
MW26	W4.0
MW30	W4.7
MW32	W5.0
MW35	W5.4
MW40	W6.2
MW45	W6.5
MW50	W7.8
MW55	W8.5, except W8.0 in piles only
MW60	W9.3
MW70	W10.9, except W11.0 in piles only
MW80	W12.4
MW90	W14.0
MW100	W15.5

The sizes in the following tables of materials and products are exact conversions of metric sizes of materials and products and are listed as acceptable equivalents:

CONVERSION TABLE FOR SIZES OF: (1) STEEL FASTENERS FOR GENERAL APPLICATIONS, ASTM Designation: A 307 or AASHTO Designation: M 314, Grade 36 or 55, and (2) HIGH STRENGTH STEEL FASTENERS, ASTM Designation: A 325 or A 449	
DIAMETER	
METRIC SIZE SHOWN ON THE PLANS mm	EQUIVALENT IMPERIAL SIZE inch
6, or 6.35	1/4
8 or 7.94	5/16
10, or 9.52	3/8
11, or 11.11	7/16
13 or 12.70	1/2
14, or 14.29	9/16
16, or 15.88	5/8
19, or 19.05	3/4
22, or 22.22	7/8
24, 25, or 25.40	1
29, or 28.58	1-1/8
32, or 31.75	1-1/4
35, or 34.93	1-3/8
38 or 38.10	1-1/2
44, or 44.45	1-3/4
51, or 50.80	2
57, or 57.15	2-1/4
64, or 63.50	2-1/2
70 or 69.85	2-3/4
76, or 76.20	3
83, or 82.55	3-1/4
89 or 88.90	3-1/2
95, or 95.25	3-3/4
102, or 101.60	4

CONVERSION TABLE FOR NOMINAL THICKNESS OF SHEET METAL			
UNCOATED HOT AND COLD ROLLED SHEETS		HOT-DIPPED ZINC COATED (GALVANIZED) SHEETS	
METRIC THICKNESS SHOWN ON THE PLANS mm	EQUIVALENT US STANDARD GAGE inch	METRIC THICKNESS SHOWN ON THE PLANS mm	EQUIVALENT GALVANIZED SHEET GAGE inch
7.94	0.3125		
6.07	0.2391		
5.69	0.2242		
5.31	0.2092		
4.94	0.1943		
4.55	0.1793		
4.18	0.1644	4.270	0.1681
3.80	0.1495	3.891	0.1532
3.42	0.1345	3.510	0.1382
3.04	0.1196	3.132	0.1233
2.66	0.1046	2.753	0.1084
2.28	0.0897	2.372	0.0934
1.90	0.0747	1.994	0.0785
1.71	0.0673	1.803	0.0710
1.52	0.0598	1.613	0.0635
1.37	0.0538	1.461	0.0575
1.21	0.0478	1.311	0.0516
1.06	0.0418	1.158	0.0456
0.91	0.0359	1.006 or 1.016	0.0396
0.84	0.0329	0.930	0.0366
0.76	0.0299	0.853	0.0336
0.68	0.0269	0.777	0.0306
0.61	0.0239	0.701	0.0276
0.53	0.0209	0.627	0.0247
0.45	0.0179	0.551	0.0217
0.42	0.0164	0.513	0.0202
0.38	0.0149	0.475	0.0187

CONVERSION TABLE FOR WIRE		
METRIC THICKNESS SHOWN ON THE PLANS	EQUIVALENT USA STEEL WIRE THICKNESS	GAGE NO.
mm	inch	
6.20	0.244	3
5.72	0.225	4
5.26	0.207	5
4.88	0.192	6
4.50	0.177	7
4.11	0.162	8
3.76	0.148	9
3.43	0.135	10
3.05	0.120	11
2.69	0.106	12
2.34	0.092	13
2.03	0.080	14
1.83	0.072	15
1.57	0.062	16
1.37	0.054	17
1.22	0.048	18
1.04	0.041	19
0.89	0.035	20

CONVERSION TABLE FOR COMMON NAILS				
NAIL SIZE	METRIC		ENGLISH	
	mm		inch	
	Length	Diameter	Length	Diameter
8d	63.5	3.33	2 1/2	0.131
10d	76.2	3.76	3	0.148
16d	88.9	4.11	3 1/2	0.162

CONVERSION TABLE FOR LUMBER	
METRIC NOMINAL SURFACE DRY SIZE	EQUIVALENT NOMINAL SURFACE DRY U S SIZE
mm	inch
51	2
102	4
152	6
203	8
254	10
305	12

CONVERSION TABLE FOR PLYWOOD	
METRIC mm	ENGLISH inch
6.4	1/4
7.9	5/16
9.5	3/8
11.1	7/16
11.9	15/32
12.7	1/2
15.1	19/32
15.9	5/8
18.3	23/32
19.1	3/4
22.2	7/8
25.4	1
28.6	1 1/8

CONVERSION TABLE FOR INSULATION R-VALUE	
METRIC (K m ² /W)	ENGLISH (HR FT ² F/BTU)
0.5	3
0.7	4
1.4	8
1.9	11
2.3	13
2.5	14
3.3	19
5.3	30

CONVERSION TABLE FOR VAPOR TRANSMISSION RATING	
METRIC (Perm-m)	ENGLISH (perm-inch)
0.29	0.02

CONVERSION TABLE FOR LOW PRESSURE	
METRIC (Pa)	ENGLISH (Inches of Water Column)
30	0.125
60	0.25
90	0.375
120	0.50
150	0.60
155	0.625
175	0.70
185	0.75
200	0.80
250	1.00
310	1.25

CONVERSION TABLE FOR PRESSURE	
METRIC (kPa)	ENGLISH (psi)
10	1.5
210	30
280	40
350	50
690	100
860	125
1040	150
1100	160
1210	175
1380	200
1730	250
2070	300
2170	315
2410	350
2590	375
2760	400
4830	700
5170	750
5520	800
13800	2000
17200	2500
20700	3000
27600	4000
34500	5000
137900	20000

CONVERSION TABLE FOR MIL THICKNESS	
METRIC (mm)	ENGLISH (inch/1000)
0.10	4
0.13	5
0.15	6
0.50	20
0.75	30
1.00	40

CONVERSION TABLE FOR HVAC DUCTING.	
METRIC (mm)	ENGLISH (inch)
100	4
125	5
150	6
175	7
200	8
225	9
250	10
300	12
360	14
410	16
460	18
510	20
560	22
610	24
660	26
710	28
760	30

CONVERSION TABLE FOR MECHANICAL PIPING		
METRIC (GSP, PVC, BSP, DUCTILE IRON)	METRIC (mm)	ENGLISH (inch)
NPS 1/2	15	1/2
NPS 3/4	20	3/4
NPS 1	25	1
NPS 1 1/4	32	1 1/4
NPS 1 1/2	40	1 1/2
NPS 2	50	2
NPS 2 1/2	65	2 1/2
NPS 3	75	3
NPS 4	100	4
NPS 6	150	6

CONVERSION TABLE FOR LUBRICATION PIPING TUBING WALL THICKNESS	
METRIC (mm)	ENGLISH (inch)
2.1	0.083
0.9	0.035

CONVERSION TABLE FOR HOSE/TUBING SIZES O. D.	
METRIC (mm)	ENGLISH (inch)
6	1/4
10	3/8
13	1/2
16	5/8
19	3/4
22	7/8
25	1

CONVERSION TABLE FOR DRUM SIZES			
METRIC		ENGLISH	
L	kg	gallons	pounds
205	180	55	400
60	55	16	120
19	16	5	35

CONVERSION TABLE FOR POWER	
METRIC (kW)	ENGLISH (HP)
0.037	1/20
0.075	1/10
0.18	1/4
0.25	1/3
0.37	1/2
0.55	3/4
0.75	1
1.1	1 1/2
1.5	2
2.2	3
3.7	5
5.5	7 1/2
7.5	10
11	15
15	20
18.5	25
22	30
30	40
37	50
45	60
55	75
75	100
90	120
110	150

CONVERSION TABLE FOR IMPELLER BALANCE		
SYNCHRONOUS RPM	METRIC (g mm/kg)	ENGLISH (ounce- inch/pound)
720	94	0.059
900	73	0.046
1200	54	0.034
1800	41	0.026
3600	17	0.011

CONVERSION TABLE FOR ELECTRICAL CONDUIT	
METRIC SIZE SHOWN ON THE PLANS mm	EQUIVALENT IMPERIAL SIZE inch
16	1/2
21	3/4
27	1
35	1 1/4
41	1 1/2
53	2
103	4

SECTION 12-2. SITEWORK

12-2.01 REMOVING PORTIONS OF EXISTING FACILITIES

PART 1.- GENERAL

Scope.--This work shall consist of removing portions of the existing facilities, including removal of existing work to gain access to or for new work, in accordance with the details shown on the plans and these special provisions.

PART 2.- PRODUCTS (Not applicable)

PART 3.- EXECUTION

PREPARATION.--

General.--The limits of removal shall be located and identified. Items to be removed and the interface of items to be removed and items to remain intact shall be identified and marked.

Prior to removing concrete or masonry, a saw cut approximately 25 mm deep shall be made along the limits of removal on all faces that will be visible in the completed work.

REMOVAL.--

General.--Removal shall be to the limits shown on the plans. Removal shall be done carefully to minimize damage to the portions to remain. Remaining portions that are damaged by the Contractor's operation shall be restored to original condition at the Contractor's expense.

Existing apparatuses, devices, or accessories which would be functionally impaired by new construction or remodeling shall be moved, brought out to new surfaces, or provided with new access covers, as necessary to restore apparatuses, devices, or accessories to their original usefulness.

Piping and conduits to be abandoned shall be capped or plugged.

Surfaces that are exposed to view at the limits of removal work shall be patched, bumps shall be removed and depressions filled, and the surface shall be finished to match the existing surrounding surfaces. Depressions in concrete less than 25 mm deep shall be deepened to 25 mm minimum depth before filling with cement mortar.

Anchor bolts and reinforcement shall be removed at least 25 mm below the surrounding surfaces, and the resulting hole shall be patched with cement mortar.

Existing reinforcement that is to be incorporated into the new work shall be protected from damage and thoroughly cleaned before being embedded in new concrete.

REPAIR.--

General.--Existing tile or roof decking at the Comfort Stations that are damaged by reason other than by the Contractor's operations shall be repaired when ordered by the Engineer. Such work shall be as directed by the Engineer, and will be paid for as an ordered change in accordance with the requirements in Section 4-1.03D of the Standard Specifications.

DISPOSAL.--

General.--Materials that are to be removed, shall become the property of the Contractor and shall be disposed of outside the highway right of way in accordance with the requirements in Section 7-1.13, "Disposal of Material Outside of the Highway Right of Way," of the Standard Specifications.

12-2.02 RELOCATING MATERIALS AND EQUIPMENT

PART 1.- GENERAL

SUMMARY.--

Scope.--This work shall consist of relocating existing materials and equipment in accordance with the details shown on the plans and these special provisions.

PART 2.- PRODUCTS (Not applicable)

PART 3.- EXECUTION

RELOCATION.--

General.--Materials or equipment to be relocated shall be removed carefully to avoid damage to the materials or equipment or to the materials or equipment which are to remain. Assemblies to be relocated which require dismantling for removal shall be matchmarked before dismantling.

The Contractor shall notify the Engineer prior to the relocation work in order that the materials or equipment may be inspected for existing damage.

Materials or equipment to be relocated shall have all adhering concrete, mastics, earth or other deleterious materials removed and shall have all exterior surfaces cleaned.

Materials or equipment which are damaged by the Contractor's operations shall be replaced or restored to match the condition of the materials or equipment prior to the beginning of the Contractor's operations. Replacement or restoration of damaged materials or equipment shall be at the Contractor's expense.

Connections, anchorages and fasteners for relocated materials and equipment shall match existing and shall be furnished and installed by the Contractor. Assemblies which have been dismantled shall be reassembled to match the existing installation. Relocated materials and equipment shall be installed as required for new work.

Modifications to wiring and plumbing to accommodate relocated items shall be as shown on the plans. Ends of piping and conduits to be abandoned shall be capped.

Surfaces that are exposed to view upon removal or relocation of materials or equipment shall be patched. Bumps shall be removed and depressions filled, and the surface finished to match the existing surfaces. Depressions in concrete less than 25 mm deep shall be deepened to 25 mm minimum depth before filling with cement mortar.

DISPOSAL.--

General.--Materials from existing facilities to be reused in the work, in the opinion of the Engineer, is unsuitable for use shall become the property of the Contractor and disposed of as provided in Section 7-1.13, "Disposal of Material Outside of the Highway Right of Way." of the Standard Specifications. The unsuitable material shall be replaced as ordered by the Engineer and will be paid for as extra work as provided in Section 4-1.03D, "Extra Work," of the Standard Specifications.

12-2.03 EARTHWORK FOR BUILDING WORK

PART 1.- GENERAL

SUMMARY.--

Scope.--This work shall consist of performing earthwork for building work in accordance with the details shown on the plans and these special provisions.

Earthwork for building work shall consist of structure excavation and structure backfill. Structure excavation shall include excavation for footings, foundations, slabs, and trenches. Structure backfill shall include backfilling under slabs; backfilling under and around footings; backfilling for pipes and conduits; backfilling holes resulting from removal of existing facilities. In addition to structure excavation and structure backfill, earthwork for building work shall include any other earthwork, not mentioned, but necessary to complete the building work.

QUALITY ASSURANCE.--

Samples.--Samples of sand weighing not less than 11 kg, shall be submitted to the Engineer at the jobsite for approval.

SITE CONDITIONS.--

Existing underground piping and conduit.--The location of existing underground piping and conduit is based on the best records available. Before beginning work, the Contractor shall accurately locate the piping and conduit involved in the work. If the location of the existing piping or conduit deviates from the location shown on the plans by more than 1.5 meters, or, if no elevations are indicated and the piping or conduit is more than 0.9 meter below grade, the cost of the additional excavation, backfill, piping or conduit, and removal and replacement of concrete, if any, will be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications.

Existing surfaced or planted areas.--Existing surfaced or planted areas that are removed, broken or damaged by the Contractor's operations shall be restored to their original condition except as otherwise shown on the plans or specified herein.

Restoration materials shall be equal to or better than the original materials. Surfacing shall be replaced to match the material thickness, grades, and finish of the adjacent surrounding surfaces.

PART 2.- PRODUCTS

BACKFILL MATERIALS.--

Structure backfill.--

Structure and trench backfill shall be free of organic and other deleterious material and shall be suitable for the required compaction. Gravel without sand matrix shall not be used except as free draining granular material beneath slabs and footings.

Sand.--

Sand shall be clean, washed sand, free from clay or organic material graded such that 100 percent passes the 6 mm sieve, 90 percent to 100 percent passes the 4.75 mm sieve and not more than 5 percent passes the 75 µm sieve size.

PART 3.- EXECUTION

PREPARATION & RESTORATION.--

Sawcutting.--Prior to excavation or trenching, existing surfacing shall be removed to saw cut lines, or to existing wood dividers or expansion joints, if any. The saw cut shall be to a neat line and have a depth not less than 25 mm.

Restoration.--Surfacing shall be replaced to match the thickness, grades and finish of the adjacent surrounding surfaces.

STRUCTURE EXCAVATION.--

General.--Unless otherwise noted, all excavation for building work shall be classified as structure excavation.

Footing excavation.--The bottom of excavation shall not be disturbed. The contractor shall excavate by hand to the final grade. The bottom of concrete footings shall be poured against undisturbed material. Unless otherwise noted, compaction of the bottom of footing excavation is not required unless the material is disturbed. The footing depths shown on the plans shall be changed to suit field conditions when directed by the Engineer. Solid rock at or near required depths shall

not be disturbed. Unsuitable material shall be excavated down to firm bearing as directed by the Engineer. Work and materials required because of excavation in excess of the depths shown on the plans, when such excavation has been ordered by the Engineer, will be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications.

Excavate to the elevations and dimensions within a tolerance of ± 12 mm. Limits of the excavation shall allow for adequate working space for installing materials and as required for safety of personnel. Such working space excavation shall be replaced in kind and compacted at the Contractor's expense.

Overdepth excavation for footings shall be backfilled with concrete or such other material recommended by the Contractor and approved by the Engineer. Relative compaction shall be not less than 95 percent.

Excavation for pipes and conduits.--Pipes or conduits in the same trench shall have a minimum clear distance between pipes or conduits of 150 mm. Pipes or conduits shall have not less than 0.75 meter of cover from top of pipes or conduits to finished grade unless otherwise shown on the plans or specified.

Trenching shall be of sufficient depth to permit placing a minimum depth of 100 mm of compacted sand under all pipes and conduits.

Dewatering.--Excavations shall be kept clear of standing water. Water shall be removed by pumping if necessary. Water removed from excavation shall be carried away from the building site and disposed of in a manner that will not harm State or adjacent property.

STRUCTURE BACKFILLING.--

General.--Unless otherwise noted, all backfill for building work shall be classified as structure backfill. Backfill shall be placed and compacted in horizontal layers, not more than 150 mm thick prior to compaction, and to the lines and grades shown on the plans or to original ground.

Structure backfill.--After structures are in place and forms are removed, wood and other debris shall be removed from excavations before placing structure backfill.

Unless approved in writing by the Engineer, compaction of structure or select backfill by jetting or ponding will not be permitted.

Backfilling pipes and conduits.--Backfill placed under pipe and conduits shall be compacted sand, 100 mm minimum depth. Backfill material placed to a level 150 mm above tops of pipes and conduits shall be sand. Backfill material placed higher than 150 mm above tops of pipes or conduits shall consist of material free of stones or lumps exceeding 100 mm in greatest dimension except:

- (a) The top 300 mm of backfill under roads, walks or paving shall consist of aggregate base material.
- (b) The top 150 mm of backfill in planted areas shall consist of topsoil.

COMPACTION.--

General.--Relative compaction shall be determined in accordance with California Test 216 or 231.

Unless otherwise noted below, all backfill shall be compacted to a minimum relative compaction of 90 percent.

Compact original ground.--Original ground surface under fill with surfacing of concrete and asphalt concrete shall be compacted to a relative compaction of not less than 95 percent for a minimum depth of 150 mm.

Structure backfill.--Structure backfill shall be compacted to not less than 95 percent relative compaction.

Trench backfill.--Trench backfill placed beneath slabs or paved areas shall be compacted to a relative compaction of not less than 95 percent.

DISPOSAL.--

Surplus material.--Surplus material from the excavation shall be removed and disposed of outside the right-of-way in accordance with Section 7-1.13 of the Standard Specifications.

FIELD QUALITY CONTROL.--

Inspection.--When the excavation is substantially completed to grade, the Contractor shall notify the Engineer. No concrete shall be placed until the foundation has been approved by the Engineer.

Testing.--The State will conduct compaction tests during the backfilling and compacting operations.

12-2.04 AGGREGATE BASE

PART 1.-GENERAL

SUMMARY.--

Scope.--This work shall consist of furnishing, spreading and compacting aggregate base in accordance with the details shown on the plans and these special provisions.

PART 2.-PRODUCTS

Aggregate base.--

Aggregate base shall be commercial quality aggregates consisting of broken stone; crushed gravel; natural, clean, rough-surfaced gravel and sand; or a combination thereof.

Aggregate base shall conform to the following grading as determined by California Test 202:

Sieve or Screen Size	Percentage Passing
25 mm	100
19 mm	90 - 100
4.75 mm	35 - 60
600 µm	10 - 30
75 µm	2 - 9

Aggregate base shall also conform to the following quality requirements:

Tests	California Test No.	Test Requirements
Durability Index	229	35 Min.
Resistance (R-Value)	301	78 Min.
Sand Equivalent	217	22 Min.

PART 3.-EXECUTION

SPREADING AND COMPACTING.--

Spreading.--Aggregate base shall be placed and compacted to the lines and grades shown on the plans.

Spreading and compacting shall be performed by methods that will produce a uniform base, free from pockets of coarse or fine material.

Compaction.--Relative compaction of each layer of compacted base material shall be not less than 95 percent, as determined by California Test 216 or 231.

12-2.05 PAINTED PAVEMENT MARKINGS

PART 1.- GENERAL.--

Scope.--This work shall consist of furnishing and applying paint for pavement markings in accordance with the details shown on the plans and these special provisions.

Pavement markings include, but are not limited to, word and symbol markings, and parking stall markings.

PART 2.- PRODUCTS.--

Paint.--

Paint shall be top commercial quality for pavement marking, formulated for the use intended, and manufactured by a nationally recognized manufacturer of paint and other coating products.

The kind of paint to be used (solvent or water borne) shall be determined by the Contractor, based on local air pollution control regulations and weather conditions.

PART 3.- EXECUTION.--

ALIGNMENT AND LAYOUT.--All necessary alignment and layout work shall be performed by the Contractor, in a manner that will not damage the pavement.

Unless otherwise shown on the plans, the width of parking stall markings shall be 105 mm.

EQUIPMENT AND OPERATION.--Mechanical means shall be used to paint pavement markings.

All equipment used in the application of paint shall produce pavement markings of uniform quality.

All spray equipment shall be the proper type and of adequate capacity for the work involved.

Air atomized spray equipment shall be equipped with oil and water extractors and pressure regulators, and shall have adequate air volume and compressor recovery capacity. Spray gun tip needle assemblies and orifices shall be the proper size.

Rapid dry paint shall be applied only with airless type equipment.

Stencils and hand spray equipment shall be used to paint word and symbol markings. Stencils shall be furnished by the Contractor. The stencil layout shall conform to the dimensions shown on the plans.

SURFACE PREPARATION.--Surfaces which are to receive paint shall be cleaned of all dirt and loose material.

APPLICATION.--Paint shall be applied only on dry surfaces, and only during periods of favorable weather, in accordance with the manufacturer's recommendations.

On new surfacing, paint shall be applied in 2 coats. The first coat shall be dry before application of the second coat is applied.

On existing surfacing, paint shall be applied in one coat.

Completed pavement markings shall have clean and well-defined edges, and shall conform to the dimensions shown on the plans or as specified in these special provisions.

Drips, oversprays, improper markings, and paint material tracked by traffic shall be immediately removed from the pavement by methods approved by the Engineer. All such removal shall be at the Contractor's expense.

APPLICATION RATES.--Each application of paint shall be applied at the rates recommended by the paint manufacturer for the type of surface involved.

PROTECTION.--Newly placed pavement markings shall be protected from damage by traffic or other causes until the paint is thoroughly dry.

DISABLED ACCESSIBLE PARKING STALL SYMBOL.--Each parking space reserved for persons with physical disabilities shall have a minimum 0.9 m x 0.9 m surface identification with the international symbol of accessibility. The symbol and border shall be white and the background shall be blue conforming to Federal Standard 595B, Color No. 15090.

12-2.06 SEPTIC SEWAGE DISPOSAL SYSTEM

PART 1.- GENERAL

SUMMARY.--

Scope.--This work shall consist of modifying a septic sewage disposal system in accordance with the details shown on the plans and these special provisions.

Septic sewage disposal system shall include piping and such other materials and appurtenances, not mentioned, which are required for the complete installation and proper operation of the system.

Related work.--Sewer pipes in buildings and to a point 1.5 meters beyond the buildings shall be as specified in Section 12-15, "Mechanical," of these special provisions.

Order of Work.--Work which will curtail the use of the existing sewage system shall not be done until the facilities utilizing the system are closed and are no longer required.

SUBMITTALS.--

Product data.--Material lists for materials to be used shall be submitted for approval and shall include the name of the manufacturer and the source, model number, description, and standard of manufacture.

Manufacturer's descriptive data and catalog cuts for the following shall be submitted for approval:

- Sewer pipe and fittings
- Manhole frames and covers
- Valve boxes
- Diversion valve

Working drawings.--Working drawings and design calculations for each precast septic tank used in the work shall be submitted for approval. The drawings and calculations shall be stamped and signed by an engineer who is registered as a Civil or Structural Engineer in the State of California. Complete bedding, assembly, installation and backfilling instructions for manufactured sewer structures shall be submitted for approval.

QUALITY ASSURANCE.--

Codes and standards.--All sanitary sewage work shall conform to the applicable portions of the 1997 Uniform Plumbing Code as amended by the latest edition of the California Building Standards Code.

Certificates of Compliance.--Certificates of compliance shall be furnished for manhole frames and covers in accordance with the requirements specified in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications.

PART 2.- PRODUCTS

MATERIALS.--

PIPES AND PIPE FITTINGS.--

Sewer pipe.--

Sewer pipe and fittings shall be polyvinyl chloride (PVC) gravity sewer plastic pipe and fittings conforming to ASTM Designation: D 3034, Standard Dimension Ratio (SDR) 35, with integral bell and bell and spigot rubber gasketed joints or conforming to ASTM Designation: D2665 with solvent welded fittings. Rubber gaskets shall conform to ASTM Designation: F 477. Stainless steel clamps with rubber boots shall not be used.

Sewer pipe adapters.--

Sewer pipe adapters from PVC, cast iron soil pipe or clay piping shall be PVC-DWV adapters, conforming to ASTM Designation: D 2665; or PVC sewer pipe adapters, conforming to ASTM Designation: D 3034. Rubber boot and clamps shall not be used.

MANHOLES AND VALVE BOXES.--

Manholes.--

Manholes shall be precast, reinforced concrete conforming to ASTM Designation: C 478M or precast reinforced concrete pipe conforming to ASTM Designation: C 76.

Manhole frame and cover.--

Manhole frame and cover shall be gray cast iron, conforming to ASTM Designation: A 48, Class 30 or greater (traffic type). Cover shall be no bolt, gas tight, closed pick hole and shall be marked "SS," "SEWER," or "SANITARY SEWER." The side or bottom of the cover shall be machined grooved for an integral O-ring gasket. The frame seat for the bottom O-ring gasket shall be a minimum of 22 mm in width. The machine groove may be omitted and a flat gasket may be used, provided that the gasket is bonded to the frame seat with contact cement.

Valve box.--

Valve box and cover shall be precast concrete box with cast iron cover. Cover shall be factory marked "SEWER," "SS," or "SANITARY SEWER", and shall be traffic rated where shown on the plans. Valve box shall be Cook Concrete Products, No. 10-T-12; Christy No. G-5C; Brooks, No. 3-RT; or equal with extensions as required.

VALVES.--

PVC diversion valve.--

PVC diversion valve shall be PVC, NPS 4 Schedule 40, 3-way female connections with 2 outlets 120 degrees from inlet, PVC riser and PVC watertight riser cap and adapter, concrete valve box with extensions as required, and valve key. Valve key shall operate from the surface. The valve shall be UPC listed and shall withstand a working pressure of 172 368 kPa.

PART 3.- EXECUTION

PREPARATION.--

Existing system.--Connections to the existing system shall be as approved by the Engineer.

INSTALLATION OF SEWER PIPES AND FITTINGS.--

Pipe.--Sewer pipe shall be installed upgrade unless otherwise permitted by the Engineer.

Damaged or misaligned pipe shall be corrected prior to use.

Sewers near water lines shall be installed below water line in the same trench, in parallel trenches less than 3 meters apart, or at any crossing.

When water line crosses above a sewer line, a vertical separation of not less than 305 mm shall be maintained between the top of the sewer and the bottom of the water line.

When a sewer line crosses 610 mm or more below a water line, no extra protection is required. When a sewer line crosses less than 610 mm below a water line, the sewer pipe shall be cast iron pipe with leaded or mechanical joints or at least 1.83 meters in both directions from the crossing, or the sewer line shall be encased in concrete of 150 mm minimum thickness for the same distance.

When a water line must cross under a sewer line, a vertical separation of at least 460 mm between the bottom of the sewer line and the top of the water pipe shall be maintained with support provided for the sewer to prevent settling. The sewer shall be constructed of cast iron pipe with leaded or mechanical joints for at least 1.83 meters in both directions from the crossing, or the sewer shall be encased in concrete of 150 mm minimum thickness for the same distance.

Cleaning pipe.--Interior of pipes shall be cleaned of dirt and other materials as the work progresses.

Joint adapters.--Joints between different types of pipes shall be made with standard manufactured adapters and fittings intended for that purpose.

INSTALLATION OF MANHOLES AND VALVE BOXES.--

Sewer structures.--Manufactured sewer structures shall be installed in accordance with the manufacturer's recommendations and to the lines and grades shown on the plans.

A concrete collar shall be cast in place around each manhole in accordance with the details shown on the plans. Forms shall be used for constructing concrete collars.

INSTALLATION OF VALVES.--

Diversion valve.--The diversion valve shall have an inner riser and riser cap which is connected to the valve body and shall be installed 90 degrees to near grade as shown on the plans. The outer valve box extensions shall rest on the cast-in-place concrete block and shall be installed 90 degrees to grade as shown on the plans. A cast-in-place concrete block shall be constructed to surround the valve body and fittings. A cast-in-place concrete collar shall be constructed around the valve box.

FIELD QUALITY CONTROL.--

TESTING.--

Testing pipes.--All sewer pipes shall be tested for obstructions before covering the pipes by balling and flushing the pipes with an approved commercial sewer cleaning ball. The ball shall be moved slowly through the sewer with a tag line. NPS 4 sewer pipe shall be tested by pulling an appropriate sized inflatable plug through the pipe. Obstructions or irregularities shall be removed or repaired.

Sewer pipes shall be tested for leakage for a minimum period of 4 hours by filling with water to an elevation of 1.22 meters above the average invert of sewer, or to the top of the manholes where less than 1.22 meters deep. The system shall show no visible leaks, and the leakage rate shall not exceed 13.25 liters per 24 hours, per 25 mm diameter, per 30.5 meters of pipe. Sewers may be tested in sections with the test water progressively passed down the sewers if feasible. Water shall be released at a rate which will not create water hammer or surge in the plugged section of sewer.

In lieu of hydrostatic test with water, the air test method, as outlined in the Uniform Plumbing Code (UPC), "Low Pressure Air Test for Building Sewers," may be used.

12-2.07 PARKING BUMPERS

PART 1.- GENERAL

Scope.--This work shall consist of furnishing and installing precast concrete parking bumpers in accordance with the details shown on the plans and these special provisions.

PART 2.- PRODUCTS

Parking bumpers.--

Parking bumpers shall be commercially available precast parking bumpers.

Parking bumpers shall be 1220 mm long, nominal 200 mm wide and 150 mm high with both top longitudinal corners continuously chamfered, and anchor holes 230 mm from each end.

PART 3.- EXECUTION

Layout.--Arrangement of parking bumpers shall be coordinated with the layout of parking stalls and traffic aisles, providing the proper angle to engage wheels and proper location to prevent overtravel of vehicles.

Parking bumpers shall be anchored with two 19 mm diameter reinforcing bars 380 mm in length. The reinforcing bars shall be installed such that the top of the bars is flush with the top of the parking bumper.

12-2.08 ACCESSIBLE PARKING AND AUTHORIZATION SIGNS

PART 1.- GENERAL

SUMMARY.--

Scope.--This work shall consist of furnishing and installing accessible parking and authorization signs in accordance with the details shown on the plans and these special provisions.

SUBMITTALS.--

Product data.--Manufacturer's descriptive data and sign fastening details shall be submitted for approval.

PART 2.- PRODUCTS

Accessible parking stall identification sign.--

Accessible parking stall identification sign shall be a metal sign with baked enamel finish and the international symbol of accessibility. Sign background shall be blue and shall conform to Federal Standard 595B, Color No. 15090. Symbol, lettering and border shall be white and shall conform to Federal Standard 595B, Color No. 17886.

Van accessible sign.--

Van accessible sign shall be a metal sign with baked enamel finish and the international symbol of accessibility. Sign background shall be blue and shall conform to Federal Standard 595B, Color No. 15090. Lettering and border shall be white and shall conform to Federal Standard 595B, Color No. 17886.

Unauthorized vehicles parking sign.--

Unauthorized vehicles parking sign shall be a metal sign with baked enamel finish. Sign background shall be blue and shall conform to Federal Standard 595B, Color No. 15090. Lettering and border shall be white and shall conform to Federal Standard 595B, Color No. 17886. Lettering shall be not less than 25 mm in height and shall read as shown on the plans.

Support post.--

Support post shall be commercial quality, standard weight, galvanized steel pipe. Pipe diameter shall be 35 mm.

Fastening hardware.--

Fastening hardware shall be galvanized or cadmium plated.

Concrete.--

Concrete for support posts shall be commercial quality concrete, proportioned to provide a workable mix suitable for the intended use, with not less than 300 kilograms of cement per cubic meter.

PART 3.- EXECUTION

Installation.--Support posts shall be placed in holes excavated to the depth and cross-section shown on the plans. Posts shall be set vertical and shall be firmly embedded in concrete backfill. The top of the concrete backfill around the post shall be crowned to drain water.

Support posts shall be fitted with a rainproof top.

Sign shall be fastened rigidly and securely to the support post.

The Engineer will provide the Contractor with the necessary information for the disabled authorization sign.

SECTION 12-3. CONCRETE AND REINFORCEMENT**12-3.01 CAST-IN-PLACE CONCRETE****PART 1.- GENERAL****SUMMARY.--**

Scope.--This work shall consist of constructing cast-in-place concrete facilities in accordance with the details shown on the plans and these special provisions.

SUBMITTALS.--

Product data.--Manufacturer's descriptive data for admixtures, expansion joint material, vapor barrier, hardener, and sealer shall be submitted for approval.

Descriptive data shall be delivered to the Engineer at the jobsite.

QUALITY ASSURANCE.--

Certificates of Compliance.--Certificates of Compliance shall be furnished for cement, reinforcement, admixtures and epoxy products in accordance with the requirements specified in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications.

PART 2.- PRODUCTS

CONCRETE MIXES.--

Concrete (structural work).--

Commercial quality concrete shall be proportioned to provide a workable mix suitable for the intended use; shall have not less than 350 kg/m³ of cement; 0 to 50 mm penetration, inclusive, as determined by California Test 533.

Concrete (minor work).--

Commercial quality concrete for concrete sidewalks and collars shall be proportioned to provide a workable mix suitable for the intended use; shall have not less than 300 kg/m³ of cement; 0 to 50 mm penetration, inclusive, as determined by California Test 533.

CONCRETE MATERIALS.--

Cement.--

Cement shall conform to ASTM Designation: C 150, Types II, or III portland cement; or Type IP (MS) Modified cement. Type IP (MS) Modified shall conform to ASTM Designation: C 595 and shall be comprised of an intimate mixture of Type II Modified cement and not more than 20 percent of a pozzolanic material.

Aggregates.--

Aggregates shall be free from deleterious coatings, clay balls and other extraneous materials.

Admixtures.--

Admixtures used in portland cement concrete shall be included on the Department's current list of approved admixtures, and shall conform to ASTM Designation: C 494, Types A, B, D, F or G for chemical admixtures; ASTM Designation: C 260 for air-entraining admixtures; and ASTM Designation: C 618 for mineral admixtures, except loss on ignition shall not exceed 4 percent. Properties of admixtures shall be uniform in each lot.

FORM MATERIALS.--

Forms for exposed finish concrete.--

Forms for exposed surfaces shall be plywood, metal or other panel type materials. Plywood shall be not less than 16 mm thick and without scars, dents, and delaminations. Forms shall be furnished in largest practical pieces to minimize number of joints.

Plywood shall conform to the requirements of U. S. Product Standard PS-1 for Exterior B-B (Concrete Form) Class I.

Forms for edges of slabs shall be nominal 50 mm solid stock lumber, plywood, or metal forms.

Forms for unexposed finish concrete.--

Forms for unexposed finish concrete surfaces shall be plywood, lumber, metal or other acceptable material.

Form oil.--

Form oil shall be commercial quality form oil which will permit the ready release of the forms and will not discolor the concrete.

REINFORCING MATERIALS.--

Bar reinforcement.--

Bar reinforcement shall conform to ASTM Designation: A 615/A 615M, Grade 60 [420], or ASTM Designation: A 706/A 706M.

Bar supports.--

Bar supports for reinforcement shall be precast mortar blocks or ferrous metal chairs, spacers, metal hangers, supporting wires, and other approved devices of sufficient strength to resist crushing under applied loads.

EPOXY.--

General.--Epoxy shall be furnished as 2 components which shall be mixed together at the site of the work.

Epoxy mortars.--

Epoxy mortar and epoxy mortar surface treatment shall consist of a commercial quality, trowelable mixture consisting of epoxy and sand. Epoxy shall have a pull-off strength of not less than 6895 MPa and a 90-percent cure in 24 hours. Epoxy shall be of the type that requires no primer as a bonding agent.

Sand.--

Sand for use in epoxy mortars shall be clean and shall have a moisture content of not more than 0.50-percent when tested in accordance with California Test 226.

Sand for epoxy mortar surface treatment shall be graded such that 100-percent passes the 150 μ m sieve.

RELATED MATERIALS.--

Anchor bolts, nuts, and washers.--

Nonheaded anchor bolts shall conform to ASTM Designation: A 36/A 36M, with a minimum hook length of 6.2 diameters.

Headed anchor bolts shall conform to ASTM Designation: A 307.

Nuts shall conform to ASTM Designation: A 563M, Grade A.

Washers for anchor bolts shall be commercial quality.
Exposed anchor bolts, nuts, and washers shall be hot dipped galvanized.

Expansion joint material.--

Expansion joint material shall be commercial quality asphalt impregnated pressed fiber sheets, 13 mm minimum thickness.

Mortar.--

Mortar shall consist of one part cement to 2 parts clean sand and only enough water to permit placing and packing.

Curing compound.--

Curing compound shall be a non-pigmented curing compound with fugitive dye conforming to the requirements of ASTM Designation: C 309, Type 1-D, Class A.

ADMIXTURES.--

General.--Admixtures shall be used when specified or ordered by the Engineer and may be used at the Contractor's option to conserve cement or to facilitate any construction operation.

Calcium chloride shall not be used in any concrete.

Admixtures shall be combined with concrete materials by methods that produce uniform properties throughout the concrete.

If more than one admixture is used, said admixtures shall be compatible with each other so that the desirable effects of all admixtures will be realized.

Mineral admixtures may be used to replace up to 15 percent of Type II portland cement provided the weight of mineral admixture used is not less than the weight of cement replaced. Mineral admixtures shall not be used to replace Type IP (MS) Modified or Type III cements. Chemical admixtures may be used to reduce up to 5 percent of the portland cement except that the cement content shall not be less than 300 kg/m³. When both chemical and mineral admixtures are used with Type II cement, the weight of cement replaced by mineral admixture may be considered as cement in determining the resulting cement content.

Mineral admixtures will be required in the manufacture of concrete containing aggregates that are determined to be "deleterious" or "potentially deleterious" when tested in accordance with ASTM Designation: C 289. The use of mineral admixture in such concrete shall conform to the requirements in this section except that the use of set retarding admixtures will not be permitted.

When the use of a chemical admixture is specified or is ordered by the Engineer, the admixture shall be used at the rate specified or ordered. If no rate is specified or ordered, or if the Contractor uses a chemical admixture for his own convenience, the admixture shall be used at the dosage normally recommended by the admixture manufacturer.

When air-entrainment is specified or is ordered by the Engineer, the air-entraining admixture shall be used in amounts to produce concrete having the specified or ordered air content as determined by California Test 504. If the Contractor uses air-entrainment for his own convenience, the average air content shall not exceed 4 percent and no single test shall exceed 5 1/2 percent.

Chemical admixtures and air-entraining admixtures shall be dispensed in liquid form. Dispensers shall have sufficient capacity to measure at one time the total quantity required for each batch. If more than one liquid admixture is used in the concrete, a separate measuring unit shall be provided for each liquid admixture and dispensing shall be such that the admixtures are not mixed at high concentrations. When air-entraining admixtures are used with other liquid admixtures, the air-entraining admixtures shall be the first to be incorporated into the mix. Unless liquid admixtures are added to premeasured water for the batch, they shall be discharged to flow into the stream of water so that the admixtures are well dispersed throughout the batch.

BAR REINFORCING STEEL.--

Bending.--Reinforcing steel bars shall accurately conform to the dimensions shown on the plans.

Bars shall be bent or straightened in a manner that will not crack or break the material. Bars with kinks or improper bends shall not be used.

Hooks, bends and splices shall conform to the provisions of the Building Code Requirements for Reinforced Concrete of the American Concrete Institute.

MIXING AND TRANSPORTING CONCRETE.--

General.--When a truck mixer or agitator is used for transporting concrete to the delivery point, discharge shall be complete within 1 1/2 hours, or before 250 revolutions of the drum or blades, whichever comes first, after the introduction of cement to the aggregates.

Truck mixers or agitator shall be equipped with electrically or mechanically actuated revolution counters by which the number of revolutions of the drum or blades may readily be verified. The counters shall be of the continuous-registering type, which accurately register the number of revolutions and shall be mounted on the truck so that the Engineer may safely and conveniently inspect them from alongside the truck. Under conditions contributing to quick stiffening of the concrete, or when the temperature of the concrete is 30°C or above, a time less than 1 1/2 hours may be required.

When non-agitating hauling equipment is used for transporting concrete to the delivery point, discharge shall be complete within one hour after the introduction of cement to the aggregates. Under conditions contributing to quick stiffening of the concrete, or when the temperature of the concrete is 30°C, or above, the time between the introduction of cement to the aggregates and discharge shall not exceed 45 minutes.

Each load of concrete for the work shall be accompanied by a trip ticket, a copy of which shall be delivered to the Engineer at the jobsite. The trip ticket shall show volume of concrete, weight of cement and aggregates, quantity of each admixture, quantity of water including water added at the jobsite, time of day the concrete is batched, and revolution counter readings on transit mix trucks at the times the truck is charged and unloaded.

PART 3.- EXECUTION

PREPARATION.--

Existing concrete construction.--Where fresh concrete joins existing or previously placed concrete or masonry, the contact surfaces of the existing or previously placed material shall be roughened, cleaned, flushed with water and allowed to dry to a surface dry condition immediately prior to placing the fresh concrete. The roughened surface shall be no smoother than a wood trowelled surface. Cleaning of the contact surfaces shall remove laitance, curing compounds, debris, dirt and such other substances or materials which would prevent bonding of the fresh concrete.

Abrasive blast methods shall be used to clean horizontal construction joints to the extent that clean aggregate is exposed.

Exposed reinforcing steel located at the contact surfaces which is to be encased in the fresh concrete shall be cleaned to remove any substance or material that would prevent bonding of the fresh concrete.

Forms.--Forms shall be mortar tight, true to the dimensions, lines, and grades shown on the plans, securely fastened and supported, and of adequate rigidity to prevent distortion during placing of concrete.

Forms for exposed surfaces shall be constructed with triangular fillets not less than 19 mm x 19 mm attached so as to prevent mortar runs and to produce smooth straight chamfers at all sharp edges of the concrete.

Form fasteners shall be removable without chipping, spalling, heating or otherwise damaging the concrete surface. Form ties shall be removed to a depth of at least 25 mm below the surface of the concrete.

The inside surfaces of forms shall be cleaned of all dirt, mortar and foreign material. Forms shall be thoroughly coated with form oil prior to use.

Forms shall not be stripped until at least 40 hours after placing concrete.

Anchorage and embedded items shall be placed and rigidly secured at their planned locations prior to placing concrete.

Reglets or embedded flashing shall be installed on concrete forms before the concrete is placed.

Placing reinforcing steel.--Reinforcing steel bars shall be accurately placed to the dimensions shown on the plans.

Bar reinforcement conforming to ASTM Designation: A 615/A 615M, Grade 420, or A 706//A 706M shall be lapped at least 45 diameters.

Bars shall be firmly and securely held in position by means of wiring and approved bar supports. The spacing of supports and ties shall prevent displacement of the reinforcing or crushing of supports.

Tie wire shall be clear of concrete formwork and concrete surfaces.

All reinforcing steel shall be in place and inspected before concrete placement begins. Placing of bars on fresh layers of concrete will not be permitted.

PLACING CONCRETE.--

General.--Concrete shall be placed and consolidated by means of internal vibrators to form dense, homogeneous concrete free of voids and rock pockets.

Forms and subgrade shall be thoroughly moistened with water immediately before placing concrete.

Concrete shall be placed as nearly as possible to its final location and the use of vibrators for extensive shifting of the concrete will not be permitted.

Concrete shall be deposited and consolidated in a continuous operation within limits of construction joints, until the placing of the panel or section is completed.

FINISHING CONCRETE SURFACES.--

Finishing unformed surfaces.--Slabs shall be placed full thickness to finish elevation and leveled to screeds by use of long straightedges. The screeds shall be set to grade at approximately 1.8 meter centers. After leveling, screeds shall be removed and the surface shall be floated with wooden floats.

The floated surface shall be trowelled with steel trowels. Troweling shall form a dense, smooth and true finish. Walkways, pedestrian ramps, stairs and outdoor slabs for pedestrian traffic shall be given a non-slip broom finish unless a different finish is called for on the plans or in these special provisions.

The application of cement dust coat will not be permitted.

Finishing formed surfaces.--Formed concrete surfaces shall be finished by filling holes or depressions in the surface, repairing all rock pockets, and removing fins. All surfaces of formed concrete exposed to view shall have stains and discolorations removed, unsightly bulges removed, and all areas which do not exhibit the required smooth, even surface of uniform texture and appearance shall be sanded with power sanders or other approved abrasive means until smooth, even surfaces of uniform texture and appearance are obtained.

Cement mortar, patching and finishing materials used to finish exposed surfaces of concrete shall closely match the color of surrounding surfaces.

CURING CONCRETE.--

General.--Freshly placed concrete shall be protected from premature drying and excessive cold or hot temperatures.

Concrete surfaces shall be kept moist for a period of at least 5 days by leaving the forms in place or by covering the exposed surfaces using moist rugs, cotton mats or other curing materials approved by the Engineer.

Concrete curbs, sidewalks, and collars may be cured with a curing compound.

PROTECTING CONCRETE.--

General.--Concrete shall not be placed on frozen or frost covered surfaces.

Concrete shall be protected from damage due to rain, freezing or inclement weather, and shall be maintained at a temperature of not less than 4°C for 72 hours. When required by the Engineer, the Contractor shall provide a written outline of his proposed methods of protecting concrete.

Vehicles, equipment, or concentrated loads weighing more than 140 kg individually and material stockpiles weighing more than 240 kg/m² will not be permitted on the concrete within 10 calendar days after placing.

SPECIAL TREATMENTS.--

Epoxy mortars.--Epoxy for use as a binder in epoxy mortars shall be thoroughly mixed together before the aggregate is added, and unless otherwise specified, the mix proportions shall consist of one part binder to approximately 4 parts of aggregate, by volume.

All surfaces against which epoxy mortars are to be applied shall be free of rust, paint, grease, asphalt, and loose or deleterious material.

12-3.02 DRILL AND BOND DOWELS

PART 1.- GENERAL

SUMMARY.--

Scope.--This work shall consist of drilling holes in existing concrete and installing and bonding bar reinforcing steel dowels into such drilled holes in existing concrete in accordance with the details shown on the plans and these special provisions.

PART 2.- PRODUCTS

Bonding material.--

The bonding material shall be magnesium phosphate concrete, either single component (water activated) or dual component (with a prepackaged liquid activator), as approved by the Engineer.

Dowels.--

Dowels shall be bar reinforcing steel, as specified under "Cast-In-Place Concrete" in Section 12-3, "Concrete and Reinforcement," of these special provisions.

PART 3.- EXECUTION

INSTALLATION.--The holes shall be drilled by methods that will not shatter or damage the concrete adjacent to the holes. The diameter of drilled holes shall be 13 mm larger than the nominal diameter of the dowels unless otherwise shown on the plans.

Immediately prior to placing the dowels, the holes shall be cleaned of dust and other deleterious materials, and the holes shall be dry.

Sufficient bonding material shall be placed in the hole so that no voids remain after the dowels are inserted.

Dowels which fail to bond or are damaged before new concrete is placed shall be removed and replaced.

Magnesium phosphate concrete shall be formulated for minimum initial set time of 15 minutes and minimum final set time of 25 minutes at 21°C. The materials, prior to use, shall be stored in a cool, dry environment.

Mix water used with water activated material shall be free from oil and impurities and contain not more than 2000 parts per million as Cl nor more than 1500 parts per million of sulfate as SO₄.

The quantity of water for single component type or liquid activator for dual component type to be blended with the dry component, shall be within the limits recommended by the manufacturer and shall be the least amount required to produce a pourable batter.

Magnesium phosphate concrete shall not be mixed in containers or worked with tools containing zinc, cadmium, aluminum, or copper metals.

The surface of any dowel coated with zinc or cadmium shall be coated with a colored lacquer before installation of the dowel. The lacquer shall be allowed to dry thoroughly before embedment of said dowels.

SECTION 12-4. MASONRY

12-4.01 CONCRETE MASONRY UNITS

PART 1.- GENERAL

SUMMARY.--

Scope.--This work shall consist of constructing reinforced hollow concrete masonry units in accordance with the details shown on the plans and these special provisions.

Related work.--Water repellent coating shall be applied in accordance with the requirements specified under "Water Repellent Coating" in Section 12-7, "Thermal and Moisture Protection," of these special provisions.

PERFORMANCE REQUIREMENTS.--

Unit Strength.--Provide masonry units that develop the following installed compressive strengths (f'm) at 28 days:

Based on net area f'm = 10.34 MPa

SUBMITTALS.--

Product data.--Manufacturer's descriptive data for each type of masonry unit, accessory, and other manufactured products shall be submitted for approval.

Samples.--Two samples of masonry units of each color and architectural finish shall be submitted for approval.

QUALITY ASSURANCE.--

Certificates of Compliance.--Certificate of Compliance shall be furnished for masonry units, aggregate for grout and transit mixed grout in accordance with the requirements specified in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications.

DELIVERY, HANDLING AND STORAGE.--

Delivery.--Masonry materials shall be delivered to the project in an undamaged condition.

Storage and handling.--Masonry units shall be stored and handled in order to prevent deterioration or damage due to moisture, temperature changes, contamination, corrosion or other causes.

PART 2.- PRODUCTS

CONCRETE MASONRY UNITS.--

Concrete masonry units.--

Concrete masonry units shall be nominal size, color and architectural finish as shown on plans; hollow load bearing, light weight or medium weight, Grade N, Type II, conforming to ASTM Designation: C 90; standard or open ended masonry units.

Special shapes shall be provided where required for lintels, corners, jambs, sash, control joints, headers, bonding and other special conditions.

MORTAR AND GROUT MATERIALS.--

Cement.--

Cement for mortar shall be Type II, low alkali portland cement conforming to ASTM Designation: C 150; or masonry cement conforming to ASTM Designation: C 91.

Cement for grout shall be Type II portland cement conforming to ASTM Designation: C 150 with maximum 15 percent Class N, F, or C mineral admixture conforming to ASTM Designation: C 618 except that the loss on ignition shall not exceed 4 percent; or Type IP(MS) blended hydraulic cement conforming to ASTM Designation: C 595.

Aggregate.--

Aggregate for mortar shall conform to ASTM Designation: C 144, except not more than 10 percent shall pass the No. 100 sieve.

Aggregate for grout shall conform to ASTM Designation: C 404, except 100 percent of the coarse aggregate shall pass the 9.5 mm sieve. Soundness loss shall not exceed 10 percent as determined by California Test 214.

Coloring for mortar.--

Coloring for mortar shall be chemically inert, fade resistant mineral oxide or synthetic type.

Lime.--

Lime shall conform to ASTM Designation: C 207, Type S.

Premixed mortar or grout.--

A premixed packaged blend of cement, lime, and sand, with or without color, that requires only water to prepare for use as masonry mortar or grout may be furnished. Packages of premix shall bear the manufacturer's name, brand, contents, weight, and color identification.

Transit mixed grout.--

Transit mixed grout shall conform to ASTM Designation: C 94, except aggregate shall be as specified herein for aggregate for grout. The minimum compressive strength shall be 17236 kPa at 28 days when tested in accordance with ASTM Designation: C 39. Admixtures, if used, shall conform to ASTM Designation: C 494, Types A, E or F and shall not contain chlorides.

REINFORCEMENT, TIES AND ANCHORING DEVICES.--**Bar reinforcement.--**

Bar reinforcement shall conform to ASTM Designation: A 615/A 615 M, Grade 60 [420], or ASTM Designation: A 706/A 706 M.

Anchors, ties, angles, and metal lath.--

Anchors, ties, angles, and metal lath shall be commercial quality, and shall be galvanized.

Dry pack.--

Dry pack to set items into masonry shall be one part portland cement to not over 3 parts of clean sand and with a minimum amount of water for hydration and packing.

PROPORTIONING MORTAR AND GROUT.--

General.--Mortar shall be proportioned by loose volume and shall have one part cement, one quarter part of hydrated lime and 2 1/4 to 3 parts aggregate. Mortar shall be tinted with coloring to match the masonry units.

Grout, except transit mixed and packaged premix grout, shall be proportioned by loose volume and shall have one part cement, not more than 1/10 part hydrated lime, 2 1/4 to 3 parts sand aggregate, and not more than 2 parts gravel aggregate.

Aggregate shall be measured in a damp loose condition.

Grout shall be mixed with sufficient water to produce a mix consistency suitable for pumping without segregation. Slump shall not exceed 229 mm.

PART 3.- EXECUTION**CONSTRUCTION.--**

General.--Masonry units shall be laid in running bond, except as otherwise shown on the plans.

Surfaces of metal, glass, wood, completed masonry, and other such materials exposed to view shall be protected from spillage, splatters and other deposits of cementitious materials from masonry construction. All such deposits shall be removed without damage to the materials or exposed surfaces.

Construction will comply with Section 2104 Construction of the Uniform Building Code. Tolerances specified in Section 2104 shall be in affect unless otherwise shown on the plans.

Where fresh masonry joins concrete or masonry, the contact surfaces of existing material shall be roughened, cleaned and lightly wetted. The roughened surface shall be no smoother than a wood troweled surface. Cleaning shall remove laitance, curing compounds, debris, dirt and any substance which decreases bond to the fresh masonry.

Masonry shall not be erected when the ambient air temperature is below 5° C.

Surfaces of masonry erected when the ambient air temperature exceeds 38° C. shall be kept moist with water for a period of not less than 24 hours. Water shall be uniformly applied with a fog spray at the intervals required to keep the surfaces moist but not to exceed 3 hours unless otherwise approved by the Engineer.

All anchors, bolts, dowels, reglets and other miscellaneous items to be cast into the wall, shall be firmly secured in place before grout is poured.

Shoring for concrete masonry lintels shall remain in place a minimum of 15 days after the wall has been completed.

Laying masonry units.--Concrete masonry units shall be laid dry.

During laying of units all cells shall be kept dry in inclement weather by suitably covering incomplete walls. Wooden boards and planks shall not be used as covering materials. The covering shall extend down each side of masonry walls approximately 600 mm.

Chases shall be kept free from debris and mortar.

Bond beam units with an opening at each cross web shall be used at all horizontal reinforcing bars.

Where masonry unit cutting is necessary, all cuts shall be made with a masonry saw to neat and true lines. Blocks with excessive cracking or chipping of the finished surfaces exposed to view will not be acceptable.

Bar reinforcement.--Bar reinforcement shall be accurately positioned in the center of the cell and securely held in position with either wire ties or spacing devices near the ends of bars and at intervals not exceeding 192 bar diameters. Wire shall be 16-gage or heavier. Wooden, aluminum, or plastic spacing devices shall not be used. Tolerances for the placement of vertical reinforcement in walls and flexural elements shall be ± 12 mm. Tolerance for longitudinal reinforcement in walls shall be ± 50 mm.

The minimum spacing for splices in vertical reinforcement for masonry walls shall be 1220 mm plus lap.

Bar reinforcement shall not be placed in the plane of mortar joints.

Mortar.--Mortar joints shall be approximately 9.5 mm wide. Units shall be laid with all head and bed joints filled solidly with mortar for the full width of masonry unit shell. Head joints shall be shoved tight. Exposed joints shall be concave, tooled smooth, unless otherwise shown on the plans.

Mortar that has been mixed more than one hour shall not be retempered.

Mortar placed in joints shall preserve the unobstructed vertical continuity of the concrete filling. Any overhanging mortar projecting more than 12 mm, or other obstruction or debris shall be removed from the inside of such cells.

GROUTING.--

General.--All cells shall be filled solidly with grout. All grout in the cells shall be consolidated at the time of placement by vibrating and reconsolidated after excess moisture has been absorbed but before plasticity is lost. Slicing with a trowel is not acceptable.

Masonry units may be placed full height of the masonry work before grouting, or they may be placed in increments for individual grout pours.

Cleanouts shall be provided for all grout pours over 1524 mm in height. Such cleanouts shall be provided in the bottom course at every cell containing vertical reinforcement. After cell inspection, the cleanouts shall be sealed before filling with grout.

Masonry units shall be placed full height of the grout pour. Grout shall be placed in a continuous pour in grout lifts not exceeding 1828 mm. The interruption between placing successive lifts of grout shall be not more than one hour.

Between grout pours, a horizontal construction joint shall be formed by stopping the grout a minimum of 38 mm below the top of the last course, except if the joint is at a bond beam, it shall be 12 mm below the top of the bond beam unit, or at the top of the wall.

CLEANING AND PROTECTING MASONRY.--

General.--Splashes, stains or spots on the faces of the masonry exposed to view shall be removed.

Completed masonry shall be protected from freezing for a period of at least 5 days.

SECTION 12-5. METALS

12-5.01 BUILDING MISCELLANEOUS METAL

PART 1.- GENERAL

Scope.--This work shall consist of fabricating, furnishing and installing building miscellaneous metal in accordance with the details shown on the plans and these special provisions.

Building miscellaneous metal shall consist of the following:

- Guardrails
- Privacy screens
- Miscellaneous bars, plates, and shapes

including all anchors, fastenings, hardware, accessories and other supplementary parts necessary to complete the work.

REFERENCES.--

Codes and standards.--Welding of steel shall be in accordance with American Welding Society (AWS) D 1.1, "Structural Welding Code-Steel" and D 1.3, "Structural Welding Code-Sheet Steel."

SUBMITTALS.--

Product data.--Submit manufacturer's specifications, anchor details and installation instructions for products used in miscellaneous metal fabrications.

Working drawings.--Working drawings of fabricated items shall be submitted for approval.

QUALITY ASSURANCE.--

Shop assembly.--Preassemble items in shop to the greatest extent possible to minimize field splicing and assembly. Disassemble units only as necessary for shipping and handling limitations. Clearly mark all units for reassembly and installation.

Inspection and tests.--Materials and fabrication procedures shall be subject to inspection and tests by the Engineer, in mill, shop and field. Such tests will not relieve the Contractor of responsibility of providing materials and fabrication procedures in compliance with specified requirements.

PART 2.- PRODUCTS

MATERIALS.--

Steel bars, plates and hot-rolled shapes.--

Steel bars, plates and hot-rolled shapes shall conform to ASTM Designation: A 36/A 36M.

Pipe.--

Pipe shall be commercial quality standard steel pipe.

Steel tubing.--

Steel tubing shall conform to ASTM Designation: A 500, Grade B.

Perforated metal screen.--

Perforated metal screen shall be commercial quality and shall be as shown on the plans.

Bolts, studs, threaded rods, nuts and washers.--

Bolts, studs, threaded rods, and nuts for general application shall conform to ASTM Designation: A 307. Washers shall be commercial quality.

Expansion anchors.--

Expansion anchors shall be ICBO approved for the purpose intended, integral stud type anchor or internally threaded type with independent stud, hex nut and washer.

Mortar.--

Mortar shall consist of one part cement, measured by volume, to 2 parts clean sand and only enough water to permit placing and packing.

FABRICATION.--

Workmanship and finish.--Workmanship and finish shall be equal to the best general practice in modern shops.

Miscellaneous metal shall be clean and free from loose mill scale, flake rust and rust pitting, and shall be well formed and finished to shape and size with sharp lines and angles. Bends from shearing or punching shall be straightened.

The thickness of metal and details of assembly and support shall give ample strength and stiffness.

Built-up parts shall be true to line and without sharp bends, twists and kinks. Exposed ends and edges of metal shall be milled or ground smooth, with corners slightly rounded.

Galvanizing.--Items indicated on the plans to be galvanized shall be hot-dip galvanized after fabrication. The weight of galvanized coating shall be at least 460 grams per square meter of surface area, except drainage grates shall have at least 610 grams per square meter of surface area.

Painting.--Building miscellaneous metal items not galvanized shall be cleaned and prime painted prior to erection in accordance with the requirements specified for steel and other ferrous metals under "Painting" in Section 12-9, "Finishes," of these special provisions.

Loose bearing and leveling plates.--Loose bearing and leveling plates shall be furnished for steel items bearing on masonry or concrete construction, made flat, free from warps or twists, and of required thickness and bearing area. Plates shall be drilled to receive anchor bolts. Galvanize after fabrication.

Steel pipe guardrail—Pipe guardrail shall consist of guardrail elements supported by steel pipe posts.

Ends of railing pipe shall be closed, except for a 3 mm diameter weep hole at the low point.

All corners on railings shall be rounded. Simple and compound curves shall be formed by bending pipe in jigs to produce uniform curvature; maintain cylindrical cross-section of pipe throughout the bend without buckling, twisting or otherwise deforming exposed surfaces of the pipe.

PART 3.- EXECUTION**GENERAL.--**

Anchorage.--Anchorage devices and fasteners shall be provided for securing miscellaneous metal in-place construction; including threaded fasteners for concrete and masonry inserts, toggle bolts, through bolts, lag bolts, wood screws and other connectors.

Cutting, drilling and fitting shall be performed as required for installation of miscellaneous metal fabrications. Work is to set accurately in location, alignment and elevation, plumb, level, true and free of rack, measured from established lines and levels.

Loose leveling and bearing plates.--Plates shall be set on wedges or other adjustable devices. Anchor bolts shall be wrench tightened after the plates have been positioned and plumbed. Mortar shall be packed solidly between bearing surfaces and plates to ensure that no voids remain.

Steel pipe guardrail.--Guardrail shall be adjusted prior to anchoring to ensure matching alignment at abutting joints. Secure posts and railing ends to building construction as shown on the plans.

DAMAGED SURFACES.--

General.--Galvanized surfaces that are abraded or damaged at any time after the application of the zinc coating shall be repaired by thoroughly wire brushing the damaged areas and removing all loose and cracked coating, after which the clean areas shall be painted with 2 applications of unthinned zinc-rich primer (organic vehicle type). Aerosol cans shall not be used.

SECTION 12-6. WOOD AND PLASTICS

12-6.01 ROUGH CARPENTRY

PART 1.- GENERAL

SUMMARY.--

Scope.--This work shall consist of furnishing and installing materials and performing rough carpentry work including wood framing, furring, and sheathing in accordance with the details shown on the plans and these special provisions.

Rough carpentry includes carpentry work not specified as part of other sections and which is generally not exposed.

SUBMITTALS.--

Product Data.--Manufacturer's material data and installation instructions shall be submitted for gypsum sheathing, framing hardware and underlayments.

Wood treatment data.--Chemical treatment manufacturer's instructions shall be submitted for the handling, sorting, installation, and finishing of treated materials.

For each type of preservative treatment used, certification by treating plant shall include type of preservative solution and pressure process used, net amount of preservative retained and conformance with the applicable standards of the American Wood Preservers Association.

DELIVERY, HANDLING AND STORAGE.--

Delivery and storage.--Materials shall be kept under cover and dry. All materials shall be protected from exposure to weather and contact with damp or wet surfaces with blocking and stickers. All lumber, plywood and other panels shall be stacked in such a manner to provide air circulation within and around the stacks.

PART 2.- PRODUCTS

LUMBER.--

General.--Lumber shall be manufactured to comply with PS 20, "American Softwood Lumber Standard," and with applicable grading rules of inspection.

Softwood lumber shall be quality grade stamped or shall be accompanied by a certificate of inspection. Inspection certificates or grade stamps shall indicate compliance with the grading requirements of WWPA, WCLIB, RIS, or other approved lumber inspection agencies.

All lumber used shall be nominal sized and dressed S4S unless otherwise specified in these special provisions.

Framing lumber shall be solid stock lumber, Douglas Fir-Larch, and the grades indicated under WCLIB or WWPA rules. Moisture content shall not exceed 19 percent and shall be grade stamped "S-Dry."

DIMENSION LUMBER.--

Except as otherwise shown on the plans, lumber shall have the following grades.

Vertical framing lumber.--

Vertical framing lumber, nominal 51 mm x 51 mm through 102 mm x 102 mm, shall be Construction grade or better.

Vertical framing lumber, nominal 51 mm x 152 mm through 102 mm x 152 mm shall be No. 2 or better.

Horizontal framing lumber.--

Horizontal framing lumber, nominal 51 mm x 102 mm and wider, including joists and rafters, shall be No. 2 or better.

Horizontal framing lumber, nominal 102 mm x 102 mm and wider, including joist and rafters, shall be No. 1 or better.

Miscellaneous lumber.--

Miscellaneous lumber for support or attachment of other work including rooftop equipment curbs and support bases, cant strips, bucks, nailers, blocking, furring, grounds, stripping and similar members shall be not less than No. 2 or better.

Lumber in contact with concrete or masonry construction shall be pressure treated Douglas Fir-Larch.

TIMBERS.--

Timbers (nominal 127 mm or thicker).--

Timbers shall be No. 1 or better.

PLYWOODPANELS.--

General.—Plywoodpanels shall comply with Voluntary Product Standard PS1, "U. S. Product Standard for Construction and Industrial Plywood."

Plywood panels shall be Group 1 unless otherwise noted.

Each plywood panel shall be factory marked with APA or other trademark evidencing compliance with grade requirements.

Structural plywood wall sheathing.--

Structural plywood wall sheathing for walls shall be APA RATED SHEATHING, Exposure 1. Thickness and grade shall be as shown on the plans.

Structural plywood roof sheathing.--

Structure plywood roof sheathing shall be APA RATED SHEATHING, Exposure 1. Span rating, thickness and grade shall be as shown on the plans.

Plywood backing panels.--

Plywood backing panels for mounting electrical or telephone equipment shall be 19 mm plywood panels APA C-D PLUGGED, Exposure 1, touch-sanded.

MISCELLANEOUS MATERIALS.--

Rough Carpentry Hardware.--

Steel plates and rolled sections shall be mild, weldable steel, conforming to AISI grades 1016 through 1030 except 1017.

Nails, screws, bolts, nuts, washers shall be commercial quality. Exposed fasteners shall be hot dipped galvanized or stainless steel.

Joist hangers, clips and other standard framing hardware shall be ICBO approved, commercial quality, galvanized sheet steel or hot dipped galvanized, of the size shown on the plans.

Expansion anchors shall be as specified under "Building Miscellaneous Metal," in Section 12-5, "Metals," of these special provisions.

Nails.--

Nails shall conform to ASTM F 1667-95. "Common" nails shall conform to the following table:

Nail Size	Length (mm)	Diameter (mm)
8d	63.5	3.33
10d	76.2	3.76
16d	88.9	4.11

WOOD TREATMENT BY PRESSURE PROCESS.--

Preservative treatment.--

Preservative treatment shall be copper naphthenate, pentachlorophenol or water-borne arsenicals (ACA, CCA or ACZA).

The following items shall be treated:

Wood cants, nailers, curbs, equipment support bases, blocking, stripping and similar members in connection with roofing, flashing, vapor barriers and waterproofing.

Wood sills, sleepers, blocking, furring and other similar members in contact with concrete or masonry.

All holes, daps and cut ends of treated lumber shall be thoroughly swabbed with 2 applications of copper naphthenate.

PART 3.- EXECUTION

INSTALLATION.--

Wood framing.--Wood framing shall be in accordance with Chapter 23 of the California Building Code.

Framing members shall be of sizes and spacing shown on the plans. Unless otherwise shown on the plans, structural members shall not be spliced between supports.

Wood framing shall be accurately cut and assembled to provide closely fitted members. Framing shall be erected true to the lines and grades shown on the plans and shall be rigidly secured in place as shown and as required by recognized standards. Bracing shall be placed wherever necessary to support all loads on the structure during erection.

The size and spacing of fasteners and the edge distance for nails shall be as shown on the plans.

Nailing schedule shall be as shown on the plans and shall comply with the California Building Code.

Wall coverings exposed to the weather shall have a backing of building paper applied weatherboard fashion to the framing or sheathing. Backing shall be lapped 50 mm at horizontal joints, 152 mm at vertical joints and 305 mm at building corners.

Plywood panels.--Plywood panels shall be attached to the framing as shown on the plans and these special provisions. All structural plywood sheathing (both roof and wall) shall be nailed with "Common" nails.

Plywood sheathing shall be nailed to the framing system and shall be continuous over 2 or more supports. Roof panels shall be installed with the long dimension across the supports, with end joints staggered 1.22 m. Wall sheathing shall have all edges blocked. Spacing between panels shall be 3 mm.

12-6.02 FINISH CARPENTRY

PART 1.- GENERAL

SUMMARY.--

Scope.--This work consists of furnishing and installing materials and performing finish carpentry, including exterior trim, plywood siding and softwood paneling, as shown on the plans and these special provisions.

Finish carpentry includes carpentry work not specified as part of other sections and which is generally exposed to view.

SUBMITTALS.--

Product data.--Manufacturer's specifications and installation instructions for each item of factory-fabricated siding and paneling.

Samples.--One sample shall be submitted to the Engineer at the jobsite for each species and cut or pattern of finish carpentry as shown below:

Exterior standing and running trim - 610 mm long x full board or molding width, finished on one side and one edge.

Exterior plywood - 610 mm long x panel width, finish shall be applied to upper half of each piece.

Plywood paneling - 610 mm long x full panel width, finished on one side.

QUALITY ASSURANCE.--

Factory marks.--Each piece of lumber and plywood shall be marked with type, grade, mill and grading agency identification. Marks shall be omitted from surfaces to receive transparent finish. A mill certificate stating that material has been inspected and graded in accordance with requirements shall be furnished if marks cannot be placed on concealed surfaces.

PRODUCT DELIVERY, STORAGE AND HANDLING.--

Delivery.--Carpentry materials shall be delivered after painting, wet work and similar operations have been completed.

Protection.--Finish carpentry materials shall be protected during transit, delivery, storage and handling to prevent damage, soiling and deterioration.

PART 2.- PRODUCTS

WOOD PRODUCT QUALITY STANDARDS.--

Softwood lumber.--Softwood lumber shall conform to the requirements of PS 20, "American Softwood Lumber Standard," with applicable grading rules of inspection.

Plywood.--Plywood shall conform to the requirements of Voluntary Products Standard PS-1, "U. S. Product Standard for Construction and Industrial Plywood."

Woodworking.--Woodworking shall conform to the requirements of Woodwork Institute of California (WIC), "Manual of Millwork."

MATERIALS.--

General.--Lumber sizes indicated shall be nominal sizes except as indicated by detailed dimensions. Lumber which is to be dressed or worked and dressed shall be manufactured to the actual sizes as required by PS 20.

Lumber that is to be painted may be solid or glued-up lumber at the contractor's option.

Glued-up lumber for exterior finish work shall comply with PS 56 for "wet use" and be so certified by the inspection agency.

Exterior standing and running trim.--

Standing and running trim in the form of boards or worked products shall be clear, all heart Redwood. Trim to be painted shall be finished smooth.

Plywood siding.--

Plywood shall be 16 mm, redwood, APA RATED SIDING 303-6-W, EXT with exterior glue, rough sawn Texture 1-11. Siding shall be factory treated with the manufacturer's standard water repellent preservative.

Plywood paneling and wainscotting.--

Plywood paneling and wainscotting shall be APA Interior Grade A-C, Group 1, Exposure 1 plywood. Thickness shall be as shown on the plans.

Miscellaneous Materials.--

Nails, screws and other anchoring devices of the type, size, material and finish required shall be provided for secure attachment, concealed where possible.

Fasteners and anchorages for exterior use shall be hot dip galvanized.

PART 3.- EXECUTION

INSTALLATION.--

General.--All work shall be installed plumb, level and true with no distortions.

Standing and running trim.--Standing and running trim shall be installed with minimum number of joints possible, using full length pieces to the greatest extent possible.

Exterior joints shall be made water-resistant by careful fitting.

Anchor finish carpentry.--Finish carpentry shall be anchored to framing or blocking built in or attached directly to the substrate.

Interior carpentry shall be attached to grounds, stripping and blocking with countersunk, concealed fasteners and blind nailing where required for complete installation. Fine finish nails shall be used for exposed nailing, countersunk and filled flush with finished surface and matching final finish where transparent finish is indicated.

Finish exterior siding shall be fastened with corrosion resistant nails. The size and spacing of the siding fasteners shall be as shown on the plans. Nails shall be driven flush with the surrounding surfaces, not countersunk. Nails shall be located in the grooves of grooved siding whenever possible.

ADJUSTMENT, CLEANING, FINISHING AND PROTECTION.--

General.--Damaged and defective finish carpentry work shall be repaired or replaced.

All exposed or semi-exposed surfaces shall be cleaned.

Finish carpentry shall be finished in accordance with the requirements specified under "Painting" in Section 12-9, "Finishes," of these special provisions.

SECTION 12-7. THERMAL AND MOISTURE PROTECTION

12-7.01 WATER REPELLENT COATING

PART 1.- GENERAL

SUMMARY.--

Scope.--This work shall consist of furnishing and applying water repellent coating to or masonry surfaces in accordance with the details shown on the plans and these special provisions.

The water repellent coating shall be applied to all new exterior masonry surfaces as shown on the plans.

SUBMITTALS.--

Product data.--Manufacturer's descriptive data, application instructions and general recommendations for water repellents shall be submitted for approval.

QUALITY ASSURANCE.--

Codes and standards.--Water repellent coatings shall comply with all rules and regulations concerning air pollution in the State of California.

Certificates of Compliance.--Certificates of Compliance shall be furnished with each shipment of water repellent coating materials in accordance with Section 6-1.07, "Certificates of Compliance," of the Standard Specifications.

PART 2.- PRODUCTS

Water repellent coating.--

Water repellent coating shall be clear, colorless, water-based sealer. Water repellent coating shall be Hydrozo Inc., Clear Double 7; Euclid Chemical Co., Architectural Seal VOX; Tamms Industries Co., Chemstop; or equal.

PART 3.- EXECUTION

Preparation.--All surfaces to receive water repellent coating shall be dry and cleaned by removing contaminants that block pores of the surface. Cleaning methods shall be as recommended by the water repellent manufacturer.

Application.--The water repellent solution shall be applied in accordance with the manufacturer's printed instructions. The time period between applications of water repellent coating shall be not less than 24 hours.

Protection.--Surfaces of other materials surrounding or near the surfaces to receive the water repellent coating shall be protected from overspray or spillage from the waterproofing operation. Water repellent coating applied to surfaces not intended to be waterproofed shall be removed and the surfaces restored to their original condition.

12-7.02 RIGID ROOF INSULATION

PART 1.- GENERAL

SUMMARY.--

Scope.--This work shall consist of furnishing and installing rigid roof insulation in accordance with the details shown on the plans and these special provisions.

Rigid insulation shall include rigid insulation, underlayment, wood nailers, fasteners and such other materials, not mentioned, which are required for the complete installation of the rigid insulation system. Materials and installation shall be coordinated with the roof covering system to meet the requirements for a Class 1 Factory Mutual approved assembly.

PART 2.- PRODUCTS

Underlayment.--

Underlayment shall be a fiberglass-reinforced SBS (styrene-butadiene-styrene) modified membrane not less than 16 kg per 9.3 m². Underlayment shall be MBTechnology, Tamco, Bi-Tech, or equal.

Rigid roof insulation.--

Rigid roof insulation shall be multilayer, preformed board roof insulation having thermal conductance or resistance as shown on the plans. Glass fiber board conforming to ASTM Designation: C 726, or expanded perlite board conforming to ASTM Designation: C 728, or wood fiber board conforming to ASTM Designation: C 208.

Insulation tape.--

Insulation tape shall be as recommended by the insulation manufacturer.

Wood nailers.--

Wood nailers shall be Douglas fir, hem-fir or equivalent western softwood pressure treated after fabrication. Wood preservatives shall be waterborne type.

Fastener (wood plank decking)--

Fastener (wood plank decking) shall be barbed shank or annular threaded galvanized roofing nails having 25 mm minimum nominal diameter head or driven through galvanized caps; or power driven roofing staples through galvanized caps.

PART 3.-EXECUTION

Preparation.--The preparation of the deck surfaces shall conform to the manufacturer's recommendations and these special provisions.

The deck surface shall be made smooth and level.

Installation.--Rigid insulation shall be installed over underlayment covered with a rosin sheet. Underlayment shall be laid parallel to the eaves, shingle fashion with 152 mm edge laps and 305 mm end laps and shall be fastened as recommended by the underlayment manufacturer.

Insulation panels shall be placed in at least 2 layers with end joints staggered and with joints of the second layer offset at least 150 mm from joints in the first layer.

Insulation panels shall be oriented with the long side perpendicular to the direction roofing felts are to be laid. End joints between panels shall be staggered.

Wood nailers shall be securely fastened using at least two 16d nails to each framing member.

The first layer of insulation shall be mechanically fastened as recommended by the manufacturer. At least one fastener per 0.2 square meter of insulation panel shall be used. Panels that are cracked or broken by the installation of the mechanical fasteners shall be replaced.

Additional layers of insulation shall be secured as recommended by the manufacturer.

The completed layer of insulation shall be smooth and level, and suitable for the proper bedding of succeeding layers of roofing material.

Insulation shall be laid just before application of roofing. Units shall be laid in parallel courses with transverse joints staggered, in moderate contact with adjoining surfaces.

Joints in the top layer of glass fiber roof insulation shall be taped with 150 mm wide felt stripping set in hot asphalt mopping.

Insulation panels with broken or crushed corners or edges shall be trimmed free of such defects or shall be discarded. Replacement boards less than 305 mm wide shall not be used.

Damaged insulation in the completed work shall be removed and replaced. Insulation that has been wet or is wet shall be considered damaged.

12-7.03 METAL ROOFING

PART 1.- GENERAL

SUMMARY.--

Scope.--This work shall consist of furnishing and installing manufactured metal roof panels, in accordance with the details shown on the plans and these special provisions.

Metal roof and siding system shall consist of underlayment, prefinished metal roof panels, rain diverters, fasteners, sealants, and accessories and components, not mentioned, which are required for a complete, securely fastened and weathertight installation.

SYSTEM DESCRIPTION.--

Design Requirements.--The roof system shall conform to the wind design requirements for uplift or outward pressures in accordance with Chapter 16 of the California Building Code for the wind speed and exposure shown on the plans.

SUBMITTALS.--

Product Data.--Manufacturer's technical product data, installation instructions, and recommendations for each type of sheathing material shall be submitted for approval.

Product data shall include the manufacturer's name and a complete material description of all components of the metal sheathing system.

Samples.--Material samples shall include a 305 mm x 305 mm sample of the roofing panels for each color to be installed and a sample of each anchor clip and fastening device.

Working Drawings.--Working drawings showing the layout and details of the roofing systems shall be submitted for approval.

Working drawings shall include the shape, size, thickness, and method of attachment for each component used in the work; the layout and spacing of fasteners; details of connections and closures; and details for expansion joints and weathertight joints.

Design calculations for the fastening system of the roof panels with the substrate shown on the plans shall be submitted to verify compliance with the design requirements.

Working drawings and design calculations shall be stamped and signed by an engineer who is registered as a Civil or Structural Engineer in the State of California. The expiration date of the registration shall be shown. The Engineer's signature shall be original.

QUALITY ASSURANCE.--

Certificates of Compliance.--Certificates of compliance shall be furnished for the metal sheathing system in accordance with the requirements specified in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications.

DELIVERY, HANDLING AND STORAGE.--

Delivery and handling.--Metal panels shall be protected against damage and discoloration.

Storage.--Metal panels shall be stored above ground, with one end elevated for drainage and protected against standing water and condensation between adjacent surfaces.

PART 2.- PRODUCTS

MATERIALS.--

SHEET MATERIALS.--

Base metal.--

Base metal shall be cold formed, 0.71 mm (24-gage), galvanized sheet steel with G90 [Z275] coating, conforming to ASTM Designation: A 653/A 653M, Grade 33 [230] except where a higher strength is required for performance, extra smooth, or cold formed aluminum-zinc alloy-coated, commercial quality, sheet steel with AZ55 [AZM165] coating conforming to ASTM Designation: A 792/A 792M, Grade 40 [275], extra smooth.

Configuration.--

Standing seam metal roofing system shall have standing seams a minimum of 45 mm high and spaced not less than 305 mm nor more than 455 mm on center.

Sealed-seam metal roofing system shall be factory-formed, prefinished system with non-thermal bridging system over rigid insulation substrate with a steel framing system. Steel framing system shall be prefabricated hat channels furnished by the panel manufacturer.

METAL FINISHES.--

General.--Coatings shall be applied before or after forming and fabricating panels, as required for maximum coating performance capability.

Colors or color matches shall be as shown on the plans or, if not otherwise shown, shall be as selected by the Engineer from the manufacturer's standard color palette.

Fluoropolymer coating.--

Finish shall be the manufacturer's standard Kynar coating with a baked on primer (0.005 mm) and a finish coat of 0.02 mm nominal for a total dry film thickness of approximately 0.025 mm nominal.

Interior finish shall consist of a 0.004 mm epoxy primer and a backer coat.

MISCELLANEOUS METAL SHAPES.--

Flashings and rain diverters.--

Flashings and rain diverters shall be formed from the same material, gage and in the same finish as the metal roofing and siding panels.

Perforated soffit.--

Perforated soffit shall be formed from the same material, gage and in the same finish as the metal sheathing panels.

MISCELLANEOUS MATERIALS.--

Fastener clips.--

Fastener clips shall be noncorrosive, ferrous metal fasteners as recommended by the metal panel system manufacturer to resist the design loads.

Fasteners.--

Fasteners shall be as recommended by the metal panel system manufacturer. Sheet metal screws shall not be used except to fasten trim and flashings.

Underlayment.--

Underlayment shall be a fiberglass-reinforced SBS (styrene-butadine-styrene) modified membrane not less than 16 kg per 9.3 m².. Underlayment shall be MBTechnology, Tamco, Bi-Tech, or equal.

Sealant and sealant tape.--

Sealant and sealant tape shall be as recommended by the panel system manufacturer.

Closures.--

Closures shall be rubber, neoprene, closed cell plastic or prefinished metal.

FABRICATION.--

General.--Unless otherwise shown on the plans, or specified herein, roof panels shall be fabricated in continuous lengths for the length of the roof, from ridge or peak to eaves, except such length shall not exceed the manufacturer's maximum production length.

Flashings shall be fabricated in the longest practical lengths.

Roofing panels shall be factory formed. Field formed panels are not acceptable.

PART 3.- EXECUTION

INSTALLATION.--

Underlayment.--The standing seam metal roof panels shall be installed over underlayment covered with a rosin sheet. Underlayment shall be laid parallel to the eaves, shingle fashion with 152 mm edge laps and 305 mm end laps and shall be fastened as recommended by the metal roofing system manufacturer.

Seal-seamed metal roofing system.--The metal roofing panels shall be installed and anchored to the steel framing system and sealed as recommended by the metal roofing system manufacturer. The steel framing system shall be anchored to the roof deck with fasteners as shown on the approved working drawings. Adjoining ends of the steel framing system shall be overlapped. Ends that adjoin or abut the sides of frames shall be lap cut so that there are no gaps between adjoining sections. Field framing shall support overlapped metal panels as required by the panel manufacturer and as shown on the approved working drawings.

Roof panels.--The roof shall be installed and fastened in accordance with the details shown on the plans and the approved working drawings. Cutting and fitting shall present a neat and true appearance with exposed burrs removed. Openings through roof panels shall be cut square and shall be reinforced as recommended by the metal roofing system manufacturer.

Metal panels shall be adjusted in place and properly aligned for the detailed conditions before fastening. Panels shall not be warped, bowed or twisted. The surface finish on the panels shall not be cracked, blemished or otherwise damaged.

Miscellaneous metal shapes.--Trim, fascia, flashings, caps, and other prefinished metal work shall be positioned to the correct alignment for each detailed condition. Metal work shall be securely attached to backing construction using fasteners at the spacing shown on approved working drawings. Prefinished metal to be installed over concrete, masonry or plaster shall be back-coated with asphaltic paint as recommended by the metal roofing system manufacturer.

Metal panels, trim, and other prefinished metal that are marred, punctured, incorrectly bent, or incorrectly installed will be considered damaged and shall be replaced with undamaged units.

The metal panel system shall be installed weathertight. Closures shall be tight fitting and shall be provided at the ends of panels, at the boundary of the roof, and as indicated on the approved working drawings.

CLEAN UP AND CLOSE OUT.--

Clean up.--Adjacent surfaces shall be protected during the roofing system installation and sealant work. Excess sealant shall be removed as the installation progresses.

Roof panels, molding, trim, and other prefinished metal surfaces shall be cleaned after installation as recommended by the manufacturer. Exposed cuts shall be touched-up with a matching durable primer and paint as recommended by the metal roofing system manufacturer.

Touch up.--Damaged paint surfaces shall be touched up by using an air dry touch up paint supplied by the metal roofing system manufacturer. Only a small brush shall be used for touching up. No spraying of touch up paint is to be performed.

Damaged units.--Panels and other components of the work which have been damaged or have deteriorated beyond successful repair shall be removed and replaced.

12-7.04 SHEET METAL FLASHING

PART 1.- GENERAL

SUMMARY.--

Scope.--This work shall consist of fabricating, furnishing and installing sheet metal flashing in accordance with the details shown on the plans and these special provisions.

Sheet metal shall include metal flashings, counterflashings, straps, and roof jacks.

QUALITY ASSURANCE.--

Codes and standards.--Sheet metal work shall in accordance with the requirements in the latest edition of the Sheet Metal and Air Conditioning Contractors National Association "Standard Practice in Architectural Sheet Metal Work."

PART 2.- PRODUCTS

MATERIALS.--

Galvanized sheet steel.--

Galvanized sheet steel shall conform to ASTM Designation: A 361, not less than 0.71 mm (24-gage), unless otherwise shown on the plans. Surfaces to be painted shall not have factory coatings on galvanizing that cannot be removed by paint thinner.

Solder.--

Solder shall conform to ASTM Designation: B 32, Alloy Grade Sn50.

Soldering flux.--

Soldering flux shall be acid type, conforming to Federal Specification: O-F-506C, Type I, Form A.

Lap joint sealant.--

Lap joint sealant for concealed locations shall be a non-drying butyl.

Flashing cement.--

Flashing cement shall be a bituminous plastic cement, asbestos free, conforming to ASTM Designation: D 4586, Type II.

Sealant.--

Sealant for exposed locations shall be a silicone sealant conforming to ASTM Designation: C 920.

Primer.--

Primer shall be as recommended by the sealant manufacturer.

FABRICATION.--

General.--Sheet metal shall be assembled to Sheet Metal and Air Conditioning Contractors National Association Standards.

Sheet metal shall be formed to the sizes, shapes and dimensions shown on the plans or as specified herein with angles and lines straight, sharp and in true alignment. The number of joints shall be kept to a minimum.

Angle bends and folds for interlocking the metal shall be made with full regard for expansion and contraction to avoid buckling or fullness in the metal after it is installed.

Joints in sheet metal work shall be closed watertight unless slip joints are specifically required. Watertight joints shall be mechanically interlocked and then thoroughly soldered for metals other than aluminum. Watertight joints in aluminum or between aluminum and other metals shall be sealed with acrylic sealant.

Sheet metal joints to be soldered shall be cleaned with steel wool or other means, pre-tinned and soldered watertight.

All joints shall be wiped clean of flux after soldering. Acid flux shall be neutralized by washing the joints with sodium bicarbonate.

Flashings shall have a 45 degree drip return at bottom edges. Unless otherwise shown on the plans, counterflashing shall extend not less than 100 mm over roofing or other materials protected by the counterflashing and shall be arranged so that roofing or materials can be repaired without damage to the counterflashing.

PART 3.- EXECUTION

PREPARATION.--Surfaces to receive sheet metal shall be clean, smooth and free from defects.

PROTECTION.--Aluminum surfaces to be in contact with concrete, mortar, or dissimilar metals shall be given a heavy coat of coal tar paint.

INSTALLATION.--

Roof penetration flashings.--All pipes, ducts, vents and flues passing through roofs shall be made waterproof with flashings of storm collars or counterflashings.

Roof penetration flashings shall be fabricated from galvanized sheet steel, not less than 0.71 mm (24-gage). Size and shape shall be as shown on the plans.

12-7.05 SKYLIGHTS**PART 1.- GENERAL****SUMMARY.--**

Scope.--This work shall consist of furnishing and installing skylights in accordance with the details shown on the plans and these special provisions.

SYSTEM DESCRIPTION.--

Design requirements.--Skylights shall conform to the requirements on Section 2603.7 of the Uniform Building Code. Skylights shall be rated by the manufacturer to withstand a 200 kilograms per square meter live loading.

SUBMITTALS.--

Product data.--Manufacturer's descriptive data and installation instructions shall be submitted for approval.

Samples.--A sample of the acrylic or fiberglass plastic and the anodized framing shall be submitted for approval.

QUALITY ASSURANCE.--

Certificates of Compliance.--Certificates of compliance shall be furnished for the skylights in accordance with the requirements specified in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications.

PART 2.- PRODUCTS

Skylight and ventilator unit.--

Skylight and ventilator unit shall be factory assembled, curb mounted unit with one piece translucent acrylic plastic dome, anodized extruded aluminum frame and continuous louvers on all sides of the frame. The frame material shall not be less than 2 mm thickness. The frame shall have integral condensation gutters on 10 degree minimum slopes and condensation weeps to the outside. The color of the anodized aluminum frame shall be as shown on the plans.

The dome shall be distortion free and shall be set in an elastic seal.

Louvers shall be mitered at the outside corners exposed to the weather and heliarc welded. Removable insect screens shall be provided on the inside of the louvers.

PART 3.- EXECUTION

Installation.--Skylights shall be installed rigidly and securely in accordance with the manufacturer's instructions. The installation shall be flashed and shall be weathertight.

Cleaning and protection.--Plastic skylight units shall be cleaned and polished inside and out.

12-7.06 SEALANTS AND CAULKING

PART 1.- GENERAL

SUMMARY.--

Scope.--This work shall consist of furnishing and applying sealants and caulking which are required for this project, but not specified elsewhere, in accordance with the details shown on the plans and these special provisions.

QUALITY ASSURANCE.--

Certificates of Compliance.--Certificates of compliance shall be furnished for the sealants and caulking in accordance with the requirements specified in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications.

SUBMITTALS.--

Product data.--Manufacturer's descriptive data and installation instructions for all sealants shall be submitted for approval.

Samples.--Color samples of all sealants shall be submitted for approval. Unless otherwise shown on the plans, colors will be selected by the Engineer from the manufacturer's standard colors.

PART 2.- PRODUCTS

MATERIALS.--

General.--All sealants, primers and accessories shall be non-staining to adjacent exposed surfaces. Products having similar applications and usage shall be of the same type and same manufacturer. Gun consistency compound shall be used unless otherwise required by the job conditions.

Acrylic sealant.--

Acrylic sealant shall be one compound, solvent release acrylic sealant.

Butyl sealant.--

Butyl sealant shall be one component, skinning type.

Silicone sealant.--

Silicone sealant shall be one component, low modulus building sealant. Sealant shall be tack-free in one hour, shall not sag or flow, shall be ozone resistant and capable of 100 percent extension without failure.

Backer rod.--

Backer rod shall be round, open or closed cell polyurethane. Backer rod shall be sized such that it must be compressed between 25 and 75 percent of its uncompressed diameter during installation in the joint.

Neoprene.--

Neoprene shall conform to the requirements of ASTM Designation: C 542.

PART 3.- EXECUTION

APPLICATION.--

General.--Unless otherwise shown on the plans, sealants shall be applied in accordance with the manufacturer's instructions.

Silicone sealants shall not be used in locations where painting is required.

Butyl sealants shall not be used in exterior applications, and acrylic sealants shall not be used in interior applications.

Sealants shall be applied in a continuous operation for the full length of the joint. Immediately following the application of the sealant, the sealant shall be tooled smooth using a tool similar to that used to produce concave masonry joints. Following tooling, the sealant shall remain undisturbed for not less than 48 hours.

SECTION 12-8. DOORS AND WINDOWS

12-8.01 HINGED DOORS

GENERAL.--This work shall consist of furnishing and installing hinged doors and frames in accordance with the details shown on the plans and these special provisions.

SUBMITTALS.--Manufacturer's descriptive data, installation instructions for fire rated assemblies and a door schedule shall be submitted for approval. The door schedule shall include a description of the type, location and size of each door and frame.

PRODUCTS.--

Metal door.--

Metal door shall be flush, seamless steel door factory prepared and reinforced to receive hardware and having cold rolled stretcher leveled sheet steel face sheets not less than 1.2 mm thick (18-gage). Face sheets shall be bonded with thermosetting adhesive to rigid board honeycomb or precured foam core; or face sheets shall be welded to all parts of an assembled grid of cold formed pressed metal stiffeners and framing members located around edges, ends, openings and at all locations necessary to prevent buckling of face sheets. Seams shall be tack welded, filled and ground smooth. Bottom edge and internal stiffeners of grid type core shall have moisture vents. Welds on exposed surfaces shall be ground smooth. Louvered or glazed openings shall be provided where shown on the plans.

Door shall be cleaned and treated by the bonderized process or approved phosphatizing process and then given one factory application of metal protective rust inhibitive primer. Primer shall not contain lead type pigments.

Pressed metal frame.--

Pressed metal frame shall be not less than 1.5 mm thick (16-gage) sheet steel with integral stop, mitered corners, face welded and ground smooth corners. Frames shall be reinforced for all hardware and shall be cleaned and treated by the bonderized process or an approved phosphatizing process and then given one factory application of metal protective rust inhibitive primer. Primer shall not contain lead type pigments.

Sealants.--

Sealants shall be ultraviolet and ozone resistant, gun grade polysulfide or polyurethane, multicomponent, Federal Specification: TT-S-227.

EXECUTION.--

INSTALLATION.--Doors and frames shall be installed rigidly, securely, plumb and true and in such a manner that the doors operate freely without rubbing or binding. Clearance between frame and door shall be not more than 3 mm. The exterior frame shall be sealed weathertight.

Pressed metal frames shall be secured with clips and anchors as shown on the plans.

PAINTING.--Except for the primer application specified herein, doors and frames shall be cleaned, prepared and painted in accordance with the requirements specified under "Painting" in Section 12-9, "Finishes," of these special provisions.

12-8.02 FINISH HARDWARE

PART 1.- GENERAL

SUMMARY.--

This work shall consist of furnishing and installing hardware items for doors in accordance with the details shown on the plans and these special provisions.

Hardware assemblies shall comply with the disabled accessibility requirements indicated on the plans and specified in these special provisions.

SUBMITTALS.—

Manufacturer's technical information and catalog cuts for each item of door hardware and a door hardware schedule shall be submitted for approval prior to installation.

Manufacturer's catalog cuts shall include catalog numbers, material, grade, type, size, function, design, quality and finish of hardware.

The door hardware schedule shall indicate the location and size of door opening, the door and frame material, and the size, style, finish and quantity of the hardware components required.

FINISHES.—

Hardware shall be provided with standard US 26D metal plated finish.

KEYING INSTRUCTIONS.—

New locks shall be compatible with the master key system of the existing facility and shall be keyed to the existing lock system in use.

Locks and cylinders shall be provided with six pin "O" cylinders and blank keys. Cylinders and blank keys shall be delivered to the Engineer for combining of cylinders and cutting of keys.

The Contractor shall provide cylinders for use during construction. Construction cylinders shall remain in place until permanent cylinders are installed. Construction cylinders shall remain the property of the Contractor.

Key bows shall be stamped "State of California" and "Do Not Duplicate."

PART 2.- PRODUCTS.--

GENERAL.—

Door hardware equal in material, grade, type, size, function, design, quality and manufacture to that specified herein may be submitted for approval.

Butt hinges.--

Butt hinges shall be steel, 1 1/2-pair per door unless otherwise specified or shown on the plans. Nonremovable pins shall be provided at outswing exterior doors. Hinge size shall be 114 mm x 114 mm unless otherwise noted.

Standard weight hinges shall be:

Hager	BB 1279
McKinney	TB 2714
Stanley	BB 179
or equal.	

Mortise locksets.--

Mortise locksets shall be steel case with 32 mm x 203 mm face plate and 70 mm backset. Door and frame preparation for mortise locksets shall conform to ANSI A115.1.

Lever operated lockset shall be:

Best	35H 6FW 15H
Falcon	LM521 DG
Schlage	L9453P x 06
or equal.	

Cylindrical dead locks.--

Cylindrical dead locks shall have 25 mm throw bolt with concealed hardened steel inserts and one inch diameter bolt housing, 70 mm backset.

Single cylinder dead lock with inside thumb turn shall be:

Best	83T 7K
Falcon	D441
Schlage	B460P
or equal.	

Pushplates and pullplates.--

Pushplates and pullplates shall be 102 mm x 406 mm x 1.52 mm (16-gage). Grips shall be 25 mm diameter with 38 mm standoff and 203 mm center to center fastening, unless indicated otherwise.

Pushplates shall be:

Builders Brass	47
Quality	40
Trimco	1001-3
or equal.	

Pullplates shall be:

Builders Brass	47x290-1
Quality	1515
Trimco	01-3 x 1193-2
or equal.	

Door mounted door stop.--

Door mounted door stop shall have a 95 mm projection and 3-point anchoring.

Door mounted door stop shall be:

Builders Brass	W95
Quality	1235
Trimco	1235
or equal.	

Thresholds, rain drips, door sweeps and door shoes.--

Thresholds, rain drips, door sweeps and door shoes shall conform to the sizes and configurations shown on plans. Thresholds at door openings with accessibility requirements shall not exceed 13 mm in height.

Threshold, rain drip, door sweep and door shoe manufacturers shall be Pemko, Reese, Zero, or equal.

Threshold bedding sealant.--

Threshold bedding sealant shall conform to Federal Specification: SS-C-153.

Weatherstrip.--

Weatherstrip shall conform to the sizes and shapes shown on plans. Assemblies shall be UL listed and shall be provided where shown on the plans or as specified in these special provisions.

Weatherstrip manufacturers shall be Pemko, Reese, Zero, or equal.

Door signs and name plates.--

Door signs and name plates shall be as specified under "Signs" in Section 12-10, "Specialties," of these special provisions.

PART 3.- EXECUTION

DOORS AND FRAMES.--Doors and frames shall be set square and plumb and be properly prepared before the installation of hardware.

INSTALLATION.--Hardware items shall be accurately fitted, securely applied, and adjusted and lubricated in accordance with the manufacturer's instructions. Installation shall provide proper operation without bind or excessive play.

Hinges shall be installed at equal spacing with the center of the end hinges not more than 244 mm from the top and bottom of the door. Locksets shall be 1024 mm from the finished floor.

Thresholds shall be set in a continuous bed of sealant material.

Door controls shall be set so that the effort required to operate doors with closers shall not exceed 37.7 N maximum for exterior doors and 22.3 N maximum for interior doors.

Door stops located on concrete surfaces shall be fastened rigidly and securely in place with expansion anchoring devices. Door stops mounted elsewhere shall be securely attached with wood screws or expansion devices as required.

Backing shall be provided in wall framing at wall bumper locations.

The location and inscriptions for door signs and name plates shall be as shown on the plans.

Hardware, except hinges, shall be removed from surfaces to be painted before painting.

Upon completion of installation and adjustment, the Contractor shall deliver to the Engineer all dogging keys, closer valve keys, lock spanner wrenches, and other factory furnished installation aids, instructions and maintenance guides.

DOOR HARDWARE GROUPS AND SCHEDULE.--Hardware groups specified herein shall correspond to those shown on the plans:

GROUP 1

- 1 1/2-pair butt hinges
- 1 each lever operated mortise lockset
- 1 each cylindrical dead lock
- 1 each door mounted door stop
- 1 each threshold, rain drip, door shoe, door sweep
- 1 each weatherstrip

GROUP 2

- 1 1/2-pair butt hinges
- 1 each pushplate
- 1 each pullplate
- 1 each cylindrical dead lock
- 1 each door mounted door stop
- 1 each threshold, rain drip, door shoe, door sweep
- 1 each weatherstrip

SECTION 12-9. FINISHES

12-9.01 CERAMIC TILE

PART 1.- GENERAL

SUMMARY.--

Scope.--This work shall consist of furnishing and installing ceramic tile in accordance with the details shown on the plans and these special provisions.

Ceramic tile shall include glazed wall tile, matte porcelain tile, trim tile, setting materials, grouts and such other materials as maybe required for a complete installation.

SUBMITTALS.--

Product data.--Manufacturer's descriptive data, a list of materials to be used, and installation instructions for all materials required for the work shall be submitted for approval.

Manufacturer's descriptive data shall be submitted for each type of tile, mortar bed materials, bond coat materials and additives, and grout materials and additives.

Materials list and installation instructions shall include all products and materials to be incorporated into the work.

Friction reports shall be submitted for tile products to be used on floors and other pedestrian surfaces.

Samples.--Samples shall include 2 individual samples of each type and color of tile and trim to be installed and shall be of the same size, shape, pattern and finish as the tile and trim to be installed.

QUALITY ASSURANCE.--

Single source responsibility.--Each type and color of tile, grout and setting materials shall be obtained from a single source.

Master Grade Certificates.--Each shipment of tile to the project site shall be accompanied by a Master Grade Certificate issued by the tile manufacturer.

Certificates of Compliance.--Certificates of compliance shall be furnished for bond coat materials, setting bed materials and grout in accordance with the requirements specified in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications.

DELIVERY, STORAGE AND HANDLING.--

Delivery.--Tile and packaged materials shall be delivered to the job site in sealed, unbroken, unopened containers with the labels intact. Tile containers shall bear the Standard Grade label.

Storage and handling.--Materials shall be stored and handled in such a manner as to prevent damage or contamination by water, freezing or foreign matter.

PROJECT CONDITIONS.--

Protection.--Tile work shall be protected and environmental conditions maintained during and after installation to comply with the reference standards and manufacturer's printed instructions.

Temperatures.--Unless otherwise specified in the manufacturer's installation instructions, the ambient temperature shall be maintained at not less than 10°C nor more than 38°C in tiled areas during installation and for 7 days after completion. Exterior work areas shall be shaded from direct sunlight during installation.

Tile shall not be installed when the temperature of the substrate is greater than 32°C or is frost covered.

Illumination.--Interior work areas shall be illuminated to provide the same level and angle of illumination as will be available during final inspection.

PART 2.- PRODUCTS

MANUFACTURERS.--

Available manufacture's.--Subject to compliance with the specifications, tile shall be American Olean Tile Co., Inc.; Summitville Tiles, Inc.; United States Ceramic Tile Co.; or equal.

GENERAL.--

Ceramic tile.--Ceramic tile shall conform to the requirements in ANSI Standard: A137.1, "American National Standard Specifications for Ceramic Tile" for types and grades of tile indicated.

Ceramic tile shall conform to the "Standard Grade" requirements.

Tile installation materials.--Tile installation materials shall conform to the requirements in ANSI standard referenced with products and materials indicated for setting and grouting.

Tile color and size.--Tile color shall be as shown on the plans; tile size shall be as indicated in the Schedule elsewhere in this special provision.

Slip resistant tile.--Slip resistant tile shall have sufficient abrasives added such that the static coefficient of friction, wet or dry, shall be not less than 0.6 for walking surfaces and 0.8 for ramps when tested in accordance with ASTM Designation: C 1028.

TILE PRODUCTS.--

Matte porcelain wall tile.--

Matte porcelain wall tile shall be machine made, unpolished, dust pressed natural porcelain clay, and shall have a plain face, and cushion edges. Tile shall be 8 mm nominal thickness.

Tile trim shall match material, size and finish of field tile. Free edges of tiled areas of walls shall have bullnose type trim. Outside corners shall have bullnose type runner trim (not beads). Reentrant corners shall have cove type trim.

Matte mosaic tile.--

Matte mosaic tile shall be machine made, unpolished, dust pressed natural porcelain clay and shall have a plain face. Tile shall have a nominal thickness of 8 mm. Matte mosaic tile shall be slip resistant.

Matte mosaic trim tile shall include cove type base at walls and single piece intersecting cove base at corners.

SETTING MATERIALS.--

Portland cement mortar installation materials.--

Materials for portland cement mortar installation shall conform to the requirements in ANSI Standard: A108.1 as required for installation method designated, unless otherwise indicated.

Tile bond coat.--

Tile bond coat shall be latex-portland cement bond coat.

Latex-portland cement mortar bond coat shall be a prepackaged mortar mix, conforming to ANSI Standard: A118.4, incorporating a dry acrylic resin, and to which only water is added at the job site. Mortar shall be suitable for exterior use and be labeled for the type of tile to be installed.

GROUTING MATERIALS.--

Tile grout.--

Tile grout shall be latex-portland cement grout.

Latex-portland cement grout shall be a prepackaged grout mix, conforming to ANSI Standard: A118.6, incorporating a dry acrylic resin, and to which only water is added at the jobsite. Grout shall be suitable for exterior use and labeled for the type of tile to be installed.

Grout pigment.--

Grout pigment shall be chemically inert, fade resistant mineral oxide or synthetic type. Color shall be as shown on the plans.

SEALANTS.--**Sealant.--**

Sealant for vertical expansion joints shall be a medium modulus silicone or polyurethane. Sealant for horizontal joints shall be a 2-part polyurethane type material with a Shore Hardness of 35 to 45.

Color of exposed sealants shall match color of grout in tile adjoining sealed joints.

MORTAR BEDS.--**Cement mortar bed.--**

Cement mortar bed for floors shall be proportioned of one part cement, 1/10 parts hydrated lime, 5 parts damp sand by volume and only enough water added to provide the necessary workability. Ingredients shall be dry mixed, water added, and materials blended to produce a stiff mix. Mortar bed shall be not less than 32 mm in thickness.

MISCELLANEOUS MATERIALS.--**Sand.--**

Sand shall be a natural or manufactured sand conforming to ASTM Designation: C 144, except that no more than 10 percent shall pass the No. 150 μm sieve.

Sealers.--

Sealer for grout shall be a penetrating proprietary compound designed for sealing grout. Silicone sealers shall not be used.

Cement.--

Cement shall conform to ASTM Designation: C 150, Type I.

Hydrated lime.--

Hydrated lime shall conform to ASTM Designation: C 206, Type S, or ASTM Designation: C 207, Type S.

Water.--

Water shall be clean and potable.

Cementitious tile backer board.--

Cementitious backer board shall be a backing and underlayment panel composed of a concrete core with glass mesh reinforcing on both faces and conforming to the requirements of ANSI Standard: A118.9.

MIXING MORTAR AND GROUT.--

Mixing.--Mortar and grout shall be mixed to comply with the requirements of referenced standards and manufacturers for accurately proportioning of materials, water or additive content, mixing equipment and mixer speeds, mixing containers, mixing time, and other procedures need to produce mortars and grout of uniform quality with optimum performance characteristics for application intended.

PART 3.- EXECUTION

PREPARATION.--

General.--Concrete, mortar, or masonry substrate surfaces which are to receive a mortar bed shall not vary more than 5 mm in 2.4 m from the required plane and shall be true, plumb at vertical surfaces, and square at intersection edges.

Surfaces to receive a mortar setting bed or a bond coat shall be cleaned adequately to assure a tight bond to the applied material. Such cleaning shall leave the surface thoroughly roughened and free from laitance, coatings, oil, sand, dust and loose particles.

The cleaned surfaces which are to receive a mortar bed shall be saturated with water just prior to placing mortar or the cleaned surfaces shall be coated with fresh neat cement slurry. If the surface is saturated with water, excess water shall be removed and the wetted surfaces uniformly dusted with portland cement. The slurry or wetted cement dust shall be broomed to completely coat the surface with a thin and uniform coating just prior to placing the mortar.

Substrates shall be inspected to insure that grounds, anchors, plugs, recessed frames, bucks, drains, electrical work, mechanical work, and similar items in or behind the tile have been installed before proceeding with installation of the tiles.

INSTALLATION.--

General.--Tile installation shall conform to applicable parts of ANSI 108 Series of the tile installation standards included under "American National Standard Specifications for the Installation of Ceramic Tile" and Tile Council of American, "Handbook for Ceramic Tile Installation."

All tile shall be installed on a bond coat over a setting bed. The setting bed shall be a cured cement mortar bed or a prepared, dimensionally stable substrate of cementitious backer board as shown on the plans.

The back face of the tile shall be free of paper, adhesives, fiber mesh, resins, or other materials affecting the bond of the tile to the bedding material.

Tile sheets shall have permanent edge bonding or temporary mounting materials on the exposed face. Water soluble or absorbent adhesives shall not be used for edge bonding. Temporary mounting materials shall allow observation during tile setting operations.

Tile work shall extend into recesses and under or behind equipment and fixtures, to form a complete covering without interruptions, except as shown on the plans. Work shall be terminated neatly at obstructions, edges and corners without disrupting pattern or joint alignments.

Intersections and returns shall be accurately formed. Cutting and drilling of tile shall be performed without marring visible surfaces. Cut edges of tile abutting trim, finish or built-in items shall be carefully ground to produce straight aligned joints. Tile shall be closely fit to electrical outlets, piping, fixtures and other penetrations such that plates, collars, or covers overlap the tile.

Mortar bed placement.--The mortar bed, with or without reinforcement as shown on the plans, shall be placed, consolidated, and finished to the required thickness.

The surface of the mortar bed shall be true and pitched as shown on the plans, without high or low spots. The mortar bed surface shall not vary more than 3 mm in 2.4 m from a plane parallel to the finished tile surface when tile is installed on a cured mortar bed.

In no case shall the allowed tolerances result in offsets between adjoining tiles, low spots on finished tile surfaces than can pond water, or finished tile surfaces that are not plumb or not true.

Cement mortar beds to receive a tile bond coat shall be damp cured under cover for a minimum of 48 hours at a temperature of not less than 21°C.

Cementitious backer board.--Cementitious backer board shall be installed in accordance with the provisions of ANSI Standard: A118.11.

Tile bond coat.--The tile bond coat mortar shall be mixed according to the manufacturer's recommendations. The consistency of the mixture shall be such that ridges formed with the recommended notched trowel shall not flow or slump. Reworking will be allowed provided no water or materials are added. The setting bed surfaces shall be dampened before placing the bond coat as necessary tile installation, but the setting bed shall not be soaked. The setting bed surfaces for epoxy bond coat shall be dry.

The bond coat shall be floated onto the cured mortar bed surface with sufficient pressure to cover the surface evenly with no bare spots. The surface area to be covered with the bond coat shall be no greater than the area that can be tiled while the bond coat is still plastic. The bond coat shall be combed with a notched trowel as recommended by the manufacturer within 10 minutes before installing tile. Tile shall not be installed on a skinned over bond coat.

Installing tiles.--Tile shall be installed in accordance with the manufacturer's instructions and shall be set solid and shall be well bonded to the substrate.

Tile set on a tile bond coat shall be installed in accordance with ANSI Standard: A108.5.

If tiles are cut, the cuts shall be made with saws. Cut edges shall be rubbed with an abrasive stone to bring the edge of the glaze slightly back from the body of the tile. Cuts shall be accurately made to neatly fit the tile in place. Cut edges shall not be butted against other tile. Cut tile shall be at least half the size of a full size tile.

Tile shall completely cover wall areas behind mirrors and fixtures.

Tile shall be installed so that the finished tile surface does not vary more than 3 mm in 2.4 m from the finished tile surface shown on the plans. In no case shall there be offsets in adjoining tiles, low spots on finished tile surfaces that can pond water, or finished tile surfaces that are not plumb or true in the completed tile work.

Tiles shall be firmly pressed into the freshly notched bond coat. Tile on interior surfaces shall be tapped and beat into a true surface and to obtain at least 80 percent coverage by the mortar on the back of each tile. Tile on exterior surfaces shall have 100 percent coverage and shall be back-buttered immediately prior to setting the tile.

If tile is face mounted, the paper and glue shall be removed within one hour after tile is installed and all tiles that do not meet the requirements for joints and surface tolerance shall be adjusted or replaced.

Mortar that exudes into the grout spaces between tiles shall be removed to the bottom of tile.

Joints.--Joints between tile shall be continuous both vertically and horizontally. Joints shall be straight and of uniform and equal width. Where tiles on adjoining surface are the same size, the joints shall align, one with the other. Joint width shall be as recommended by the tile manufacturer.

Grouting tile.--Grout shall be mixed, applied and cured in accordance with the manufacturer's recommendations and ANSI Standard: A108.10 for cement grout and ANSI Standard: A108.9 for epoxy grout.

Spacers, strings, ropes, pegs, glue, paper, and face mounting material shall be removed before grouting. Joints between glazed wall tile shall be wetted if they have become dry. Joints for epoxy mortar shall be dry.

Grouting shall not begin until at least 48 hours after installing tile.

A maximum amount of grout shall be forced into the joints between tiles in accordance with the manufacturer's recommendations. The grout shall be finished to the depth of the cushion for cushion edge tile and finished flush with the surface for square edge tile. All gaps and skips in the grout spaces shall be filled.

Mortar or mounting mesh shall not show through the grouted joints.

The finished grout shall have a uniform color and shall be smooth without voids, pinholes or low spots.

Expansion joints shall be kept free of grout or mortar.

Grout shall be protected from freezing or frost for a least 5 days after installation.

Expansion joints.--Expansion joints shall be installed at the perimeter of all tile floors and at all substrate control joints and changes in the substrate material. Exterior expansion joint spacing shall not exceed 5 m in any direction.

All expansion joints shall be made with sealant over backer rods. The thickness of sealant at the center of expansion joints shall not exceed the width of the joint. Joint edges shall be primed as recommended by the sealant manufacturer.

Sounding tile.--Tiled surfaces shall be sounded with a metal bar or chain for improperly bonded tile or setting bed. Tile or setting bed that emits a hollow sound shall be replaced.

Replacement.--Cracked, chipped, broken, or otherwise defective tiles shall be removed and replaced. All tiles which differ more than 2 mm in elevation from adjacent tile edges shall be removed and replaced.

Curing.--After the installation of tile and the grouting of joints, the tile and grout shall be cured by keeping the surface continuously damp for at least 72 hours after grouting. Curing materials shall not stain the tile or grouted joints. Curing methods shall not erode away the grout.

After grouting, horizontal tiled surfaces shall be closed to traffic, and all tiled surfaces shall be kept free from impact, vibration or shock, for at least 72 hours.

CLEANING AND PROTECTION.--

Cleaning tile surfaces.--All exposed tile surfaces shall be cleaned of all grout haze upon completion of grouting. Acids and chemicals used to clean tile shall conform to the tile manufacturer's recommendations. Cleaners shall not be harmful to materials on surfaces of abutting floors, walls, and ceilings. Tile work shall be rinsed thoroughly with clean water before and after using acid or chemical cleaners. After cleaning and rinsing, tile surfaces shall be polished using a soft cloth.

Tile work shall be cleaned and polished again immediately prior to completion of the contract. All dirt, grime, stains, paints, grease, and other discoloring agents or foreign materials shall be removed.

Protection.--After grouting, horizontal tiled surfaces shall be closed to traffic, and all tiled surfaces shall be kept free from impact, vibration or shock, for at least 72 hours after.

Tile surfaces damaged by construction operations shall be retiled.

SCHEDULES.--

Wall tile.--

Wall tile shall be nominal 102 mm x 102 mm matte porcelain wall tile. Installation on cementitious backer board using a tile bond coat and grout, shall conform to the requirements of Method W 244. "Handbook for Ceramic Tile Installation."

Floor tile.--

Floor tile shall be nominal 25 mm x 25 mm matte mosaic tile installed on a mortar bed using a tile bond coat and grout and shall conform to the requirements of Method F 112, "Handbook for Ceramic Tile Installation."

12-9.02 PAINTING

PART 1.- GENERAL

SUMMARY.--This work shall consist of preparing surfaces to receive coatings, and furnishing and applying coatings, in accordance with the schedules and details shown on the plans, and these special provisions.

The coatings specified in this section are in addition to any factory finishes, shop priming, or surface treatment specified elsewhere in these special provisions.

SUBMITTALS.--Manufacturer's descriptive data, a materials list, and color samples shall be submitted for approval.

Product descriptive data shall include product description, manufacturer's recommendations for product mixing, thinning, tinting, handling, site environmental requirements, product application and drying time.

Materials list shall include manufacturer's name, trade name, and product numbers for each type coating to be applied.

Color samples shall be manufacturer's color cards, approximately 50 mm x 75 mm, for each color of coating shown on the plans. Color samples for stains shall be submitted on wood of the same species, color, and texture as the wood to receive the stain.

REGULATORY REQUIREMENTS.--Coatings and applications shall conform to the rules for control of volatile organic compound emissions adopted by the air quality control district in the air basin in which the coatings are applied.

SITE ENVIRONMENTAL REQUIREMENTS.--Coatings shall not be applied when the air temperature is below 10°C (20°C for varnishes) or when the relative humidity exceeds 75 percent.

The surface to be coated shall be maintained at a minimum temperature of 7°C for a period of 24 hours prior to, and 48 hours after the application of the coating. Heating facilities shall be provided when necessary.

Continuous ventilation shall be provided during application of the coatings.

A minimum lighting level of 865 lux, measured 1 m from the surface to be coated, shall be provided while surfaces are being prepared for coatings and during coating applications.

DELIVERY, STORAGE, AND HANDLING.--Products shall be delivered to the site in sealed, labeled containers and stored in a well ventilated area at an ambient air temperature of not less than 7°C. Container labeling shall include manufacturer's name, type of coating, trade name, color designation, drying time, and instructions for tinting, mixing, and thinning.

MAINTENANCE STOCK.--Upon completion of coating work, a full 3.8 liter container of each type and color of finish coat and stain used shall be delivered to the location at the project site designated by the Engineer. Containers shall be tightly sealed and labeled with color, texture, and room locations where used, in addition to the manufacturer's standard product label.

PART 2.- PRODUCTS

GENERAL.--The products shall be the best quality grade coatings of the specified types as regularly manufactured by nationally recognized paint and varnish manufacturers that have not less than 10 years experience in manufacturing paints and varnishes. Products that do not bear the manufacturer's identification as the best quality grade product shall not be used. Products for each coating system shall be by a single manufacturer and shall not contain lead type pigments.

Thinners, shellac, fillers, patching compounds, coloring tint, and other products required to achieve the specified finish shall be the manufacturer's best quality and shall be used as recommended.

PART 3.- EXECUTION

INSPECTION.--Surfaces to be coated at the jobsite shall be approved by the Engineer prior to the application of coatings. The Contractor shall notify the Engineer at least 3 working days prior to the application of coatings.

SURFACE PREPARATION.--Surfaces scheduled to be coated shall be prepared in accordance with the following, except that the surfaces not specified herein shall be prepared as recommended by the coating manufacturer.

GENERAL.--Hardware, cover plates, light fixture trim, and similar items shall be removed prior to preparing surfaces for coating. Following the application of the finish coating, the removed items shall be reinstalled in their original locations.

WOOD.--Oil and grease shall be removed by solvent wash. Mildew shall be removed by mildew wash. Surfaces to be coated shall be cleaned of all dirt, excess material, or filler by hand cleaning. Smooth surfaced wood shall be sanded lightly.

A sealer composed of equal parts of shellac and alcohol shall be spot applied to knots, sap, pitch, tar, creosote, and other bleeding substances.

After the application of the prime coat, all nail holes, cracks, open joints, dents, scars, and surface irregularities shall be filled, hand cleaned, and spot primed to provide smooth surfaces for the application of finish coats.

Irregularities in wood surfaces to receive a transparent stain finish shall be filled and hand cleaned after the first coat of stain has been applied. The color of the filler shall match the color of the stained wood.

Irregularities in wood surfaces to receive a clear finish shall be filled and hand cleaned before the application of coatings. The color of the filler shall match the color of the coated wood.

GALVANIZED METAL.--Oils, grease, and fabrication lubricants shall be removed by solvent wash. Surfaces shall be cleaned of remaining surface treatments by hand cleaning. New surfaces shall be roughened by hand cleaning or light abrasive blasting.

Abraded or corroded areas shall be hand cleaned and spot coated with one coat of vinyl wash pretreatment. Abraded or corroded areas on new surfaces not scheduled to be painted shall be cleaned by solvent wash, hand cleaned, and given 2 spot applications of zinc rich paint.

STEEL AND OTHER FERROUS METALS.--Oils, grease, and fabrication lubricants shall be removed by solvent wash. Dirt, water soluble chemicals, and similar surface contamination shall be removed by detergent wash or steam cleaning. Mill scale and rust shall be removed by hand cleaning or abrasive blasting.

ALUMINUM AND OTHER NON-FERROUS METALS.--Oils, grease, and fabrication lubricants shall be removed by solvent wash. Dirt, water soluble chemicals, and similar surface contamination shall be removed by detergent wash.

CONCRETE UNIT MASONRY.--New material shall be cured a minimum of 14 days before coating. Surface dirt and dust shall be removed by brooming, air blast, or vacuum cleaner. Oil and grease shall be removed by steam cleaning. Form release agents, weak concrete, surface laitance, dirt, and other deleterious material shall be removed by sandblasting. Cracks and voids shall be filled with cement mortar patching material.

PREVIOUSLY COATED AND SHOP PRIMED SURFACES.--Dirt, oil, grease, or other surface contaminants shall be removed by water blasting, steam cleaning, or TSP wash. Minor surface imperfections shall be filled as required for new work. Mildew shall be removed by mildew wash. Chalking paint shall be removed by hand cleaning. The surfaces of existing hard or glossy coatings shall be abraded to dull the finish by hand cleaning or light abrasive blasting. Abrasive blasting shall not be used on wood or non-ferrous metal surfaces.

Chipped, peeling, blistered, or loose coatings shall be removed by hand cleaning, water blasting, or abrasive blasting. Bare areas shall be pretreated and primed as required for new work.

DEFINITIONS.--

DETERGENT WASH.--Removal of dirt and water soluble chemicals by scrubbing with a solution of detergent and water, and removal of all solution and residues with clean water.

HAND CLEANING.--Removal of dirt, loose rust, mill scale, excess base material, filler, aluminum oxide, chalking paint, peeling paint, or paint which is not firmly bonded to the surfaces by using hand or powered wire brushes, hand scraping tools, power grinders, or sandpaper and removal of all loose particles and dust prior to coating.

MILDEW WASH.--Removal of mildew by scrubbing with a solution of detergent, hypochlorite-type household bleach, and warm water, and removal of all solution and residues with clean water.

ABRASIVE BLASTING.--Removal of oil, grease, form release agents, paint, dirt, rust, mill scale, efflorescence, weak concrete, or laitance, by the use of airborne abrasives, and removal of loose particles, dust, and abrasives by blasting with clean air.

Abrasives shall be limited to clean dry sand, mineral grit, steel grit, or steel shot, and shall be graded to produce satisfactory results. Unwashed beach sand containing salt or silt shall not be used.

Abrasive blasting shall conform to the requirements of SSPC-SP6-85, Commercial Blast Cleaning, as defined in the Steel Structures Painting Council Manual.

Light abrasive blasting shall conform to the requirements of SSPC-SP7-85, Brush-Off Blast Cleaning, as defined in the Steel Structures Painting Council Manual.

SOLVENT WASH.--Removal of oil, grease, wax, dirt, or other foreign matter by using solvents, such as mineral spirits or xylol, or other approved cleaning compounds.

STEAM CLEANING.--Removal of oil, grease, dirt, rust, scale, or other foreign matter by using steam generated by commercial steam cleaning equipment, from a solution of water and steam cleaning compounds, and removal of all residues and cleaning compounds with clean water.

TSP WASH.--Removal of oil, grease, dirt, paint gloss, and other foreign matter by scrubbing with a solution of trisodium phosphate and warm water, and removal of all solution and residues with clean water.

WATER BLASTING.--High pressure, low volume water stream for removing dirt, light scale, chalking or peeling paint. Water blasting equipment shall produce not less than a 13 800 MPa minimum output pressure when used. Heated water shall not exceed 66°C. If a detergent solution is used, it shall be biodegradable and shall be removed from all surfaces with clean water.

PROTECTION.--The Contractor shall provide protective devices, such as tarps, screens or covers, as necessary to prevent damage to the work and to other property or persons from all cleaning and painting operations.

Paint or paint stains on surfaces not designated to be painted shall be removed by the Contractor at his expense and the original surface restored to the satisfaction of the Engineer.

APPLICATION.--

GENERAL.--Coatings shall be applied in accordance with the printed instructions and at the application rates recommended by the manufacturer to achieve the dry film thickness specified in these special provisions.

Mixing, thinning and tinting shall conform to the manufacturer's printed instructions. Thinning will be allowed only when recommended by the manufacturer.

Coatings shall be applied only when surfaces are dry and properly prepared.

Cleaning and painting shall be scheduled so that dust and other contaminants from the cleaning process will not fall on wet, newly coated surfaces.

Materials required to be coated shall have coatings applied to all exposed surfaces, including the tops and bottoms of wood and metal doors, the insides of cabinets, and other surfaces not normally visible from eye level.

APPLICATION SURFACE FINISH.--Each coat shall be applied to a uniform finish. Finished surfaces shall be free of surface deviations and imperfections such as skips, cloudiness, spotting, holidays, laps, brush marks, runs, sags, curtains, ropiness, improper cutting in, overspray, drips, ridges, waves, and variations in color and texture.

Each application of a multiple application finish system shall closely resemble the final color coat, except each application shall provide enough contrast in shade to distinguish the separate applications.

WORK REQUIRED BETWEEN APPLICATIONS.--Each application of material shall be cured in accordance with the coating manufacturer's recommendations before applying the succeeding coating. Enamels and clear finishes shall be lightly sanded, dusted, and wiped clean between applications.

Stain blocking primer shall be spot applied whenever stains bleed through the previous application of a coating.

TIMING OF APPLICATIONS.--The first application of the specified coating system shall be applied prior to any deterioration of the newly prepared surface. Metal surfaces shall be prepared and prime coated the same day that cleaning of bare metal is performed. Additional prime coats shall be applied as soon as drying time of the preceding coat permits.

Metal surfaces shall be prime coated within 12 hours of application of vinyl wash pretreatment.

Shellac sealer shall be allowed to dry at least 12 hours before applying the next coat.

Drying time between applications of water borne coatings shall be at least 12 hours.

APPLICATION METHODS.--Coatings shall be applied by brush, roller or spray. Rollers shall be of a type which do not leave a stippled texture in the paint film. Extension handles for rollers shall not be greater than 2 m in length.

If spray methods are used, surface deviations and imperfections such as, overspray, thickness deviations, lap marks, and orange peel shall be considered as evidence that the work is unsatisfactory and the Contractor shall apply the remainder of the coating by brush or roller, as approved by the Engineer.

DRY FILM THICKNESS.--

Vinyl wash pretreatment	0.007 mm to 0.13 mm, maximum.
Bituminous paint	0.1 mm, minimum.
Other primers, undercoats, sealers, and coatings	As recommended by the manufacturer.

BACKPRIMING.--The first application of the specified coating system shall be applied to all wood surfaces (face, back, edges, and ends) of wood materials that are not factory coated, immediately upon delivery to the project site, except surfaces of interior finish woodwork that adjoin concrete or masonry shall be coated with one application of alkyd exterior wood primer before installation.

When clear or stain type coatings are required on millwork, trim, or paneling, varnish, reduced 25 percent by mineral spirits, shall be used for coating the back faces.

All primed metal surfaces in contact with concrete or concrete block exterior walls shall be coated with a bituminous paint on those surfaces in contact with the wall.

PATCHES IN PREVIOUSLY COATED SURFACES.--Where patches are made on surfaces of previously coated walls or ceilings, the entire surface to corners on every side of the patch shall be coated with a minimum of one application of the finish coat.

FINISHING MECHANICAL AND ELECTRICAL COMPONENTS.--Shop primed mechanical and electrical components shall be finish coated in accordance with the coating system entitled, "Shop Primed Steel." Louvers, grilles, covers, and access panels on mechanical and electrical components shall be removed and coated separately.

Interior surfaces of air ducts which are visible through grilles or louvers shall be coated with one application of flat black enamel, to limit of the sight line.

Exposed conduit, piping, and other mechanical and electrical components visible in public areas shall be painted.

Both sides and all surfaces, including edges and back of wood mounting panels for electrical and telephone equipment shall be finish coated before installing equipment.

CLEANING.--Upon completion of all operations, the coated surfaces shall be thoroughly cleaned of dust, dirt, grease, or other unsightly materials or substances.

Surfaces marred or damaged as a result of the Contractor's operations shall be repaired, at his expense, to match the condition of the surfaces prior to the beginning of the Contractor's operations.

COATING SYSTEMS.--The surfaces to be coated shall be as shown on the plans and as specified elsewhere in these special provisions. When a coating system is not shown or specified for a surface to be finish coated, the coating system to be used shall be as specified for the substrate material. The number of applications specified for each coating system listed herein is a minimum. Additional coats shall be applied if necessary to obtain a uniform color, texture, appearance, or required dry film thickness.

SYSTEM 1- ALUMINUM AND OTHER NON-FERROUS METALS.--

1 pretreat coat: vinyl wash pretreatment
1 prime coat: aluminum primer
2 finish coats: acrylic, exterior enamel, semi-gloss

SYSTEM 2- CONCRETE UNIT MASONRY.--

1 pretreat coat: block filler
1 prime coat: concrete and masonry primer
2 finish coats: acrylic, exterior enamel, semi-gloss

SYSTEM 3- GALVANIZED METAL.--

1 pretreat coat: vinyl wash pretreatment
1 prime coat: galvanized metal primer
2 finish coats: acrylic, exterior enamel, semi-gloss

SYSTEM 4- PREVIOUSLY COATED EXTERIOR SURFACES.--

1 prime coat : alkyd exterior enamel undercoat
2 finish coats: acrylic, exterior enamel, semi-gloss

SYSTEM 5- PREVIOUSLY COATED INTERIOR SURFACES.--

1 prime coat: alkyd interior wood primer
2 finish coats: acrylic, interior enamel, semi-gloss

SYSTEM 6- SHOP PRIMED STEEL.--

1 prime coat : red oxide ferrous metal primer
2 finish coats: alkyd, exterior enamel, semi-gloss

SYSTEM 7- STEEL AND OTHER FERROUS METALS.--

2 prime coats: red oxide ferrous metal primer
2 finish coats: alkyd, exterior enamel, semi-gloss

SYSTEM 8- WOOD, PAINTED.--

1 prime coat: alkyd, exterior wood primer
2 finish coats: acrylic, exterior enamel, semi-gloss

COLOR SCHEDULE.--Colors shall be as shown on the plans.

SECTION 12-10. SPECIALTIES

12-10.01 METAL TOILET PARTITION DOORS

GENERAL.--This work shall consist of furnishing and installing metal toilet partitions doors in accordance with the details shown on the plans and these special provisions.

Metal toilet partition doors shall consist of doors, door jambs, fasteners, anchorages and hardware. Internal reinforcement shall be provided at all fasteners, anchorages, hardware and accessories.

Doors shall have a factory applied, baked on enamel finish consisting of not less than one prime coat over a chemically pretreated base followed by at least one baked on enamel finish coat.

SUBMITTALS.--Manufacturer's descriptive data, standard color palette, installation instructions and working drawings shall be submitted for approval.

Colors will be selected from the manufacturer's standard color palette by the Engineer after the award of the contract.

Working drawings shall show the plan layout, door elevations and all details required for the complete installation and anchorage of the door system.

PRODUCTS.--

Doors and panels.--

Doors shall be flush, 25 mm minimum thickness, formed of two 0.86 mm (22-gage) minimum thickness, galvanized steel sheets over a honeycomb core. Doors shall have formed edges sealed with a continuous oval crown locking strip, and shall be mitered, welded and finished at the corners.

Doors shall have controlled action hinges, with vertical pintle and ball bearing roller operating on adjustable cams, or moving parts of nylon and stainless steel. Top pivots shall be recessed into edges of doors.

Doors shall be provided with slide bar latch and a combination coat-hat hook and door stop. Doors on stalls designed for use by the disabled shall also be provided with door pulls.

Fasteners and anchorages.--

Fasteners and anchorages shall be stainless steel with vandal resistant heads.

Hardware.--

Hardware shall be highly polished chromium plated, cast alloy, or heavy duty anodized aluminum.

EXECUTION.--

INSTALLATION.--Metal toilet doors shall be installed rigidly, securely, plumb, and true and in accordance with the manufacturer's recommendations. Tops and bottoms of doors shall align with tops and bottoms of panels, and all horizontal lines shall be level.

Rigid backing shall be provided in walls to receive anchorages.

Doors shall not bind during opening and closing. The clearance between the door edges and pilasters shall be uniform, equidistant, and shall not exceed 5 mm. Hinges shall be adjusted to hold doors ajar when unlatched. Doors on stalls designed for use by the disabled shall return to the closed position.

Drilling, cutting and fitting of wall and floor finishes shall be concealed by the completed installation.

CLEAN-UP.—Toilet doors shall be cleaned, polished and free of all defects. Chipped, dented, scratched, or otherwise damaged work shall be replaced at the Contractor's expense.

12-10.02 LOUVERS

GENERAL.--This work consists of furnishing and installing louvers in accordance with the details shown on the plans and these special provisions.

SUBMITTALS.--Manufacturer's descriptive data and installation instructions shall be submitted for approval.

PRODUCTS.--

Louvers.--

Louvers shall be factory fabricated units of extruded aluminum alloy not less than 2 mm thick (12-gage) or galvanized steel sheet not less than 1.63 mm thick (16-gage) with standard "Z" type blades, and removable bronze 16 x 16 mesh insect screens mounted on the inside of the units.

Louvers shall have integral caulking strips and retaining beads.

EXECUTION.--

INSTALLATION.--Louvers shall be installed in accordance with the manufacturer's instructions. The completed louver installation shall be weather tight.

PAINTING.--Louvers shall be cleaned, prepared and painted in accordance with the requirements specified under "Painting" in Section 12-9, "Finishes," of these special provisions.

12-10.03 INFORMATION DISPLAY CASES

PART 1.- GENERAL

SUMMARY.--

Scope.--This work shall consist of fabricating, furnishing and installing information display cases in accordance with the details shown on the plans and these special provisions.

Information display cases shall be completely factory assembled, illuminated units with tackboards and weatherstripped removable glazed panels, all in fixed frames.

SUBMITTALS.--

Product data.--Manufacturer's descriptive data for the component parts shall be submitted for approval.

Working drawings.--Working drawings of the display cases and manufacturer's descriptive data for the component parts shall be submitted for approval.

PART 2.- PRODUCTS

MATERIALS.--

Framing.--

Framing shall be factory fabricated bronze anodized aluminum frame and mitered corners.

Fasteners.--

Fasteners shall be as recommended by the manufacturer.

Glazing.--

Glazing shall be clear, mar resistant, coated acrylic plastic sheet, 6 mm thick with preformed neoprene or vinyl seals.

Tackboard.--

Tackboard shall be bulletin board grade, self-sealing, 6 mm thick glued to the plywood core. Glue shall be for exterior use and shall be compatible with the materials being adhered.

Plywood core.--

Plywood core shall be exterior grade plywood as recommended by the display board manufacturer.

Weatherstripping.--

Weatherstripping shall be continuous expanded neoprene rod type with continuous nailing tab.

Lighting fixture and miscellaneous hardware.--

Lighting fixture and miscellaneous hardware shall be as shown on the plans. Louver shall be the egg crate type with plastic lens.

FABRICATION.--

Shop assembly.--All joints shall be fitted tight and true.

Shop finishing.—Finish of aluminum frames shall be anodized bronze.

PART 3.- EXECUTION

Installation.--Information display cases shall be installed as shown on the plans. Hardware shall be adjusted, if necessary, after installation for smooth and easy operation.

12-10.04 SIGNS

PART 1.- GENERAL

SUMMARY.--

Scope.--This work shall consist of furnishing and installing signs in accordance with the details shown on the plans and these special provisions.

SUBMITTALS.--

Product data.--Manufacturer's descriptive data for sign materials, colors and graphics, and for fastening hardware and material shall be submitted for approval.

PART 2.- PRODUCTS

Plastic signs (permanent room identification).--

Plastic signs for permanent room identification for other than restrooms shall be scratch resistant, non-static, fire retardent, washable melamine laminate with a non-glare surface, not less than 3 mm thick. Letters and numbers shall be upper case Helvetica, 25 mm in height, 0.80 mm above and integral with sign material, accompanied by Grade 2 Braille.

Grade 2 Braille dots shall be 2.5 mm on centers in each cell with 5 mm space between cells. Dots shall be raised a minimum of 0.6 mm above the background.

Plastic sign (restroom).--

Plastic sign for restroom shall be not less than 6 mm acrylic plastic. Sign background shall be blue and shall conform to Federal Standard 595B, Color No. 15090. Male/female symbol and lettering shall be white and shall conform to Federal Standard 595B, Color No. 17886.

Male restroom identification shall be a male symbol on an equilateral triangle with edges 305 mm long and a vertex pointing upward.

Female restroom identification shall be a female symbol on a 305 mm diameter circle.

Unisex restroom identification shall be a male and female symbol on a 305 mm equilateral triangle superimposed on a 305 mm diameter circle.

Accessible building entrance sign.--

Accessible building entrance sign shall be not less than 3 mm acrylic plastic, not less than 102 mm x 102 mm , with the international symbol of accessibility.

Sign background shall be blue and shall conform to Federal Standard 595B, Color No. 15090. Symbol and border shall be white and shall conform to Federal Standard 595B, Color No. 17886.

Fastening hardware and material.--

Fastening hardware and material shall be as recommended by the sign manufacturer. Fasteners shall be noncorrosive.

PART 3.- EXECUTION

Inscription.--Sign messages shall be as shown on the plans.

Installation.--Plastic signs for room identification and restrooms shall be fastened or secured to clean, finished surfaces in accordance with the sign manufacturer's instructions. Signs shall be installed at a location and height as shown on the plans.

Fastening hardware and material shall be installed within the sign as shown on the plans.

12-10.05 TOILET ROOM ACCESSORIES

GENERAL.--This work shall consist of furnishing and installing toilet room accessories in accordance with the details shown on the plans and these special provisions.

SUBMITTALS.--Manufacturer's descriptive data and installation instructions and details shall be submitted for approval.

PRODUCTS.--**Mirror, wall hung.--**

Mirror, wall hung shall be Number 1 quality, 6 mm thick, electrolytically copper plated float or plate glass mirror with nonmoisture-absorbing filler. Mirror shall have a heavy gage galvanized steel back and stainless steel frame. The frame shall have a satin finish and shall be mitered and welded and the corners shall be ground smooth. Fasteners shall not penetrate surfaces of the frame exposed to view. Mirror shall conform to Federal Specification: DD-M-411b and shall be guaranteed against silver spoilage for not less than 10 years.

Grab bars.--

Grab bars shall be stainless steel, 38 mm diameter bars with integral mounting flanges concealed under integral escutcheons.

EXECUTION.--Toilet room accessories shall be installed in accordance with the manufacturer's recommendations. Fasteners for mounting toilet room accessories shall be concealed and vandal resistant.
Expansion anchors shall be used for mounting accessories on masonry or concrete walls.
Toilet room accessories shall be mounted after painting work has been complete.
All toilet room accessories shall be mounted plumb, secure and rigid. Grab bars shall be supported adequately so the bars will withstand an applied load of 113 kg at any point.

SECTION 12-11 THRU 12-14. (BLANK)
SECTION 12-15. MECHANICAL

12-15.01 MECHANICAL WORK

GENERAL.--

Scope.--This work shall consist of performing mechanical work in accordance with the details shown on the plans and these special provisions.

Mechanical work shall include furnishing all labor, materials, equipment and services required for providing plumbing systems.

Earthwork, foundations, sheet metal, painting, electrical, and such other work incidental and necessary to the proper installation and operation of the mechanical work shall be in accordance with the requirements specified for similar type work elsewhere in these special provisions.

System layouts are generally diagrammatic and location of equipment is approximate. Exact routing of pipes, ducts, etc., and location of equipment is to be governed by structural conditions and obstructions. Equipment requiring maintenance and inspection is to be readily accessible.

Roof penetrations shall be flashed and sealed watertight in accordance with the requirements specified under "Sheet Metal Flashing" in Section 12-7, "Thermal and Moisture Protection," of these special provisions.

SUBMITTALS.--

Product data.--A list of materials and equipment to be installed, manufacturer's descriptive data, and such other data as may be requested by the Engineer shall be submitted for approval.

Manufacturer's descriptive data shall include complete description, performance data and installation instructions for the materials and equipment specified herein. Control and wiring diagrams, rough-in dimensions for plumbing fixtures, and component layout shall be included where applicable.

Manufacturer's descriptive data shall be submitted for the following:

- Ball valve
- Drinking fountain
- Water chiller

CLOSEOUT SUBMITTALS.--

Operation and maintenance manuals.--Prior to the completion of the contract, 3 identified copies of the operation and maintenance instructions with parts lists for the equipment specified herein shall be delivered to the Engineer at the jobsite. The instructions and parts lists shall be indexed and bound in a manual form and shall be complete and adequate for the equipment installed. Inadequate or incomplete material shall be returned. The Contractor shall resubmit adequate and complete manuals at no expense to the State.

Operation and maintenance manuals shall be submitted for the following equipment:

- Drinking fountain
- Water chiller

QUALITY ASSURANCE.--

Codes and standards.--Mechanical work, including equipment, materials and installation, shall conform to the California Building Standards Code, Title 24, and to the California Code of Regulations, Title 8, Chapter 4, Division of Industrial Safety (DIS).

WARRANTY.--

Warranties and guarantees.--Manufacturer's warranties and guarantees for materials or equipment used in the work shall be delivered to the Engineer at the jobsite prior to acceptance of the contract.

12-15.02 PIPE, FITTINGS AND VALVES

PART 1.- GENERAL

SUMMARY.--

Scope.--This work shall consist of furnishing and installing pipes, fittings and valves in accordance with the details shown on the plans and these special provisions. Pipe, fittings and valves shall include such plumbing and piping accessories and appurtenances, not mentioned, that are required for the proper installation and operation of the plumbing and piping systems.

The pipe and fitting classes and material descriptions shall be as specified herein. No change in class or description shall be permitted without written permission from the Engineer.

QUALITY ASSURANCE.--

Codes and standards.--Pipe, fittings and valves shall be installed in accordance with the requirements in the latest edition of the Uniform Plumbing Code, the manufacturer's recommendations and the requirements specified herein.

PART 2.- PRODUCTS

MATERIALS.--

PIPE AND FITTINGS --

Class	Description
--------------	--------------------

A1.--

Schedule 40 galvanized steel pipe conforming to ASTM Designation: A 53, with 1040 kPa galvanized malleable iron banded screwed fittings and galvanized steel couplings. The weight of the zinc coating shall be not less than 90 percent of that specified in ASTM Designation: A 53.

A2.--

Schedule 40 galvanized steel pipe conforming to ASTM Designation: A 53, with black cast iron recessed drainage fittings. For rainwater leaders, neoprene-gasket compression couplings, Smith Blair, Dresser, or equal, may be used. The weight of the zinc coating shall be not less than 90 percent of that specified in ASTM Designation: A 53.

C1.--

Hub and plain end cast iron soil pipe with neoprene gaskets conforming to Cast Iron Soil Pipe Institute's Standard 301. Pipe, fittings and gaskets shall be of one manufacturer.

C2.--

Hubless cast iron soil pipe with neoprene gaskets, corrugated stainless steel shields and stainless steel clamps conforming to Cast Iron Soil Pipe Institute's Standard 301. Joint materials shall be furnished by pipe manufacturer.

H1.--

Type DWV hard copper tubing conforming to ASTM Designation: B 306, with DWV drainage fittings, stop type couplings and threaded adapters.

H3.--

Type L hard copper tubing conforming to ASTM Designation: B 88, with wrought copper or cast bronze solder joint pressure fittings, stop type couplings and threaded adapters. Solder shall be lead-free.

Unions (for steel pipe).--

Unions (for steel pipe) shall be 1730 kPa, threaded malleable iron, ground joint, brass to iron seat, galvanized or black to match piping.

Unions (for copper or brass pipe).--

Unions (for copper or brass pipe) shall be 1040 kPa cast bronze, ground joint, bronze to bronze seat with silver brazing threadless ends or 860 kPa cast brass, ground joint, brass to brass seat with threaded ends.

Unions (for brass waste and flush pipes).--

Unions (for brass waste and flush pipes) shall be slip or flange joint unions with soft rubber or leather gaskets. Unions shall be placed on the fixture side of the traps.

VALVES.--

Ball valve.--

Ball valve shall be two piece, minimum 2760 kPa WOG, bronze body and chrome plated or brass ball with full size port. Valve shall be Nibco Scott, T-580; Watts, B-6000; Kitz, 56; or equal.

PART 3.- EXECUTION

INSTALLATION.--

INSTALLATION OF PIPES AND FITTINGS.--

Pipe and fittings.--Pipe and fittings shall be installed in accordance with the following designated uses:

Designated Use	Pipe and Fitting Class
Domestic water in buildings	H3 or A1
Sanitary drain piping above ground in building	H1, C1, or C2
Sanitary vent piping above ground in building	A2, H1, C1, or C2

Installing piping.--Water piping shall be installed generally level, free of traps and bends, and arranged to conform to the building requirements.

Public use areas shall have concealed piping.

Utility chase shall have exposed piping.

Piping shall be installed parallel to walls. All obstructions shall be cleared, headroom preserved and openings and passageways kept clear whether shown or not. Piping shall not interfere with other work.

Where pipes pass through exterior walls, a clear space around pipe shall be provided. Space shall be caulked water tight with silicone caulk.

Exposed supply and drain piping at drinking fountain shall be chrome finished.

Forty-five degree bends shall be used where offsets are required in venting. Vent pipe headers shall be sloped to eliminate any water or condensation.

Vent piping shall extend a minimum of 200 mm above the roof.

Horizontal sanitary sewer pipe inside buildings shall be installed on a uniform grade of not less than 2 percent unless shown otherwise on the plans.

Drainage pipe shall be run as straight as possible and shall have easy bends with long turns.

Wye fittings and 1/8 or 1/16 bends shall be used where possible. Long sweep bends and combination Wye and 1/8 bends may be used only for the connection of branch pipes to fixtures and on vertical runs of pipe.

PVC pipe sleeves shall be provided where each pipe passes through concrete floors, footings, walls or ceilings. Inside diameter of sleeves shall be at least 20 mm larger than outside diameter of pipe. Sleeves shall be installed to provide at least 10 mm space all around pipe the full depth of concrete. Space between pipes and pipe sleeves shall be caulked watertight.

Cutting pipe.--All pipe shall be cut straight and true and the ends shall be reamed to the full inside diameter of the pipe after cutting.

Damaged pipe.--Pipe that is cracked, bent or otherwise damaged shall be removed from the work.

Pipe joints and connections.--Joints in threaded steel pipe shall be made with teflon tape or a pipe joint compound that is nonhardening and noncorrosive, placed on the pipe and not in the fittings.

The use of thread cement or caulking on threaded joints will not be permitted. Threaded joints shall be made tight. Long screw or other packed joints will not be permitted. Any leaky joints shall be remade with new material.

Exposed polished or enameled connections to fixtures or equipment shall be made with special care, showing no tool marks or threads.

Cleaning and closing pipe.--The interior of all pipe shall be cleaned before installation. All openings shall be capped or plugged as soon as the pipe is installed to prevent the entrance of any materials. The caps or plugs shall remain in place until their removal is necessary for completion of the installation.

Securing pipe.--Pipe in the buildings shall be held in place by iron hangers, supports, pipe rests, anchors, sway braces, guides or other special hangers. Material for hangers and supports shall be compatible with the piping or neoprene isolators shall be used. Allowances shall be made for expansion and contraction. Steel pipe shall have hangers or supports every 3 m. Copper pipe 25 mm or smaller shall have hangers or supports every 2 m and sizes larger than 25 mm shall have hangers or supports every 3 m. Cast iron soil pipe with neoprene gaskets shall be supported at each joint. Vertical pipes shall be supported with clamps or straps. Horizontal and vertical piping shall be securely supported and braced to prevent swaying, sagging or flexing of joints.

Union.--Unions shall be installed where shown and at each threaded or soldered connection to equipment and tanks. Unions shall be located so piping can be easily disconnected for removal of equipment or tanks. Unions shall be omitted at compression stops.

Compression stop.--Each fixture, including hose faucets, shall be equipped with a compression stop installed on water supply pipes to permit repairs without shutting off water mains. Ball valves may be installed where shown on the plans or otherwise permitted by the Engineer.

Flushing completed systems.--All completed systems shall be flushed and blown out.

Chlorination.--The Contractor shall flush and chlorinate all domestic water piping and fixtures.

Calcium hypochlorite granules or tablets, if used, shall not be applied in the dry form, but shall first be dissolved into a solution before application.

The Contractor shall take adequate precautions in handling chlorine so as not to endanger workmen or damage materials. All pipes and fittings shall be completely filled with water containing a minimum of 50 ppm available chlorine. Each outlet in the system shall be opened and water run to waste until a strong chlorine test is obtained. The line shall then be closed and the chlorine solution allowed to remain in the system for a minimum of 24 hours so that the line shall contain no less than 25 ppm chlorine throughout. After the retention period, the system shall be drained, flushed and refilled with fresh water.

FIELD QUALITY CONTROL.--

Testing.--The Contractor shall test piping at completion of installation , and at other times as directed by the Engineer. The system shall be tested as a single unit. The Contractor shall furnish necessary materials and labor and notify the Engineer at least 3 working days in advance of testing. After testing, the Contractor shall repair all leaks and retest to determine that leaks have been stopped. The Contractor shall take precautions to prevent joints from drawing while pipes and appurtenances are being tested. The Contractor shall repair damage to pipes and appurtenances or to other structures resulting from or caused by tests.

General tests.--All piping shall be tested after assembly . Systems shall show no loss in pressure or visible leaks. The Contractor shall test systems according to the following schedule for a period of not less than 4 hours:

Test Schedule		
Piping System	Test Pressure	Test Media
Sanitary sewer and vent	operating head	Water
Water	operating pressure	Water

Sanitary sewers shall be cleared of obstructions before testing for leakage. The pipe shall be proved clear of obstructions by pulling an appropriate size inflatable plug through the pipe. The plug shall be moved slowly through the pipe with a tag line. The Contractor shall remove or repair any obstructions or irregularities.

12-15.03 PLUMBING FIXTURES

PART 1.- GENERAL

SUMMARY.--

Scope.--This work shall consist of the furnishing and installing plumbing fixtures in accordance with the details shown on the plans and these special provisions.

PART 2.- PRODUCTS

General.--Plumbing fixtures shall meet the following requirements:

Water chiller.--

Water chiller shall be a standard commercially manufactured remote type, 115 volts AC, air-cooled with an adjustable temperature control dial, and shall produce a minimum of 50 liters of 10°C water per hour based on an inlet water temperature of 27°C and an ambient room temperature of 32°C.

Water chiller compressor shall be hermetically sealed and insulated.

Water chiller shall be Haws, HRC414; Elkay, ER-14; Sunroc, RP-14-4; or equal.

Drinking fountain.--

Drinking fountain shall have approximately 356 mm diameter stainless steel circular receptor and stainless steel combination drain enclosure and mounting bracket. Fountain shall be equipped with front push bar operator, 32 mm drain, screwdriver stop, bubbler, and vandal resistant bottom plate fasteners. Size requirements shall be as shown on the plans.

PART 3.- EXECUTION

INSTALLATION.--

General.--All finish for exposed metal on any fixture, including wall flanges, bolts, nuts and washers, shall be polished chrome plated.

Fixtures shall be sealed to wall with silicone caulk bead.

All exposed metal surfaces on fixture supports shall be enameled to harmonize with fixtures.

Wall mounted fixtures shall be installed on concealed carriers designed to support weight of fixture from the floor. Carriers shall be made for the specific fixture to be supported and for the particular installation conditions.

All fixtures shall be provided with accessible compression stops.

Fixture mounting heights.--Unless otherwise noted, all fixtures shall be mounted at the heights shown on plans.

Water chiller.-- Water chiller shall be installed in the plumbing gallery near the drinking fountains on a galvanized steel wall shelf with brackets, adequately sized and bolted to the wall. Headroom and walking spaces in the plumbing gallery shall be preserved.

Insulation.--All water pipe between the water chiller and drinking fountains shall be wrapped with insulating material.

FIELD QUALITY CONTROL.--

Testing.--The Contractor shall test piping as specified elsewhere in these special provisions.

The Engineer will inspect all installed fixtures for proper installation and test for proper operation after all plumbing work is complete.

SECTION 12-16. ELECTRICAL

12-16.01 ELECTRICAL WORK

PART 1.- GENERAL

SUMMARY.--

Scope.--This work shall consist of performing electrical work in accordance with the details shown on the plans and these special provisions.

Electrical work shall include furnishing all labor, materials, equipment and services required to construct and install the complete electrical system shown on the plans and the work of installing electrical connections for the thermostats, motors, and controls specified elsewhere in these special provisions.

System layouts are generally diagrammatic and location of equipment is approximate. Exact routing of conduits and other facilities and location of equipment is to be governed by structural conditions and other obstructions, and shall be coordinated with the work of other trades. Equipment requiring maintenance and inspection shall be located where it is readily accessible for the performance of such maintenance and inspection.

Related work.--Earthwork, foundations, sheet metal, painting, mechanical and such other work incidental to and necessary for the proper installation and operation of the electrical work shall be done in accordance with the requirements specified for similar work elsewhere in these special provisions.

QUALITY ASSURANCE.--

Codes and standards.--All work performed and materials installed shall be in accordance with the National Electrical Code; the California Building Standards Code, Title 24, Part 3, "California Electrical Code," and the California Code of Regulations, Title 8, Chapter 4, "Electrical Safety Orders," and all state ordinances.

Warranties and guarantees.--Manufacturer's warranties and guarantees for materials or equipment used in the work shall be delivered to the Engineer at the jobsite prior to acceptance of the contract.

TESTING.--

After the electrical system installation work has been completed, the electrical system shall be tested in the presence of the Engineer to demonstrate that the electrical system functions properly. The Contractor shall make necessary repairs, replacements, adjustments and retests at his expense.

12-16.02 BASIC MATERIALS AND METHODS

PART 1.- GENERAL

SUMMARY.--

Scope.--This work shall consist of furnishing and installing conduits, conductors, and fittings in accordance with the details shown on the plans and these special provisions.

Conduits, conductors, and fittings shall include those accessories and appurtenances, not mentioned, that are required for the proper installation and operation of the electrical system.

SUBMITTALS.--

Product data.--A list of materials and equipment to be installed, manufacturer's descriptive data, and such other data as may be requested by the Engineer shall be submitted for approval.

PART 2.- PRODUCTS

CONDUITS AND FITTINGS.--

Rigid steel conduit and fittings.--

Rigid steel conduit shall be threaded, full weight rigid steel, hot-dip galvanized inside and outside with steel or malleable iron fittings. Fittings shall be threaded unless otherwise specified or shown on the plans.

Split or three-piece couplings shall be electroplated, malleable cast iron couplings.

Insulated grounding bushings shall be threaded malleable cast iron body with plastic insulated throat and steel, lay-in ground lug with compression screw.

Insulated metallic bushings shall be threaded malleable cast iron body with plastic insulated throat.

Electrical metallic tubing (EMT) and fittings.--

Electrical metallic tubing shall be formed of cold rolled strip steel, electrical resistance welded continuously along the longitudinal seam with zinc coating outside and enamel or lacquer coating inside.

Couplings shall be electroplated, rain and concrete tight, gland compression type, steel body couplings with malleable iron nuts.

Connectors shall be electroplated, rain and concrete tight, gland compression type, steel body connectors with male hub, malleable iron nut and insulated plastic throat.

Flexible metallic conduit and fittings.--

Flexible metallic conduit shall be fabricated in continuous lengths from galvanized steel strip, spirally wound and formed to provide an interlocking design.

Fittings shall be electroplated screw-in type with malleable cast iron body and threaded male hub with insulated throat.

Liquid tight flexible metallic conduit and fittings.--

Liquid tight flexible metallic conduit shall be fabricated in continuous length from galvanized sheet steel, spirally wound and formed to provide an interlocking design with an extruded polyvinyl chloride cover.

Fittings shall be electroplated, malleable cast iron body, with cap nut, grounding ferrule, and connector body with insulated throat.

CONDUCTORS.--

Conductors.--

Conductors shall be stranded copper wire.

Conductor insulation types unless otherwise shown or specified, shall be as follows:

1. Conductors across hinges of control panel enclosures shall be Type MTW.
2. Conductors shall be type XHHW in wet and outdoor locations.
3. Conductors shall be type THHN in dry locations.

Wire connections and devices.--

Wire connections and devices shall be pressure or compression type, except that connectors for No. 10 AWG and smaller conductors in dry locations may be preinsulated spring-pressure type.

ELECTRICAL BOXES.--

Outlet, device and junction boxes.--

Unless otherwise shown or specified, boxes shall be galvanized steel boxes with knock-outs and shall be the size and configuration best suited to the application indicated on the plans. Minimum size of outlet or junction boxes shall be 100 mm square by 40 mm deep.

Cast metal boxes shall be cast iron boxes with threaded hubs and shall be of the size and configuration best suited to the application shown on the plans.

Unless otherwise shown or specified, surface-mounted boxes shall have galvanized steel covers with metal screws.

Weatherproof junction boxes shall have cast metal covers with gaskets.

MISCELLANEOUS MATERIALS.--

Anchorage devices.--

Anchorage devices shall be corrosion resistant, toggle bolts, wood screws, bolts, machine screws, studs, expansion shields, and expansion anchors and inserts.

Electrical supporting devices.--

Electrical supporting devices shall be one hole conduit clamps with clamp backs, hot-dipped galvanized, malleable cast iron.

Construction channel shall be 41 mm x 41 mm, 2.66 mm (12-gage) galvanized steel channel with 13 mm diameter bolt holes, 40 mm on center in the base of the channel.

PART 3.- EXECUTION

INSTALLATION.--

Conduit, general.--Rigid steel conduit shall be used unless otherwise shown on the plans or specified in these special provisions.

Electrical metallic tubing may be used in furred spaces and for exposed work indoors 1.2 meter above the floor or higher.

Unless otherwise specified or shown on the plans, flexible metal conduit shall be used to connect motors and other equipment subject to vibration in dry locations.

Unless otherwise specified or shown on the plans, liquid-tight flexible metal conduit shall be used to connect motors and other equipment subject to vibration in wet locations.

Conduit installation.--Conduit trade sizes are shown on the plans. No deviation from the conduit size shown on the plans will be permitted without written permission from the Engineer.

Conduit shall be concealed unless otherwise shown on the plans.

Conduits shall be tightly covered and well protected during construction using metallic bushings and bushing "pennies" to seal open ends.

Locations of conduit runs shall be planned in advance of the installation and coordinated with the ductwork, plumbing, ceiling and wall construction in the same areas and shall not unnecessarily cross other conduits or pipe, nor prevent removal of ceiling tiles or panels, nor block access to mechanical or electrical equipment.

Where practical, conduits shall be installed in groups in parallel, vertical or horizontal runs and at elevations that avoid unnecessary offsets.

Exposed conduit shall be installed parallel and at right angles to the building lines.

All raceway systems shall be secured to the building structures using specified fasteners, clamps and hangers.

Single conduit runs shall be supported by using one hole pipe clamps. Where run horizontally on walls in damp or wet locations, conduit shall be installed with "clamp backs" to space conduit off the surface.

Multiple conduit runs shall be supported with construction channel secured to the building structure. Conduits shall be fastened to construction channel with channel compatible pipe clamps.

Raceways of different types shall be joined using approved couplings or transition fittings.

All floor and wall penetrations shall be sealed water-tight.

Existing underground conduit to be incorporated into a new system shall be cleaned with a mandrel or cylindrical wire brush and blown out with compressed air.

Conduit terminations.--Rigid steel conduits shall be securely fastened to cabinets, boxes and gutters using 2 locknuts and specified insulating metallic bushing. Electrical metallic tubing shall be securely fastened to cabinets, boxes and gutters using specified connectors. Conduit terminations at exposed weatherproof enclosures and cast outlet boxes shall be made watertight using specified hubs.

Grounding bushings with bonding jumpers shall be installed on all type of conduits terminating at concentric knockouts and on all conduits containing service conductors, grounding electrode conductor, and conductors feeding separate buildings.

Conductor and cable installation.--Conductors shall not be installed in conduit until all work of any nature that may cause injury is completed. Care shall be taken in pulling conductors that insulation is not damaged. An approved non-petroleum base and insulating type pulling compound shall be used as needed.

All cables shall be installed and tested in accordance with manufacturer's recommendations.

Splices and joints shall be insulated with insulation equivalent to that of the conductor.

Provide 155 mm of slack at each outlet and device connection. If the outlet or device is not at the end of a run of wire, connection shall be made with correctly colored pigtails tapped to the runs with splices as specified herein.

Branch circuit conductors in panelboards and load centers shall be neatly trained along a path from the breaker terminals to their exit point. The conductors shall have ample length to transverse the path without strain, but shall not be so long as to require coiling, doubling back, or cramming. The path shall transverse the panelboard gutter spaces without entering a gutter containing service conductors and, unless otherwise shown on the plans, without entering the gutter space of any panelboard feeder.

All pressure type connectors and lugs shall be retightened after the initial set.

Splices in underground pull boxes and similar locations shall be made watertight.

Junction boxes in furred or accessible ceiling spaces shall be identified with felt-tip pen denoting the circuits contained in the box.

Conductor identification.--The neutral and equipment grounding conductors shall be identified as follows:

Neutral conductor shall have a white or natural gray insulation except that conductors No. 4 and larger may be identified by distinctive white marker such as paint or white tape at each termination.

Equipment grounding conductor shall be bare or insulated. If insulated, equipment grounding conductors shall have green or green with one or more yellow stripes insulation over its entire length except that conductors No. 4 and larger may be permanently identified by distinctive green markers such as paint or green tape over its entire exposed insulation.

Feeder and branch circuit ungrounded conductors shall be color coded by continuously colored insulation, except conductors No. 6 AWG or larger may be color coded by colored tape at each connection and where accessible. Ungrounded conductor color coding shall be as follows:

SYSTEM	COLOR CODE
120/240V-Single phase	Black, blue

Where more than one branch circuit enters or leaves a conduit, panel, gutter, or junction box, each conductor shall be identified by its panelboard and circuit number. Identification shall be made with one of the following:

1. Adhesive backed paper or cloth wrap-around markers with clear, heat shrinkable tubing sealed over either type of marker.
2. Self-laminating wrap around type, printable, transparent, permanent heat bonding type thermoplastic film markers.
3. Pre-printed, white, heat-shrinkable tubing.

Outlet, device and junction box installation.--Where one or more threaded steel conduits are required to connect to an outlet, device, or junction box, the box shall be a cast metal box with threaded hubs. Unless otherwise shown on the plans or specified in these special provisions, all other boxes shall be sheet steel boxes. Weatherproof outlet, device and junction boxes shall have cast metal covers with gaskets. Unless otherwise shown on the plans or specified in these special provisions, all other boxes shall have standard galvanized covers.

No unused openings shall be left in any box. Knockout seals shall be installed as required to close openings.

Outlet, device, and junction boxes shall be installed at the locations and elevations shown on the plans or specified herein. Adjustments to locations may be made as required by structural conditions and to suit coordination requirements of other trades.

Anchorage.--Hangers, brackets, conduit straps, supports, and electrical equipment shall be rigidly and securely fastened to surfaces by means of toggle bolts on hollow masonry; expansion shields and machine screws, or expansion anchors and studs or standard preset inserts on concrete or solid masonry; machine screws or bolts on metal surfaces; and wood or lag screws on wood construction.

Anchorage devices shall be installed in accordance with the anchorage manufacturer's recommendations.

12-16.03 TELEPHONE SERVICE

PART 1.- GENERAL

SUMMARY.--

Scope.--This work shall consist of modifying the existing public telephone service in accordance with the requirements of the serving utility, the details shown on the plans and these special provisions.

SUBMITTALS.--

Installation details.--The Contractor shall submit complete telephone service modification details to the serving utility for approval. Prior to submitting modification details to the serving utility, the Contractor shall have said drawings reviewed and stamped "APPROVED" by the Engineer. Submittals shall be approved by the serving utility prior to commencing work.

PART 2.- EXECUTION

Modification of the public telephone service shall be in accordance with the requirements of the serving utility and as shown on the approved modification details.

12-16.04 ELECTRICAL EQUIPMENT

PART 1.- GENERAL

SUMMARY.--

Scope.--This work shall consist of modifying existing panelboards in accordance with the details shown on the plans and these special provisions.

Related work.--Anchorage devices shall be as specified under "Basic Materials and Methods" elsewhere in this Section 12-16.

PART 2.- EXECUTION

INSTALLATION.--

Existing panelboards.--Provide new typewritten circuit directory reflecting changes made under the Contract.

12-16.05 LIGHTING

GENERAL.--This work shall consist of furnishing, installing and connecting all lighting equipment in accordance with the details shown on the plans and these special provisions.

SUBMITTALS.--Manufacturer's descriptive information, photometric curves, catalog cuts, and installation instructions shall be submitted for approval.

PRODUCTS.--

Lighting fixture lamps.--

Lighting fixture lamps shall be type and size as shown on the plans. Lamps shall be General Electric, Phillips, Sylvania, or equal. Fluorescent lamps, unless otherwise noted, shall be 4100K tri-phosphor with a CRI of 70 or greater.

Ballasts.--

All fixtures shall be equipped with high power factor ballasts suitable for the line voltage and for the type, size and number of lamps required by the fixture.

Lighting fixtures.--

Lighting fixtures shall be as shown on the plans and as specified herein. Outdoor luminaires shall be listed and labeled "Fixture Suitable For Wet Locations."

H1.--

Outdoor, square, ceiling mounted, 70-watt, 120-volt high pressure sodium luminaire with integral ballast. The luminaire shall be similar to the existing luminaires that mounted in the adjacent area.

MH1.--

Ceiling mounted, square, 100-watt, 120-volt metal halide luminaire with integral ballast, die-cast aluminum housing and one-piece injection molded polycarbonate lens.

EXECUTION.--

LIGHTING FIXTURES.--Lighting fixtures shall be mounted securely in accordance with the manufacturer's recommendations. Mounting methods shall be suitable for the particular type of ceiling or support at each location.

The Contractor shall provide all supports, hangers, spacers, channels, fasteners and other hardware necessary to support the fixtures.

Fixtures shall be set at the mounting heights shown on the plans, except heights shown shall be adjusted to meet conditions.

BALLASTS.--All fixtures shall be equipped with high power factor ballasts suitable for the line voltage and for the type, size and number of lamps required by fixture. All ballasts used in unheated areas inside the building shall be -20°C ballasts or less.